




C Alternative 2 - 500 kV single circuit transmission line replacement as seen from KVA Seg 1-8.

Note: Typical 115-foot-tall 500 kV single circuit towers used for simulation purposes.

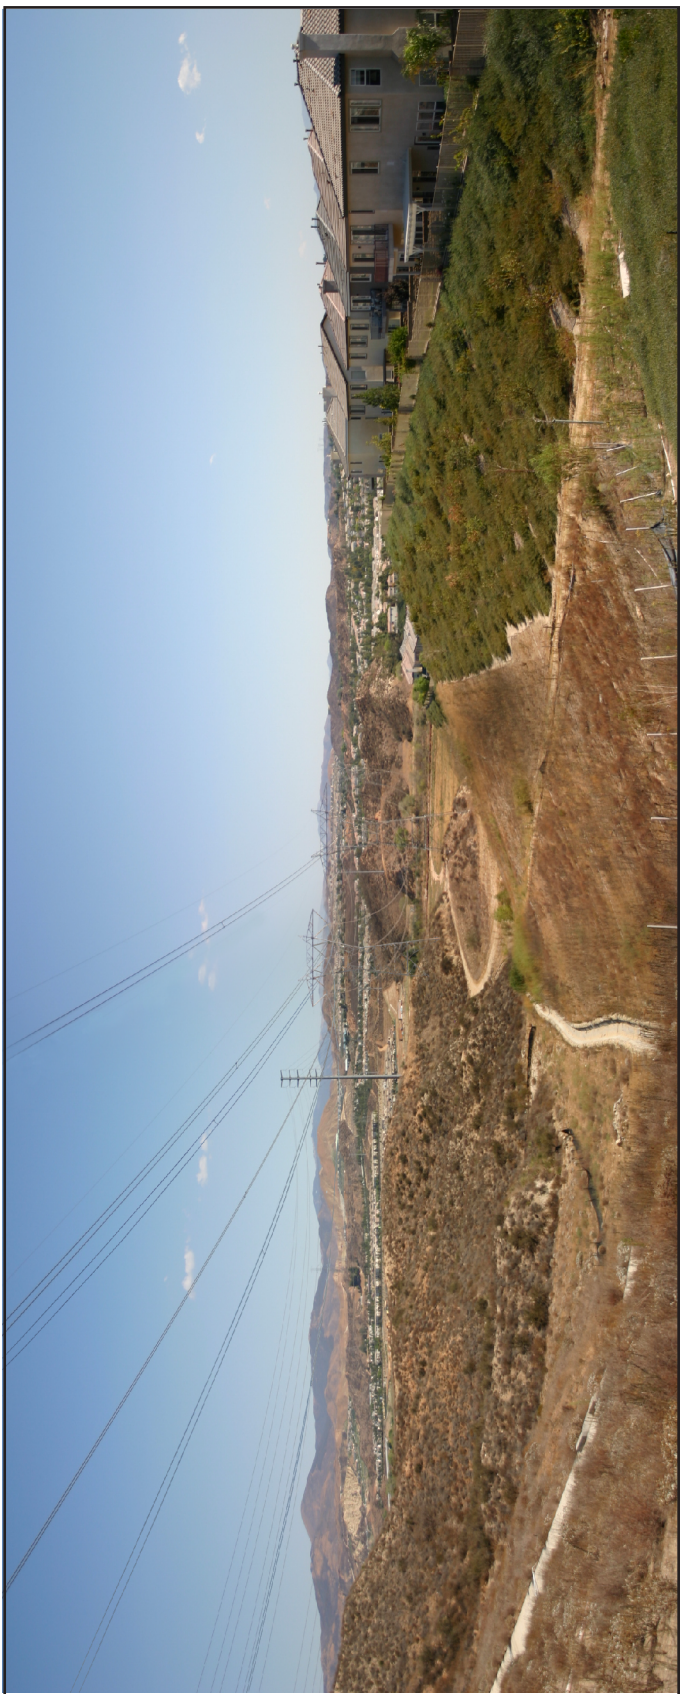

Antelope
Transmission Project PEA
Segment 1

Figure 5.2-8. □ KVA SEG 1-8 PHOTO C

2004