

**Figure 3.1.1-4: (Index) Talega-Escondido/Valley-Serrano 500 kV Interconnect Project**  
Source: The Nevada Hydro Company




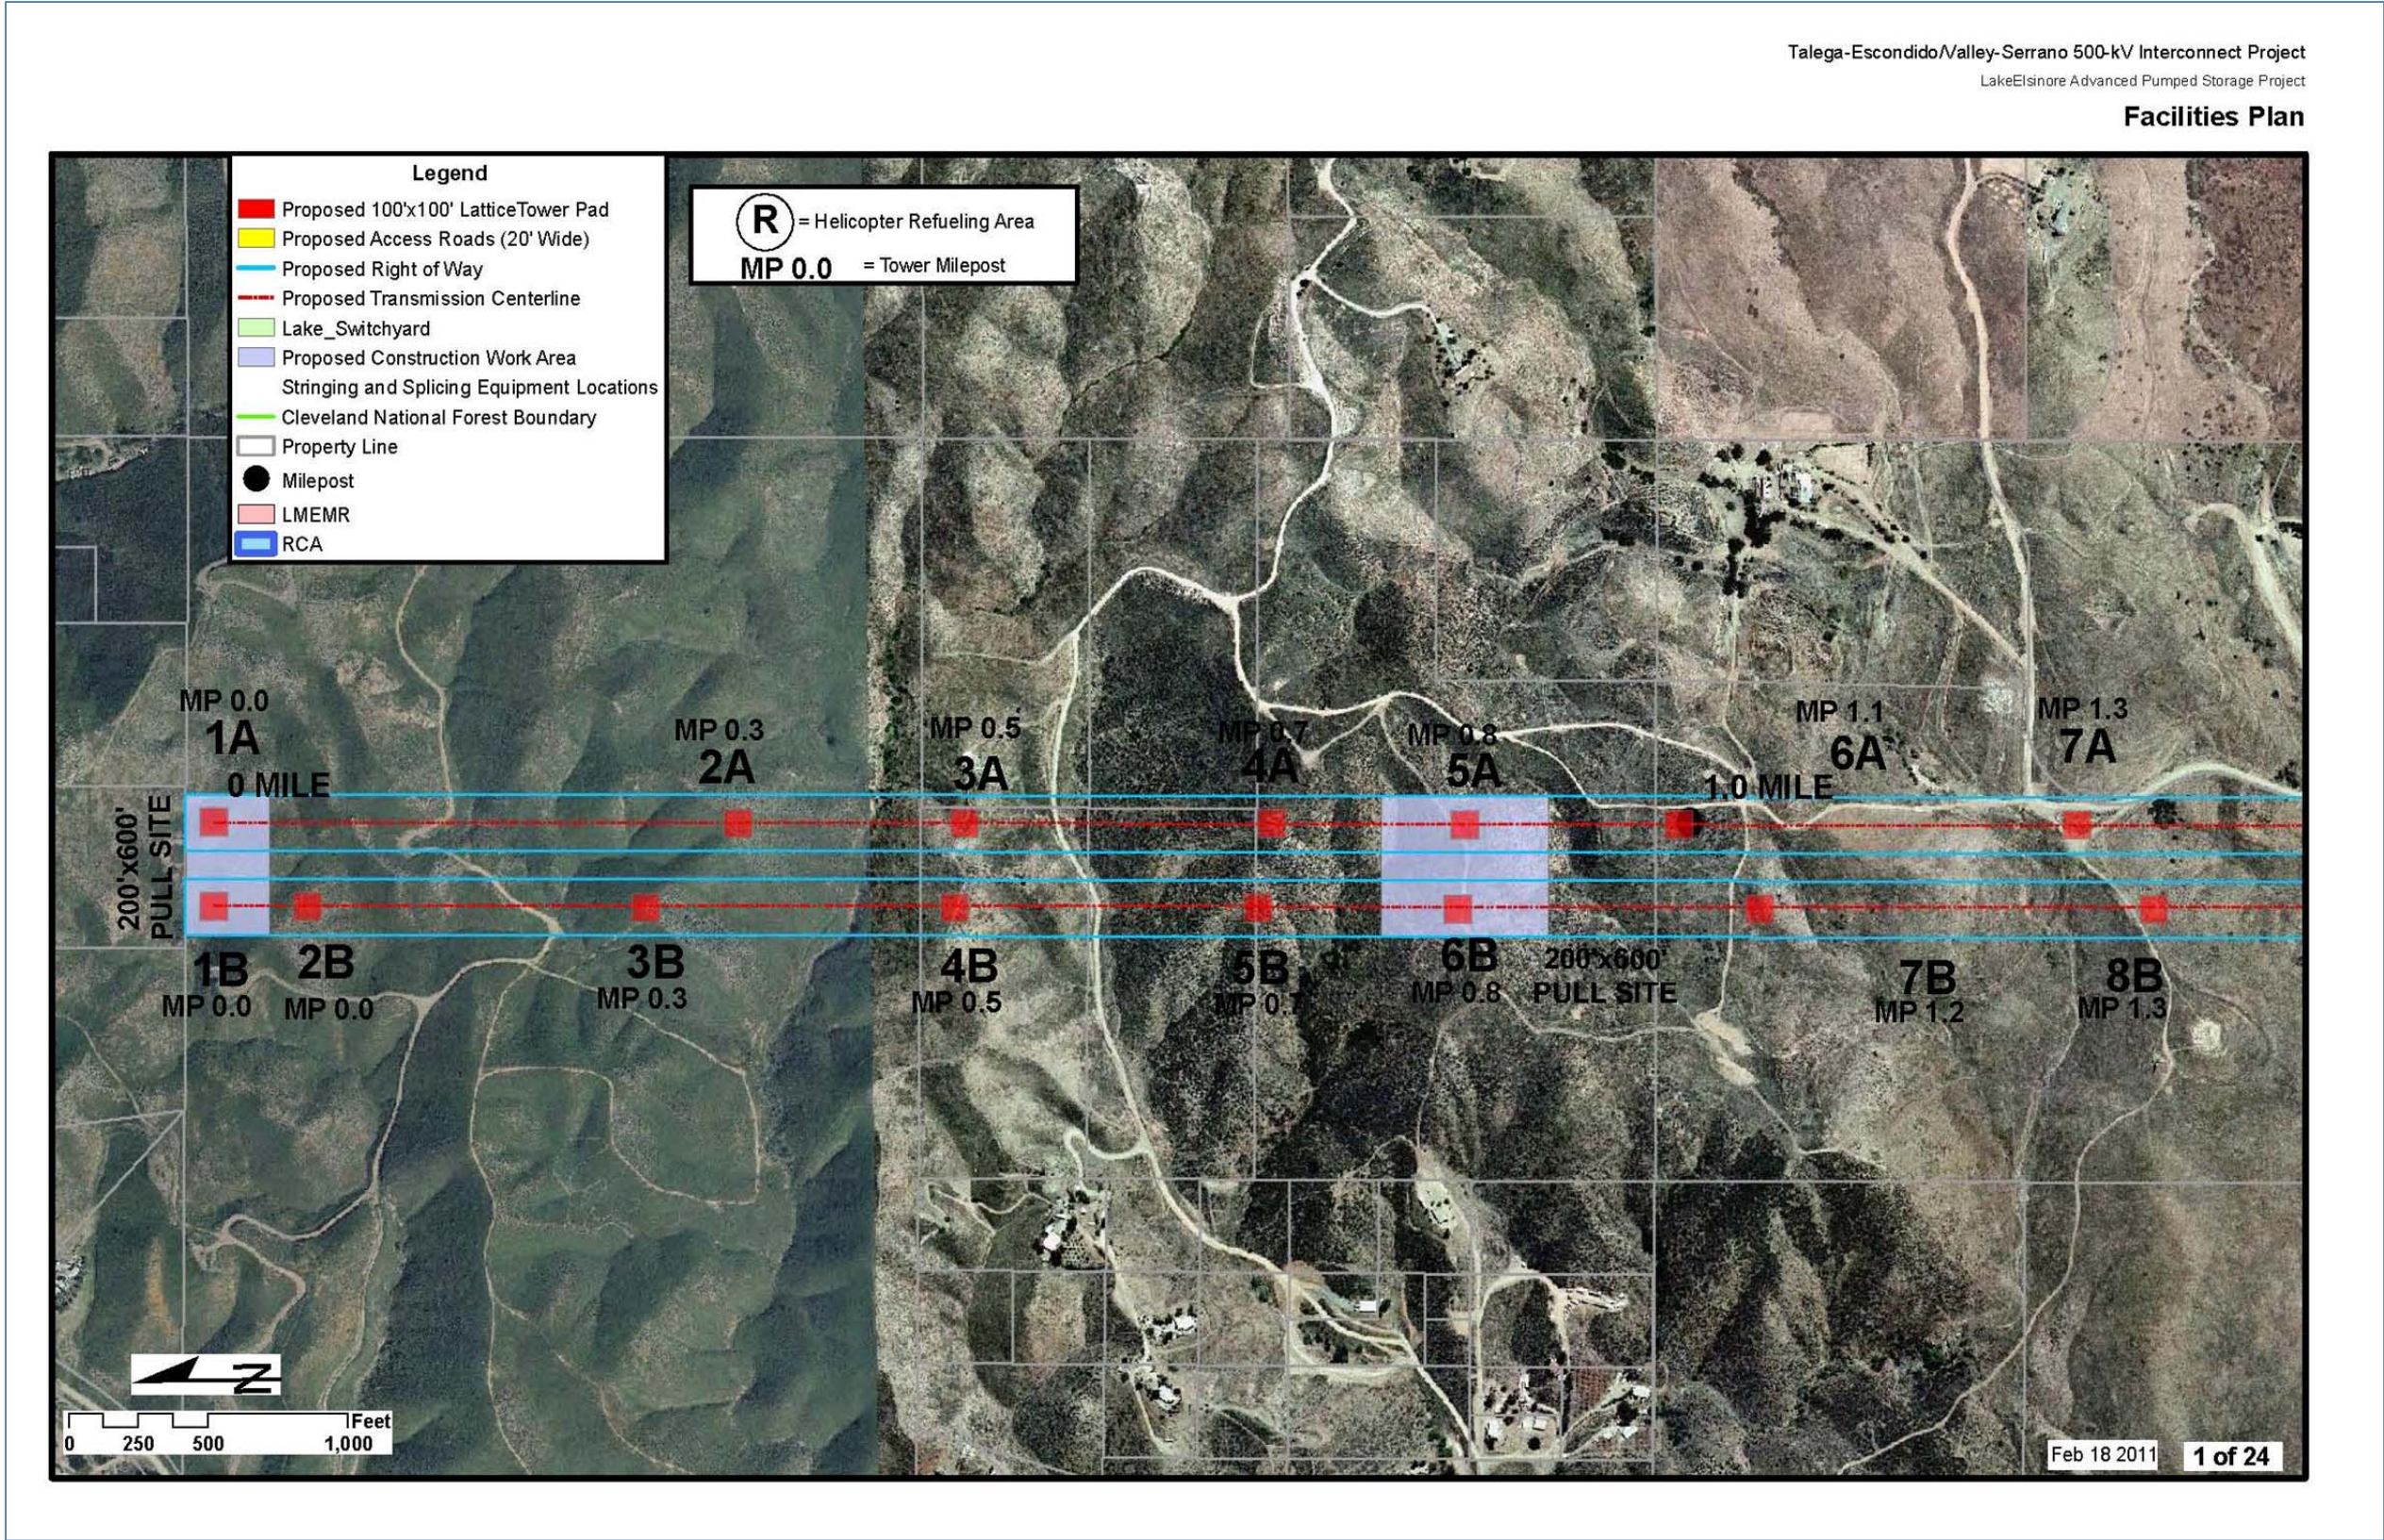


Figure 3.1.1-4: (1 of 24) Talega-Escondido/Valley-Serrano 500 kV Interconnect Project


Source: The Nevada Hydro Company



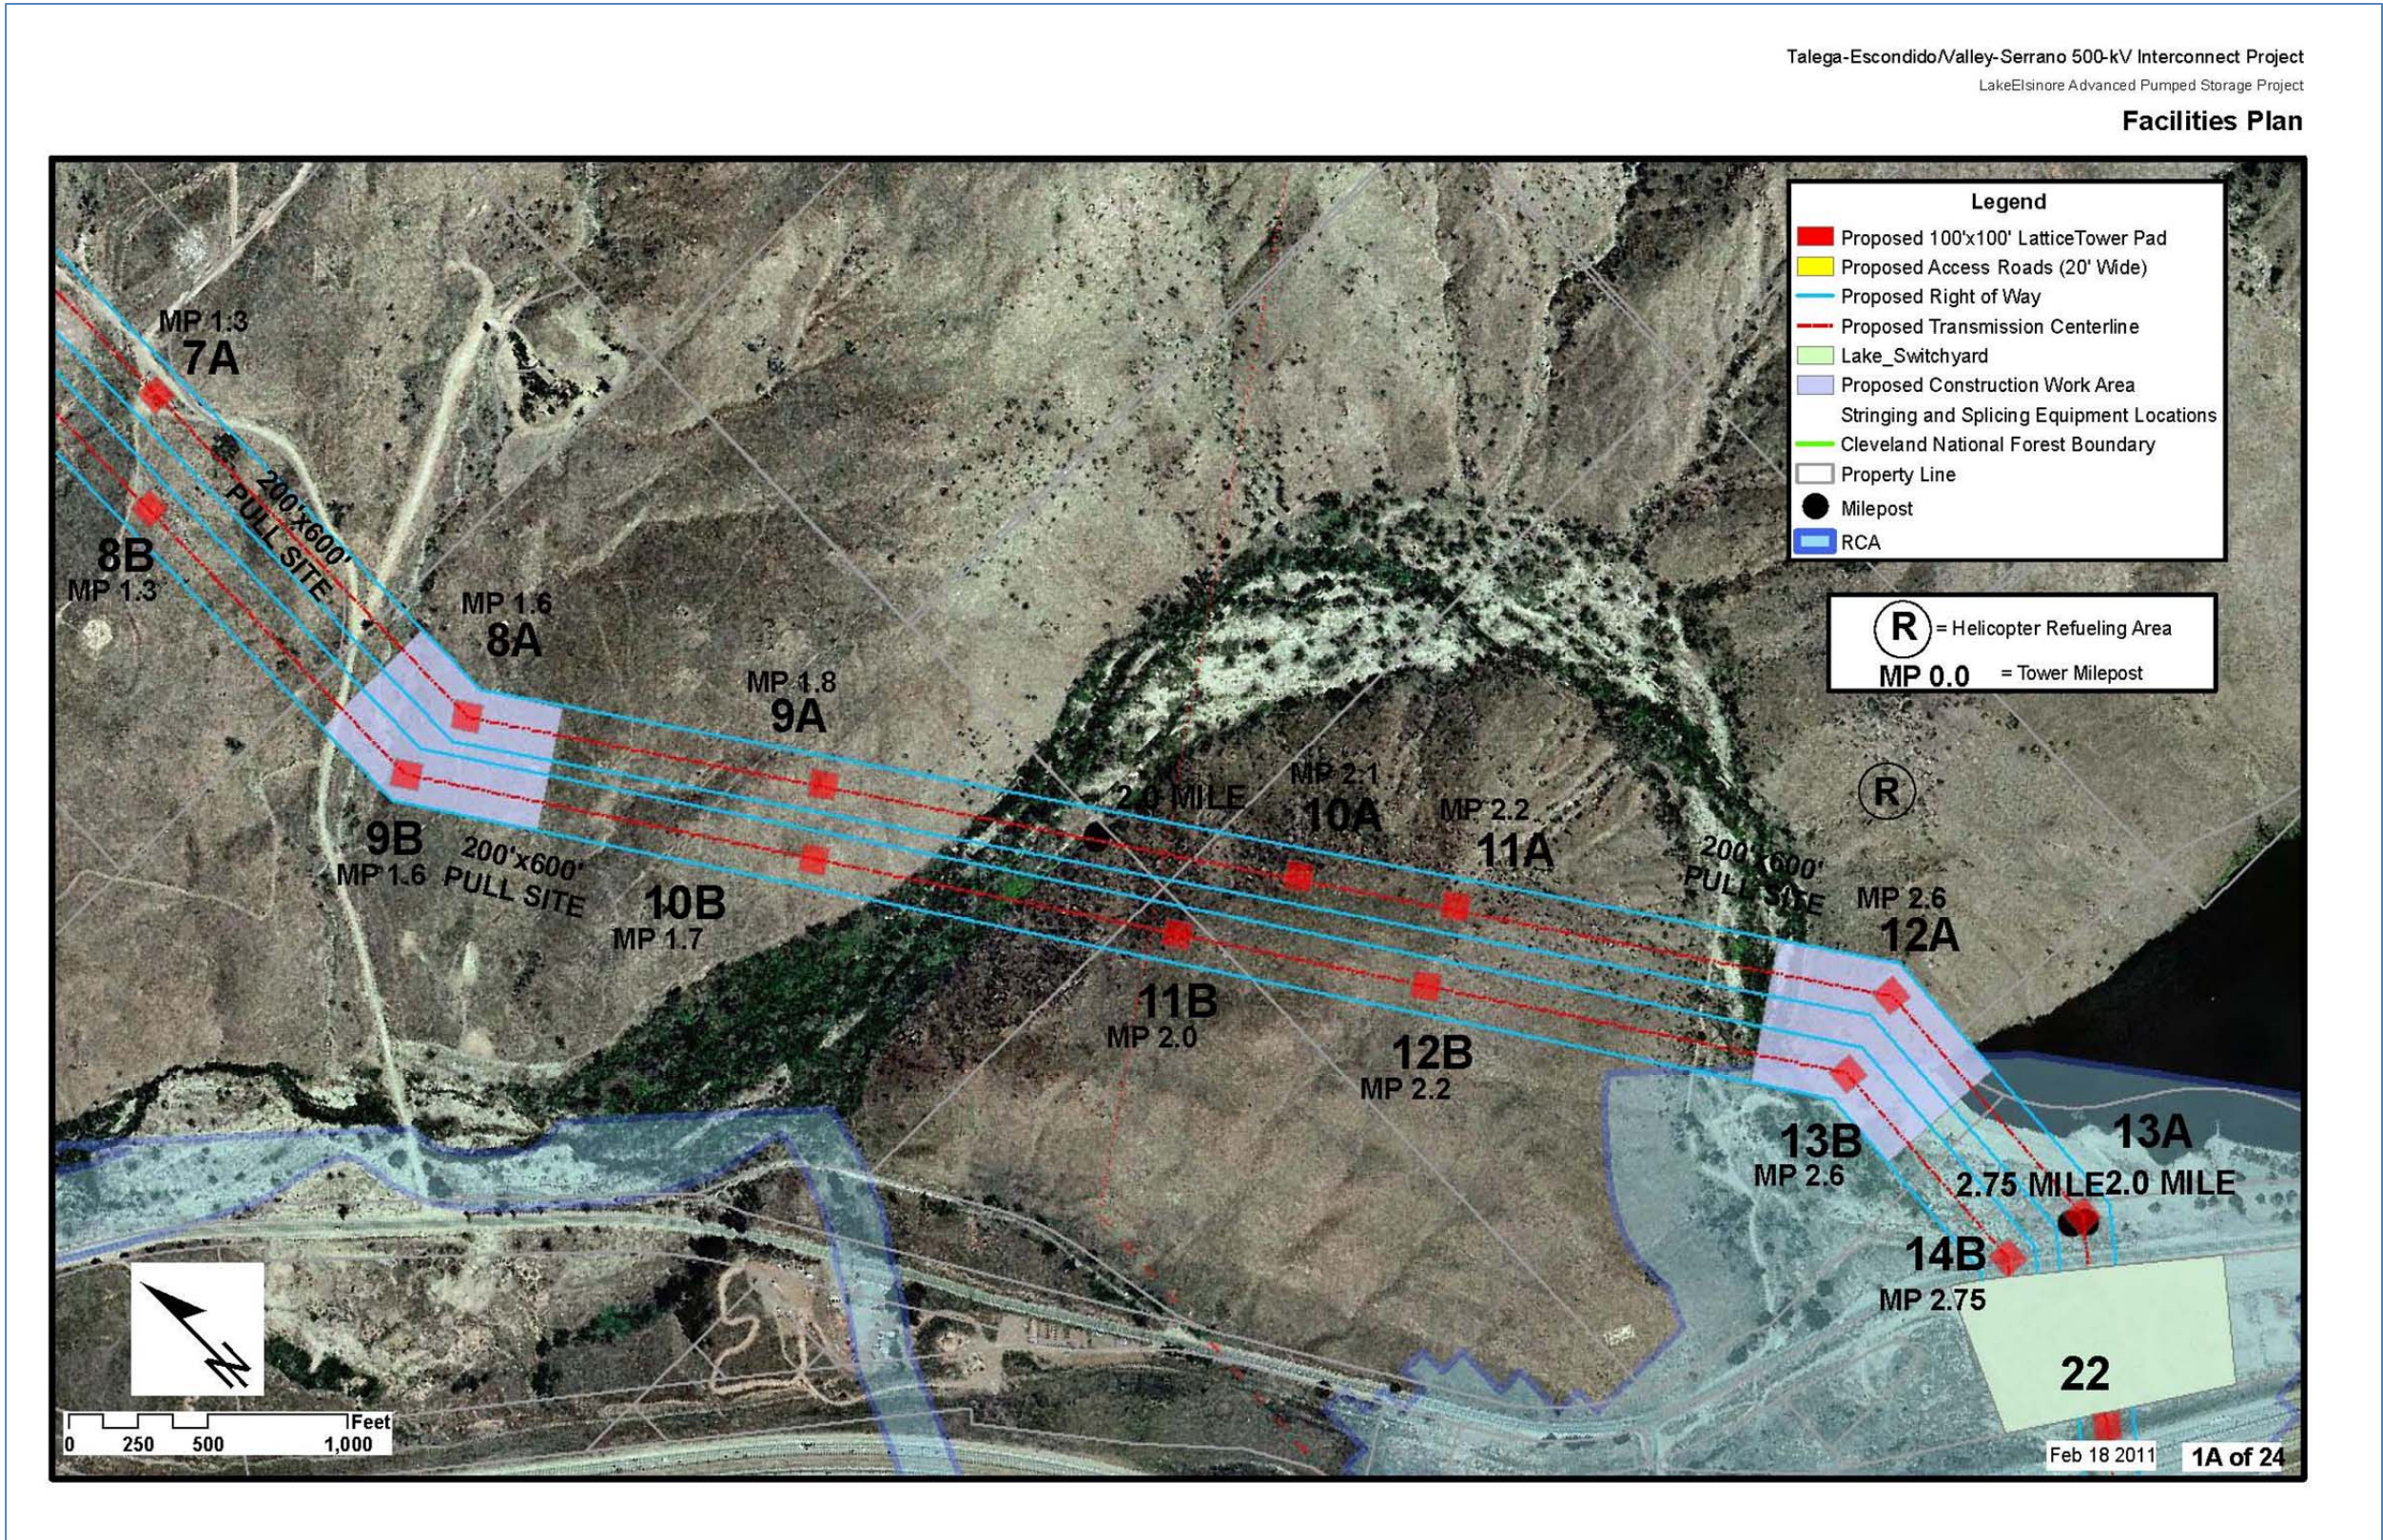

**Figure 3.1.1-4: (1A of 24) Talega-Escondido/Valley-Serrano 500 kV Interconnect Project**  
Source: The Nevada Hydro Company



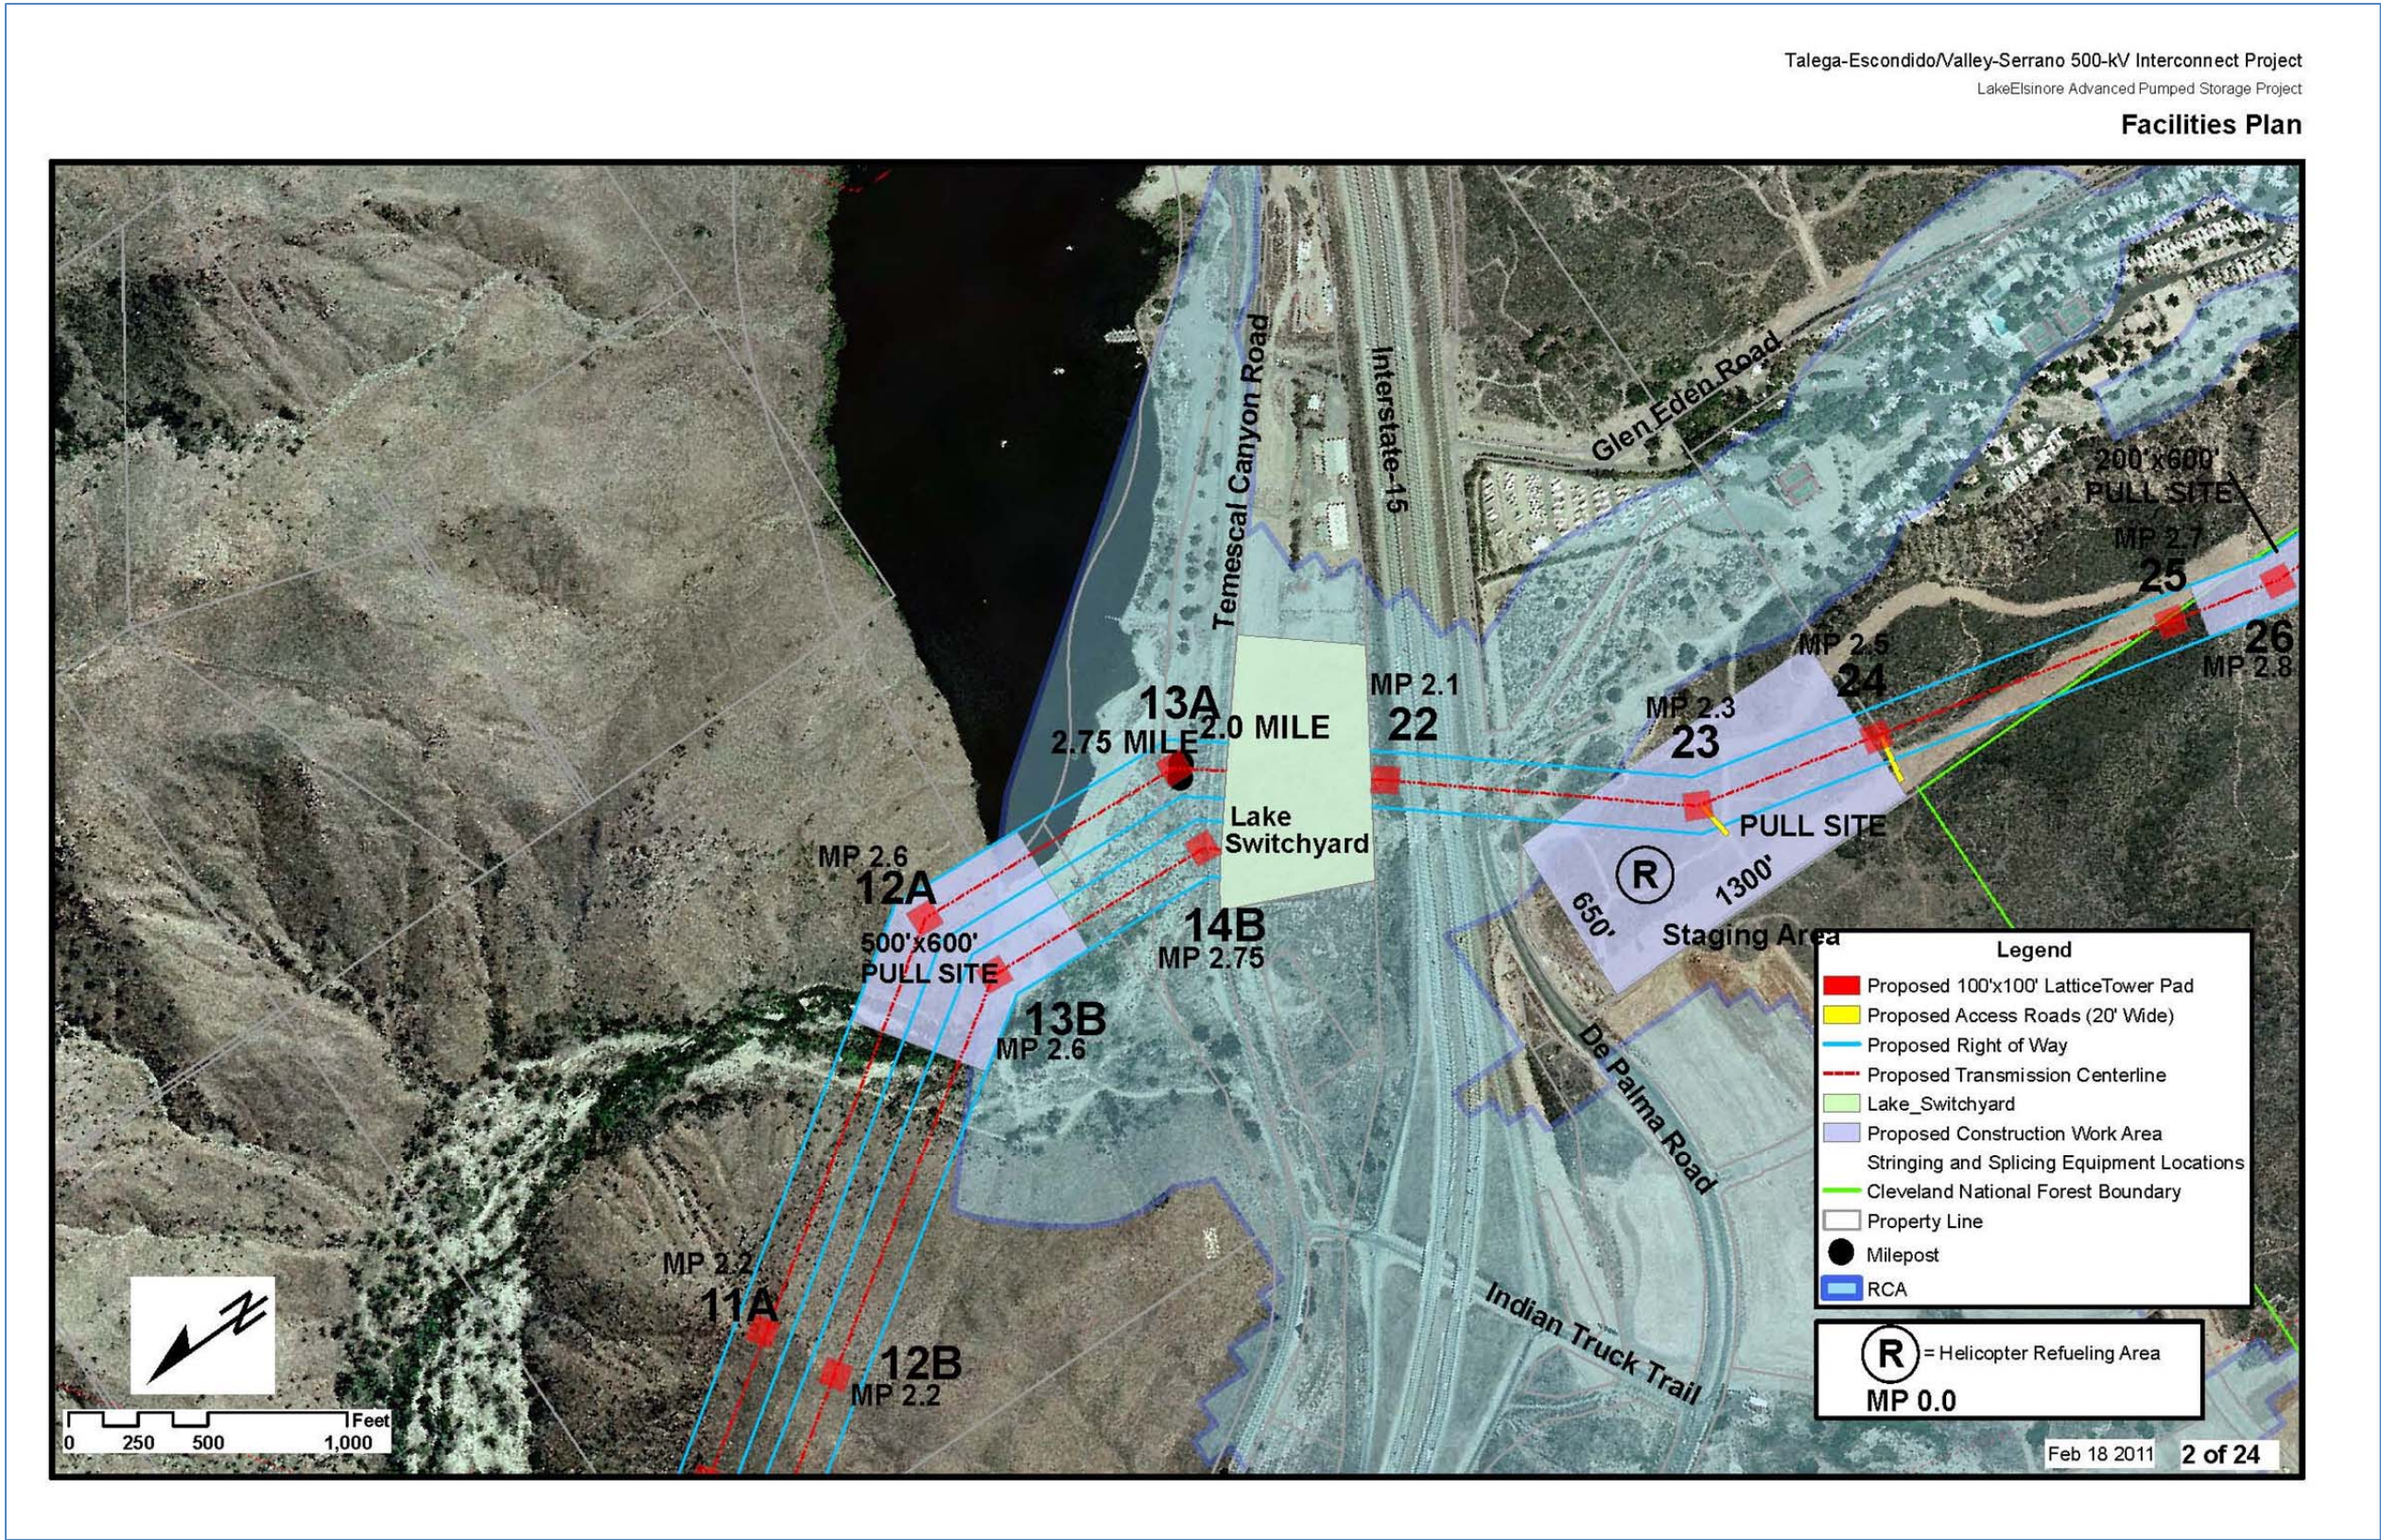




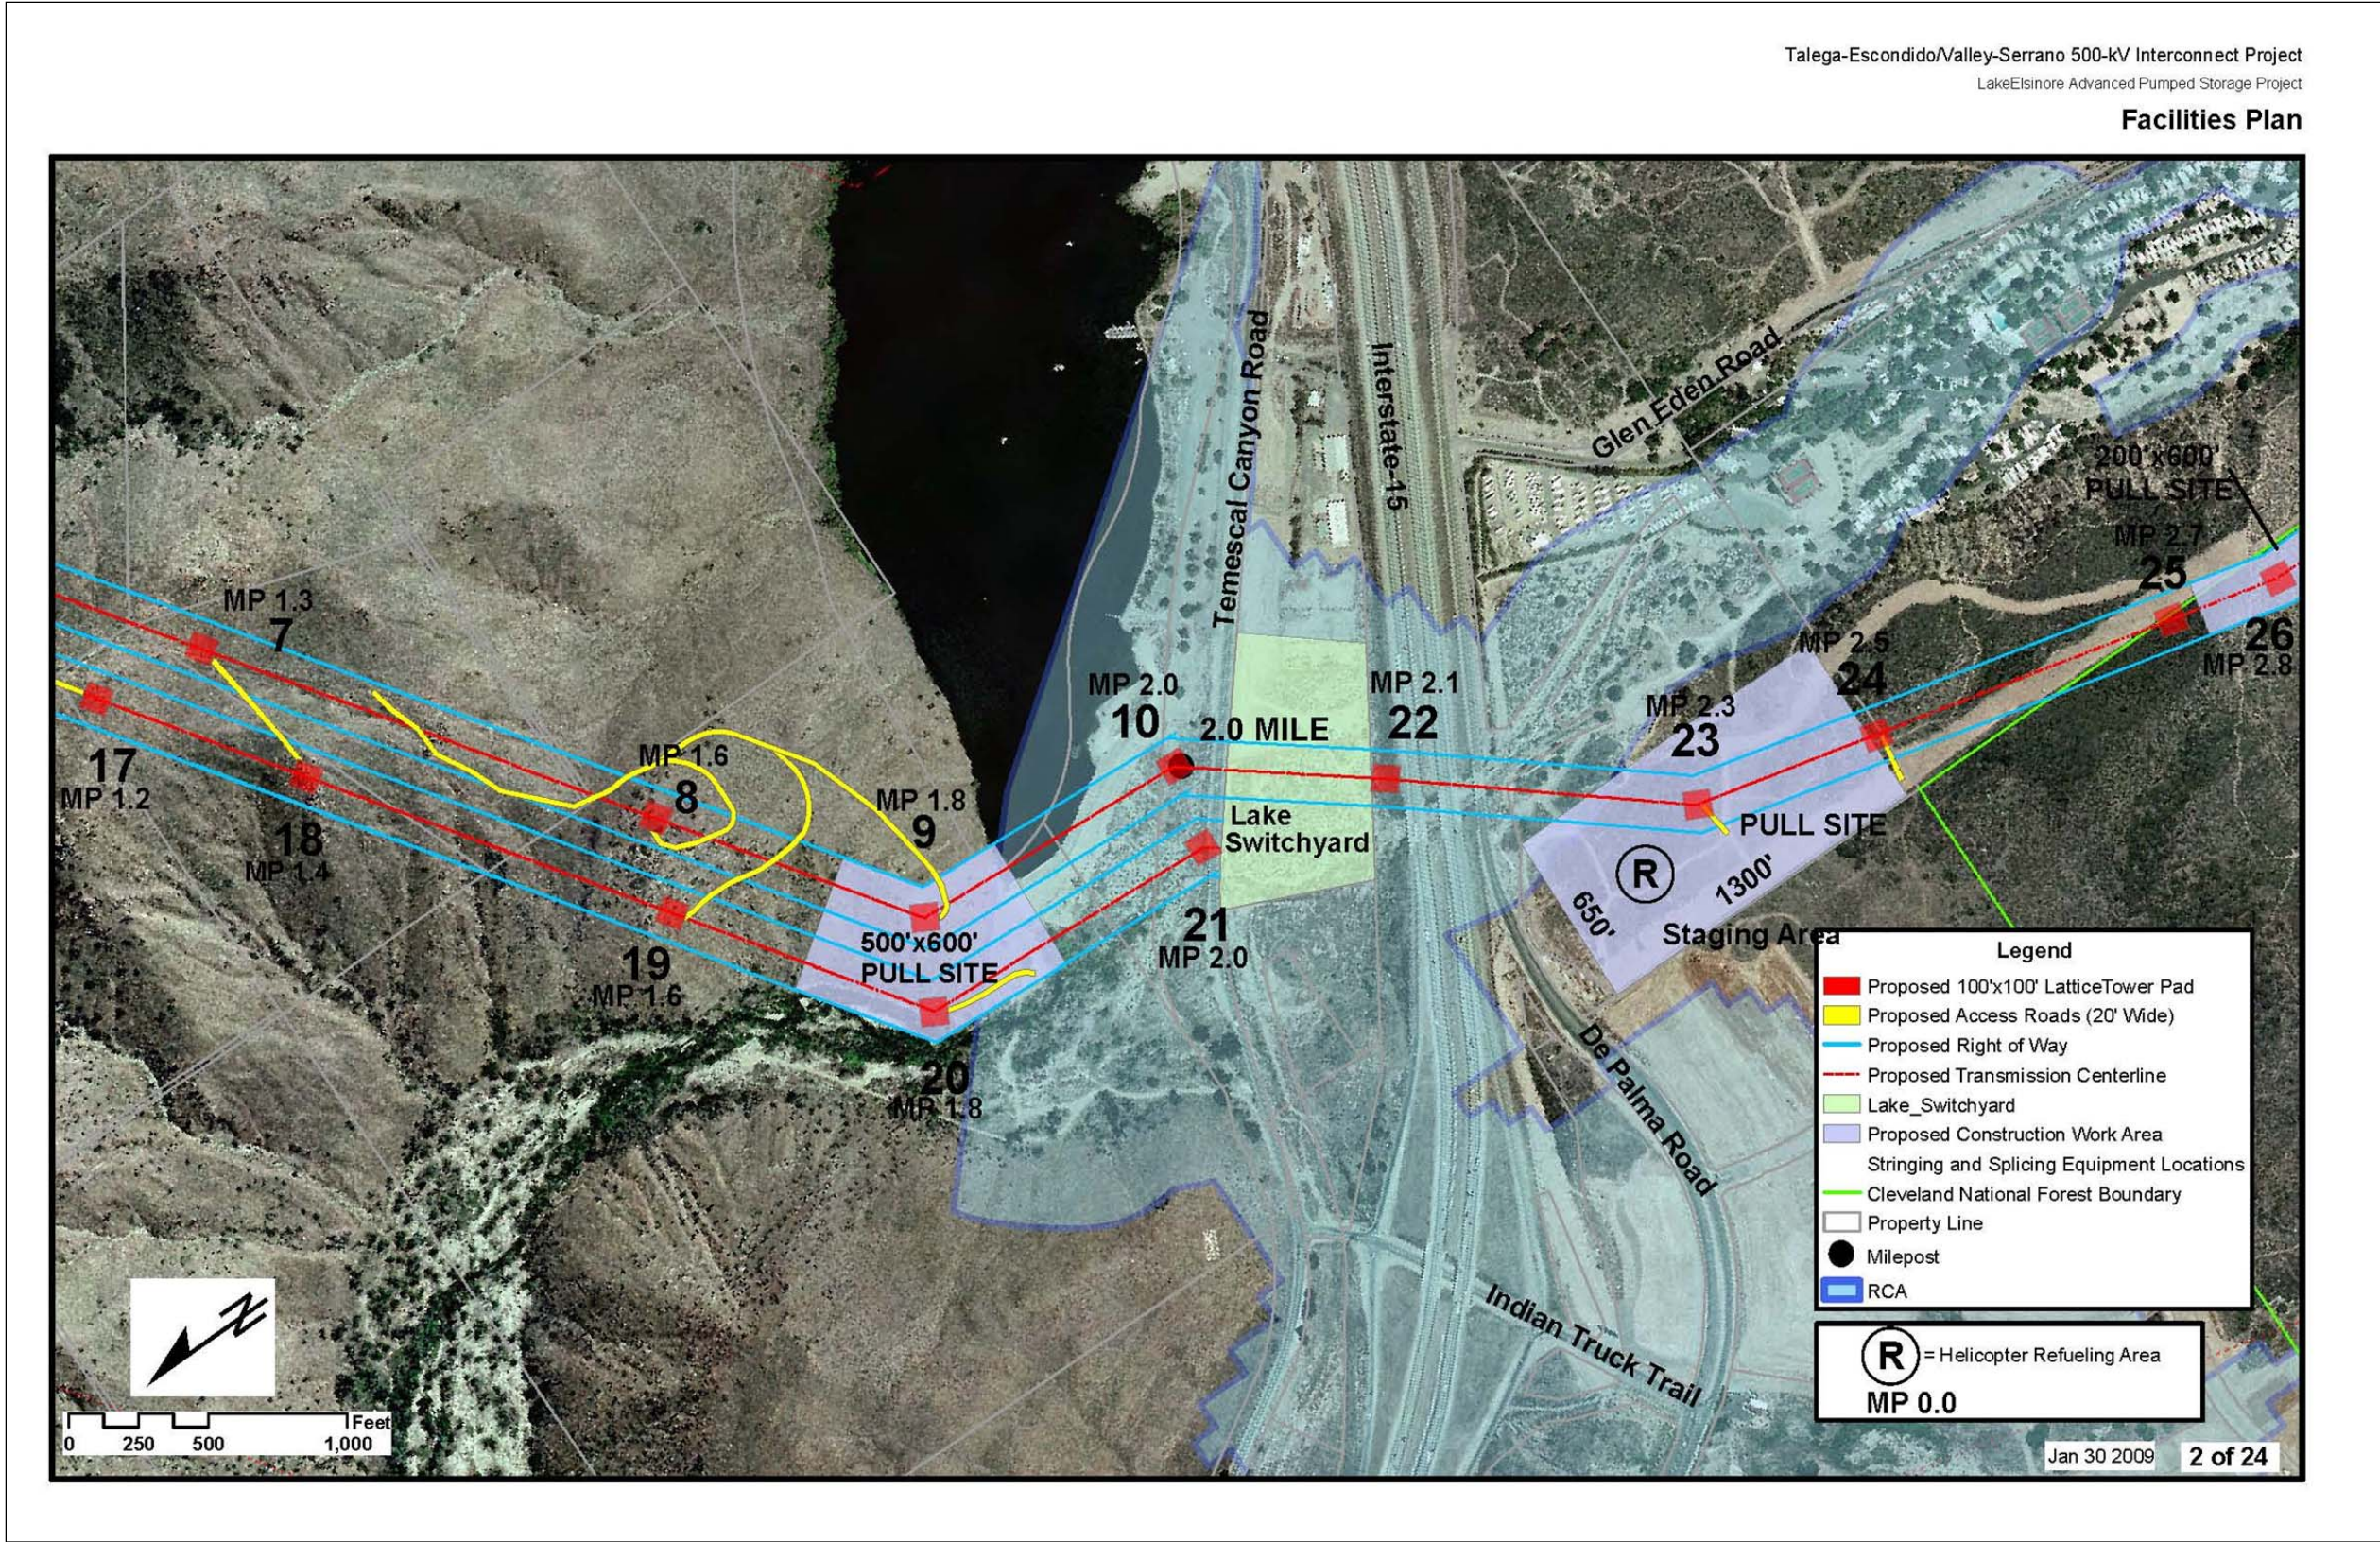


Figure 3.1.1-4: (2 of 24) Talega-Escondido/Valley-Serrano 500 kV Interconnect Project


Source: The Nevada Hydro Company



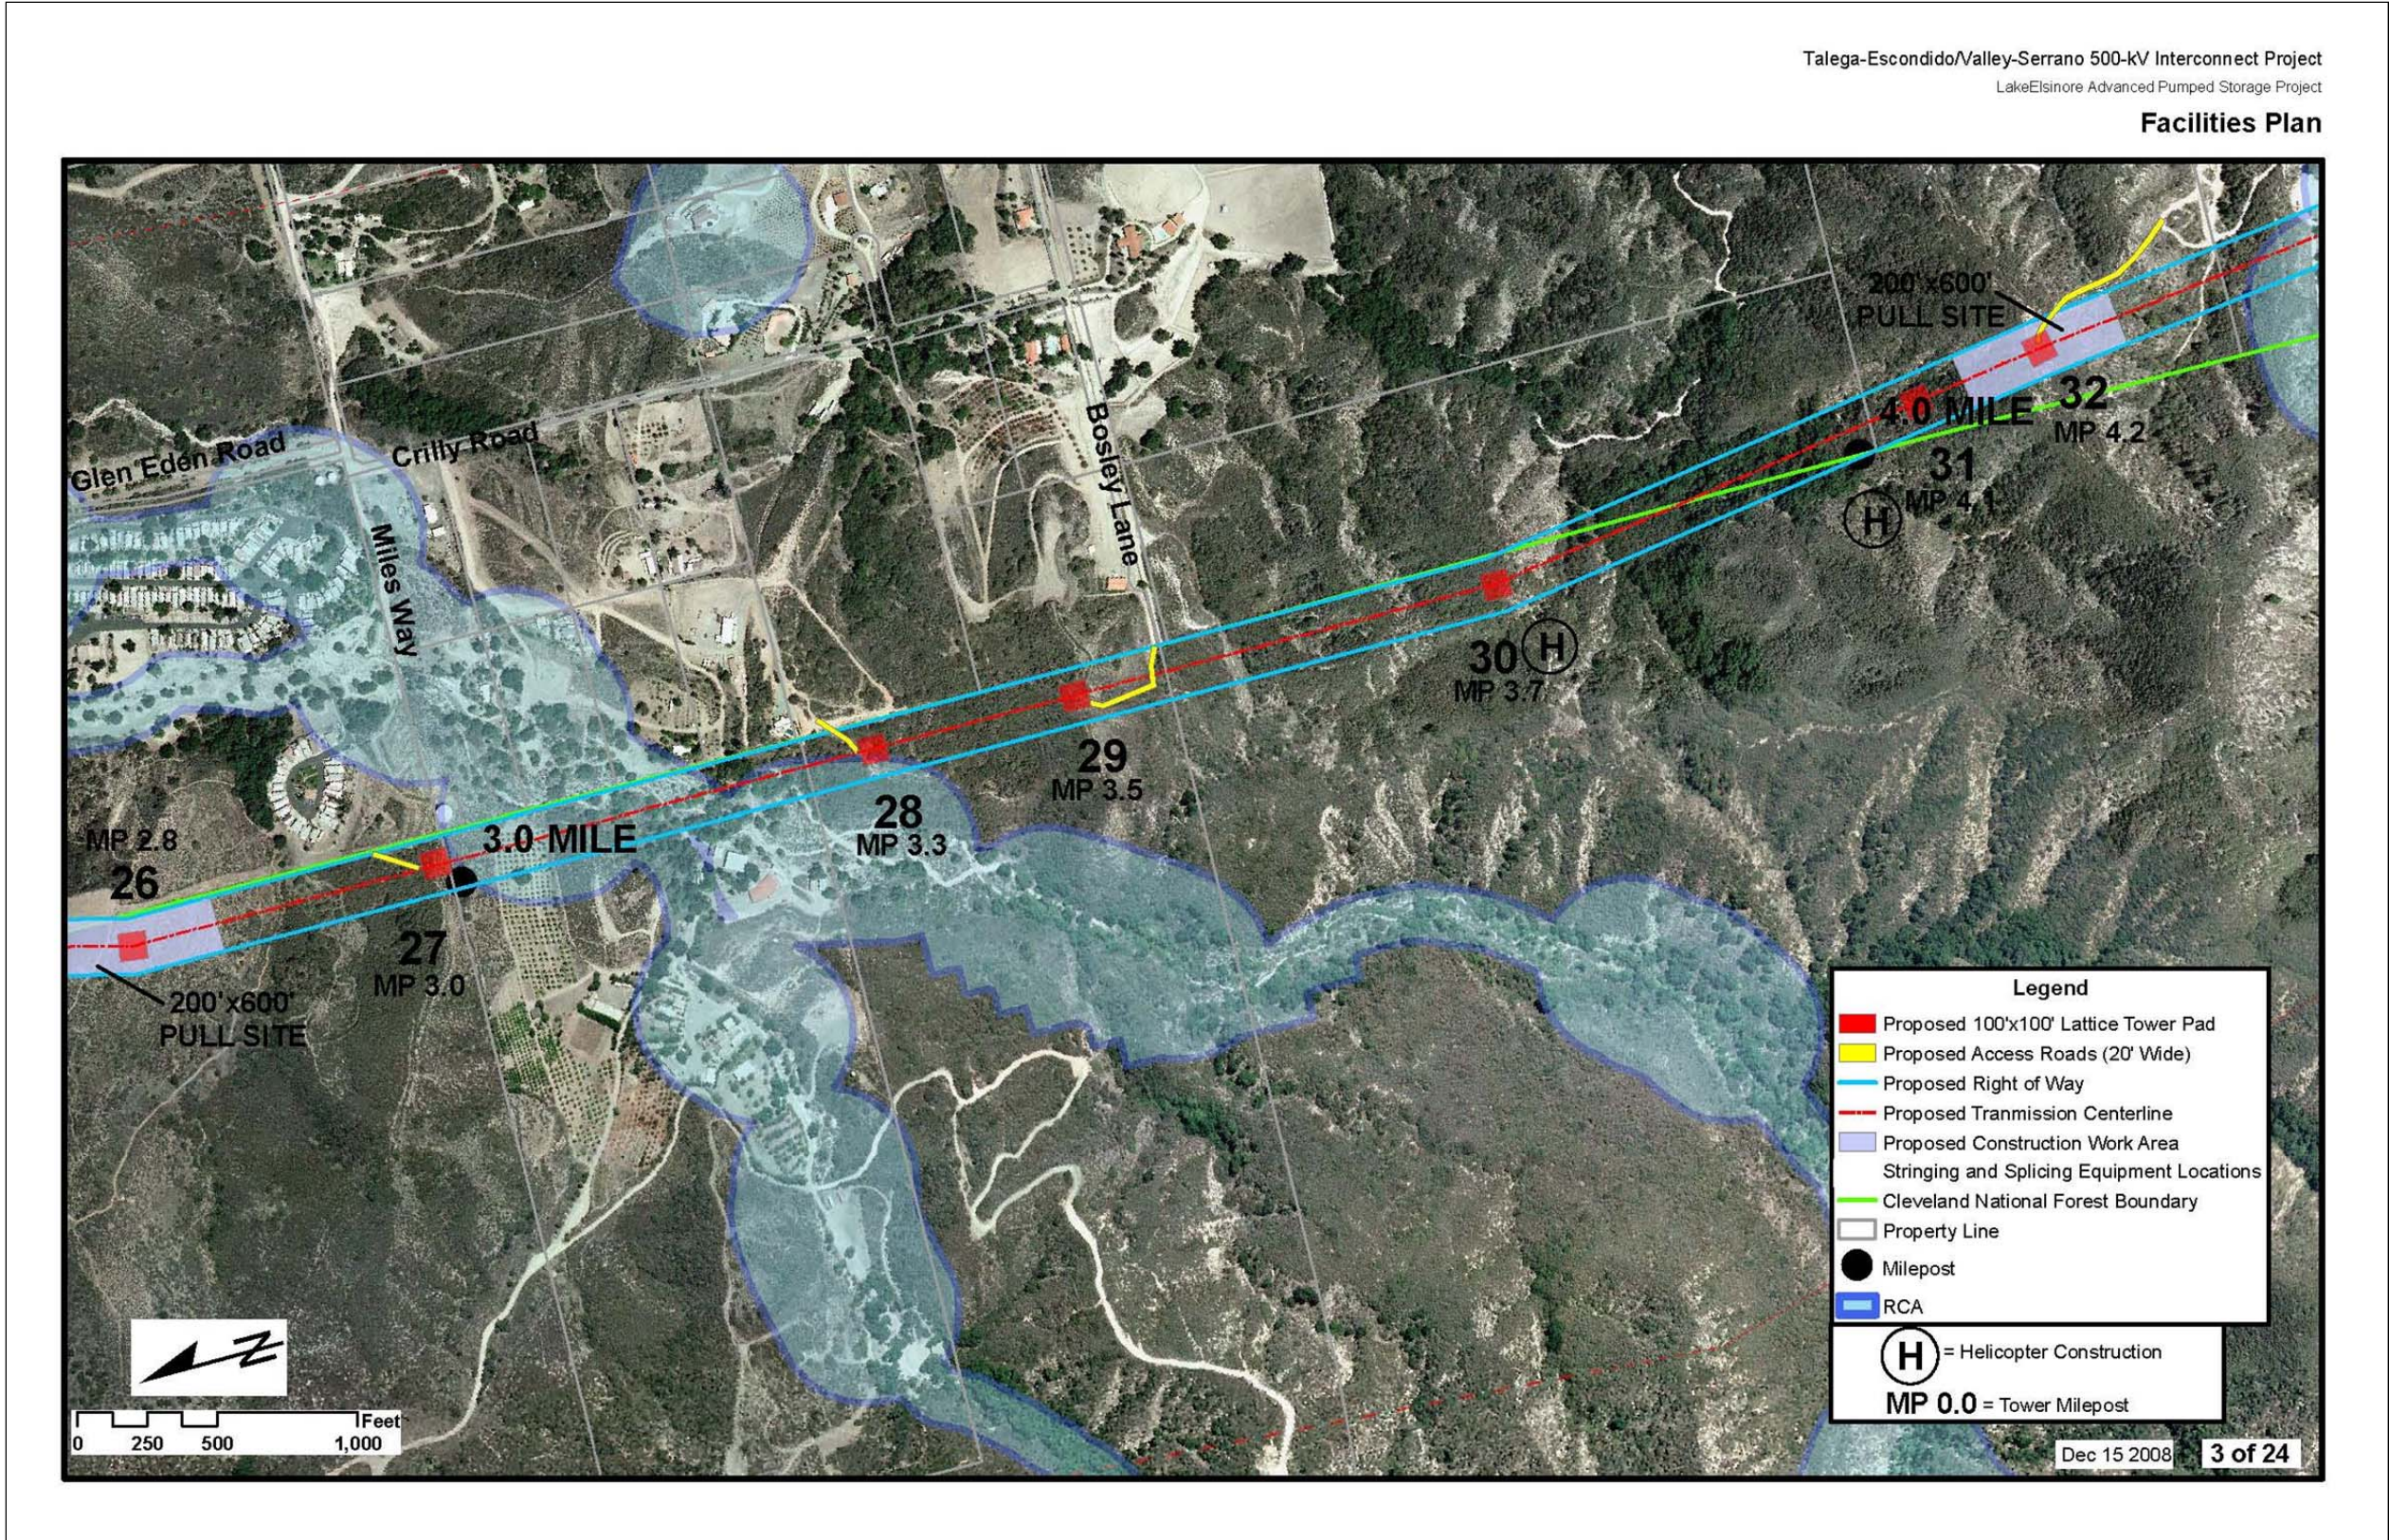

**Figure 3.1.1-4: (3 of 24) Talega-Escondido/Valley-Serrano 500 kV Interconnect Project**  
Source: The Nevada Hydro Company



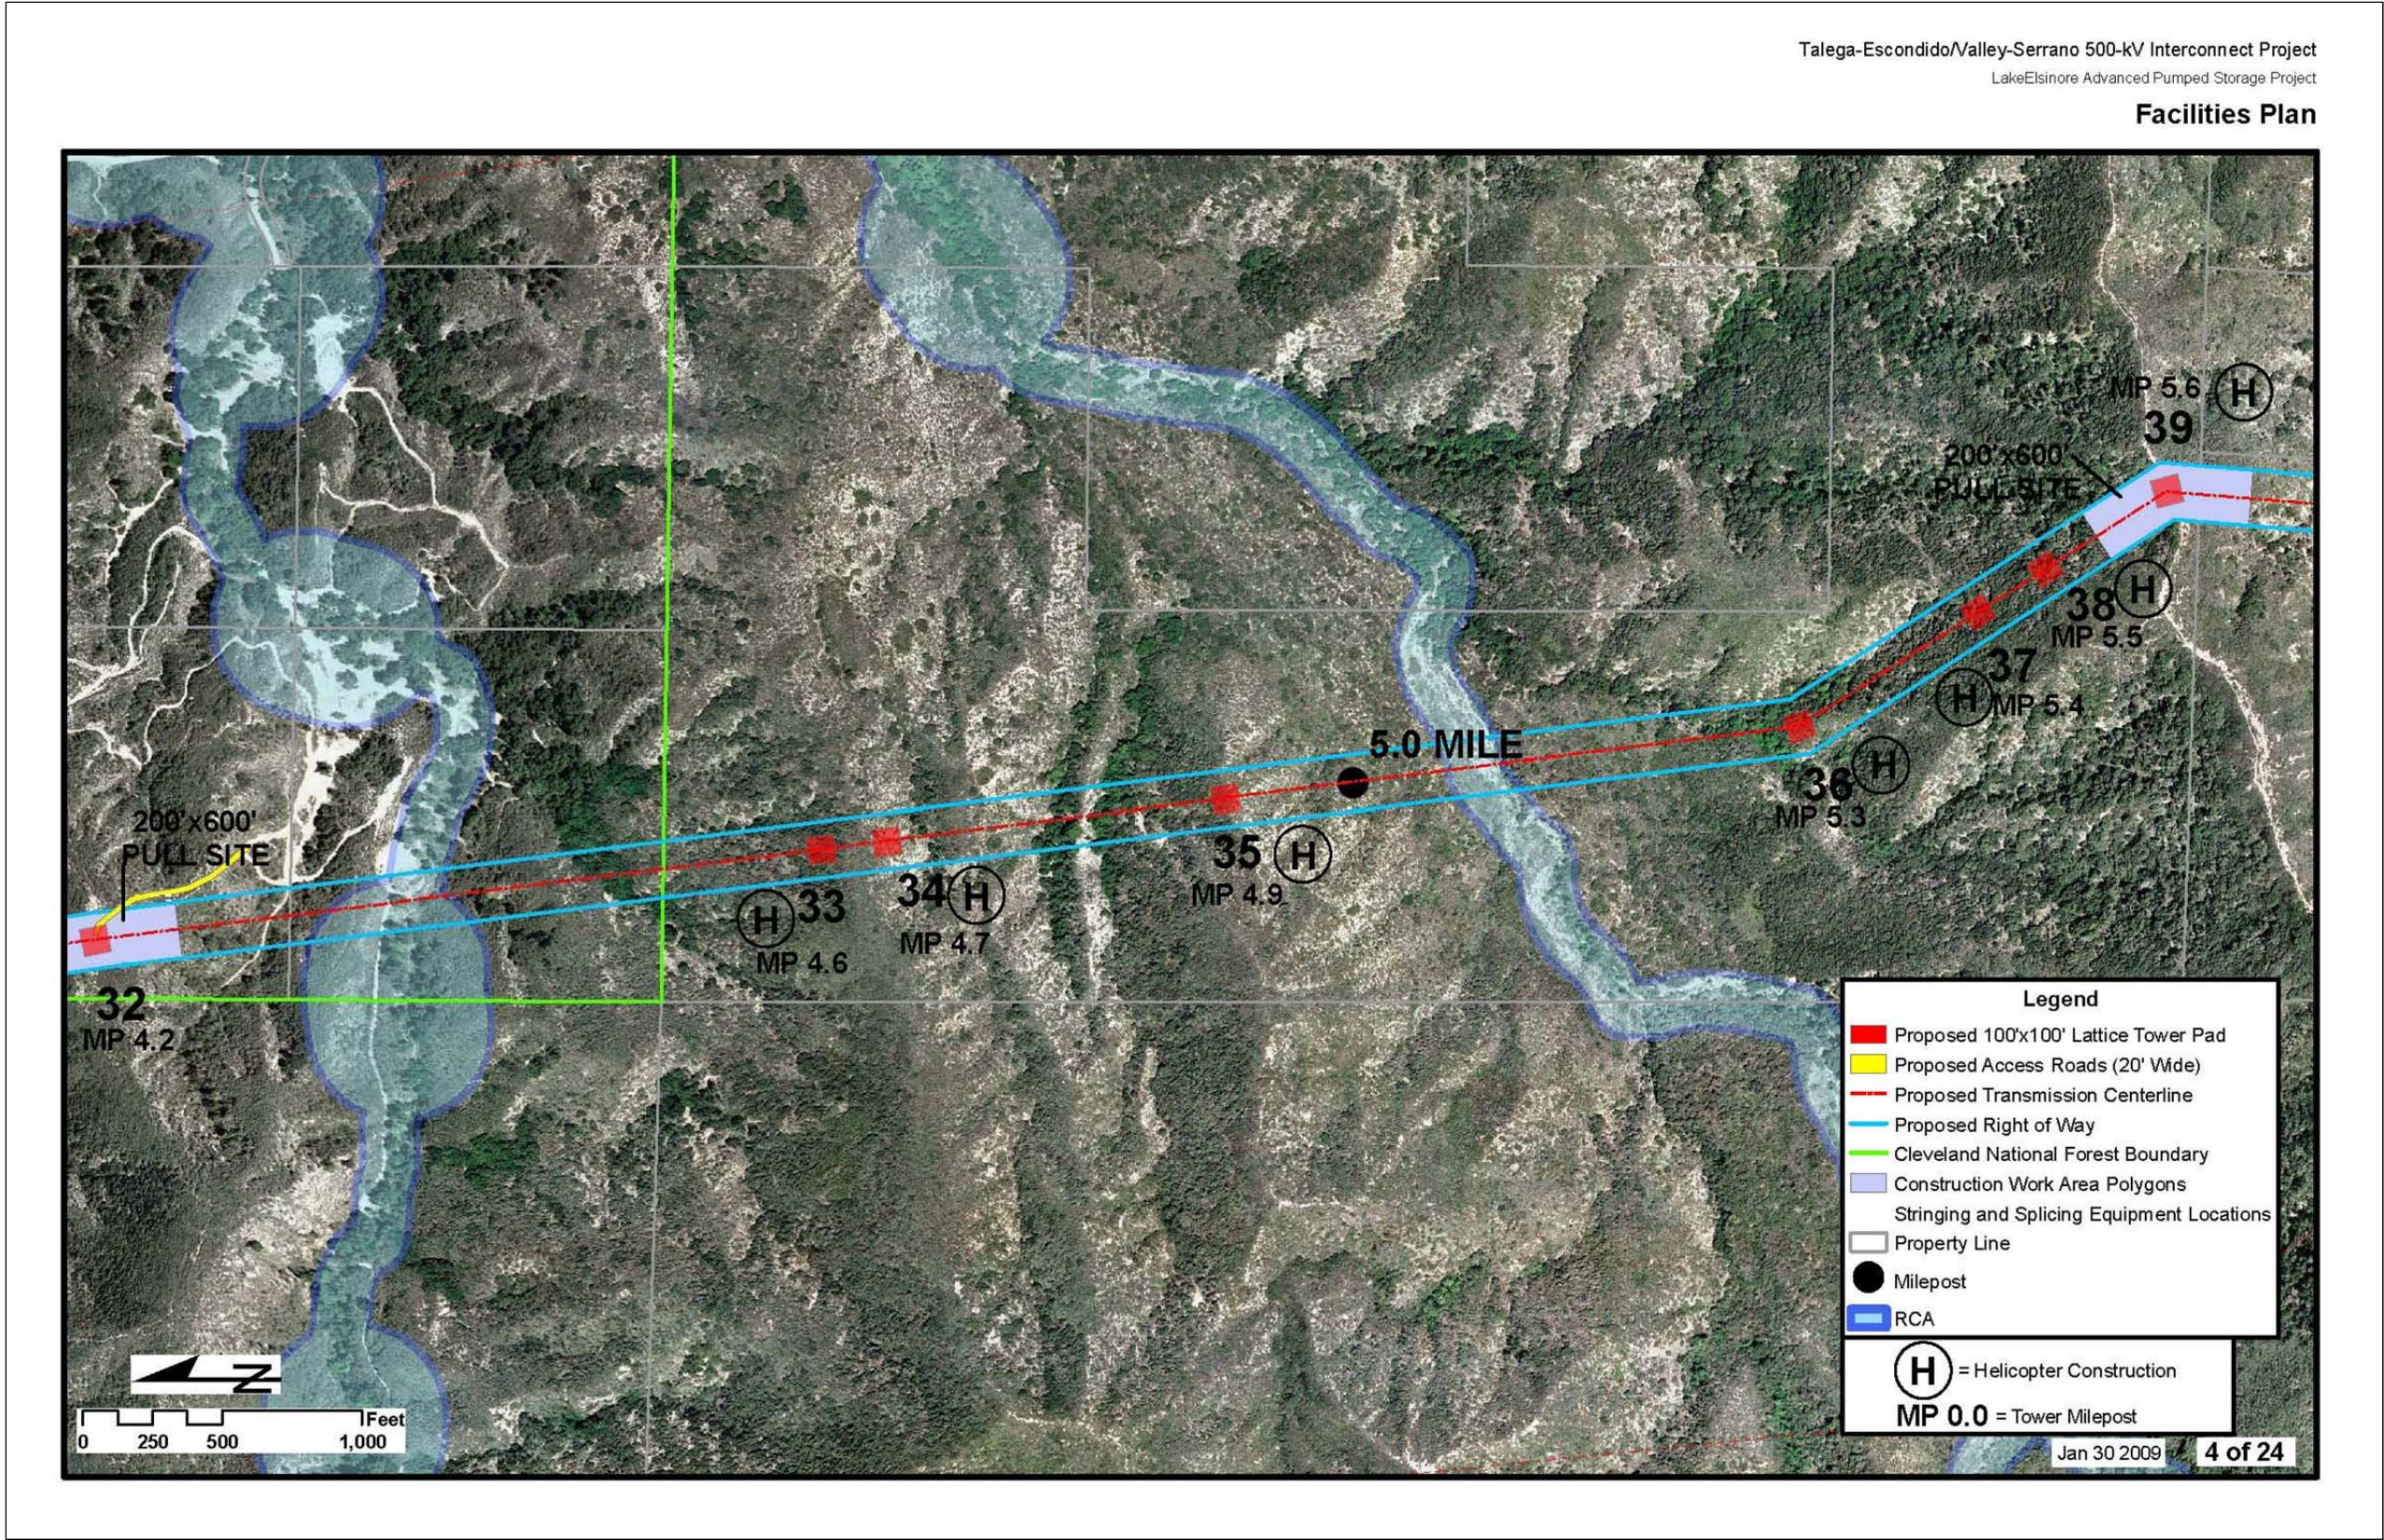

**Figure 3.1.1-4: (4 of 24) Talega-Escondido/Valley-Serrano 500 kV Interconnect Project**  
Source: The Nevada Hydro Company




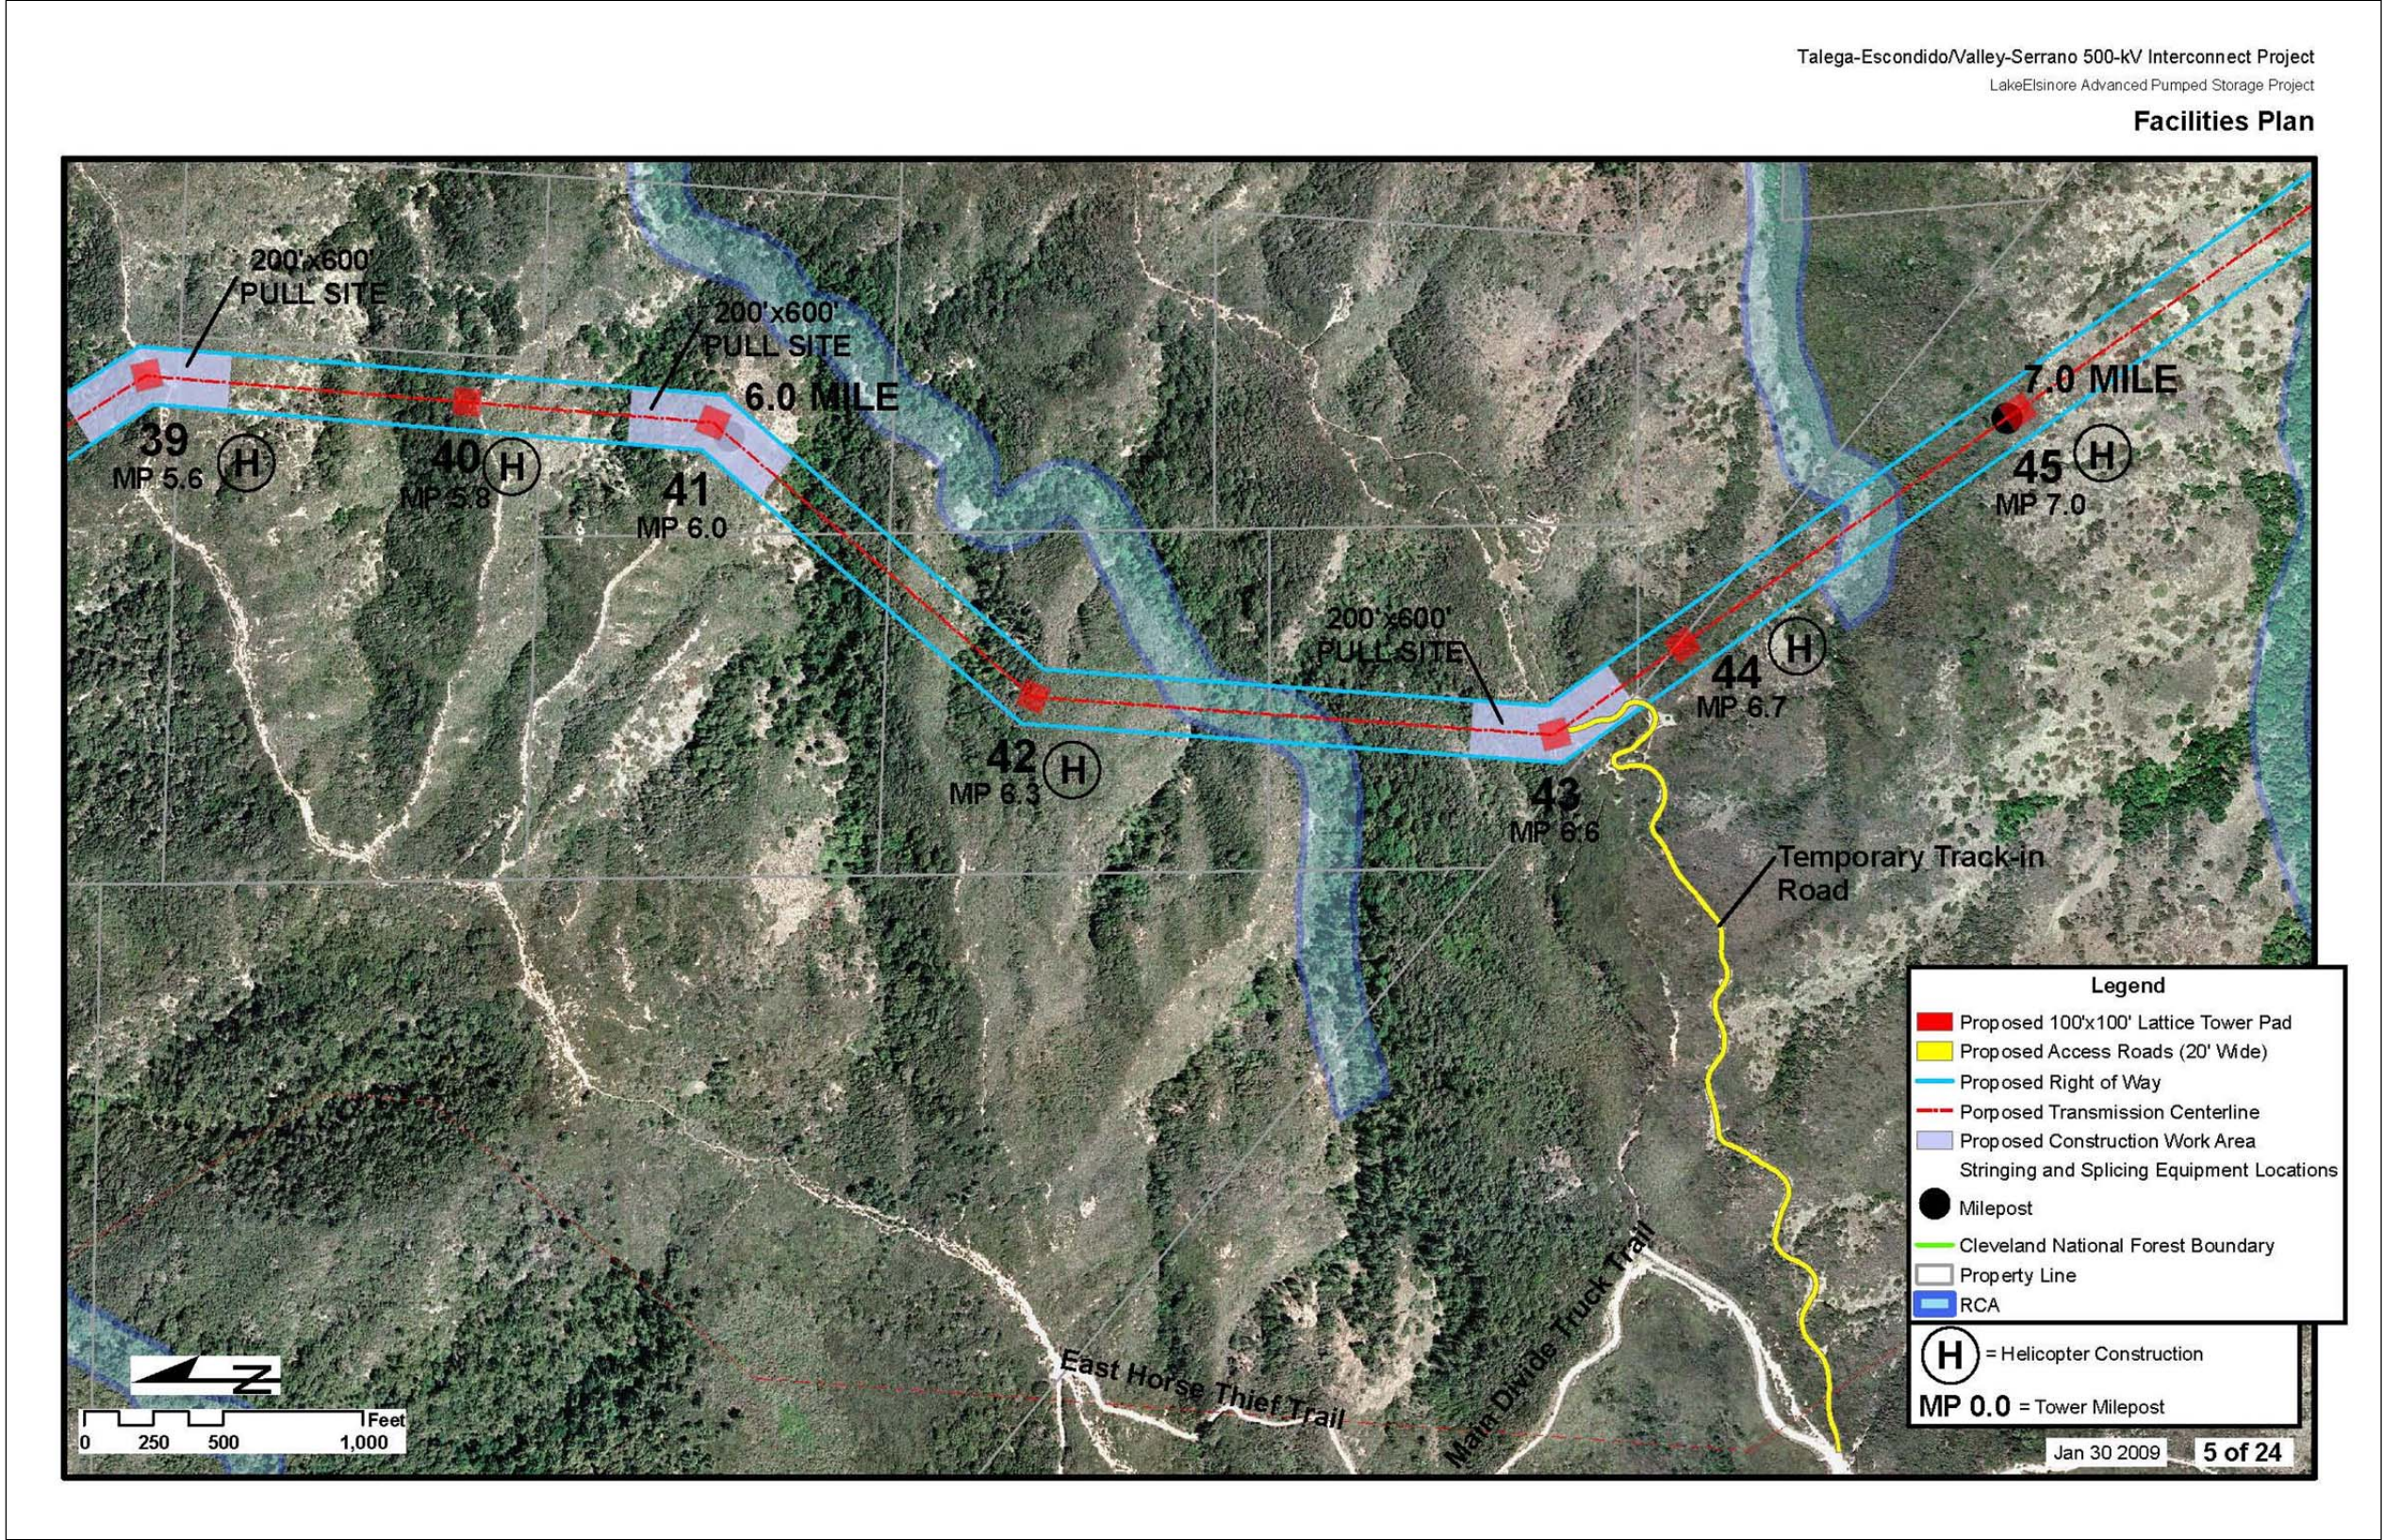


Figure 3.1.1-4: (5 of 24) Talega-Escondido/Valley-Serrano 500 kV Interconnect Project


Source: The Nevada Hydro Company



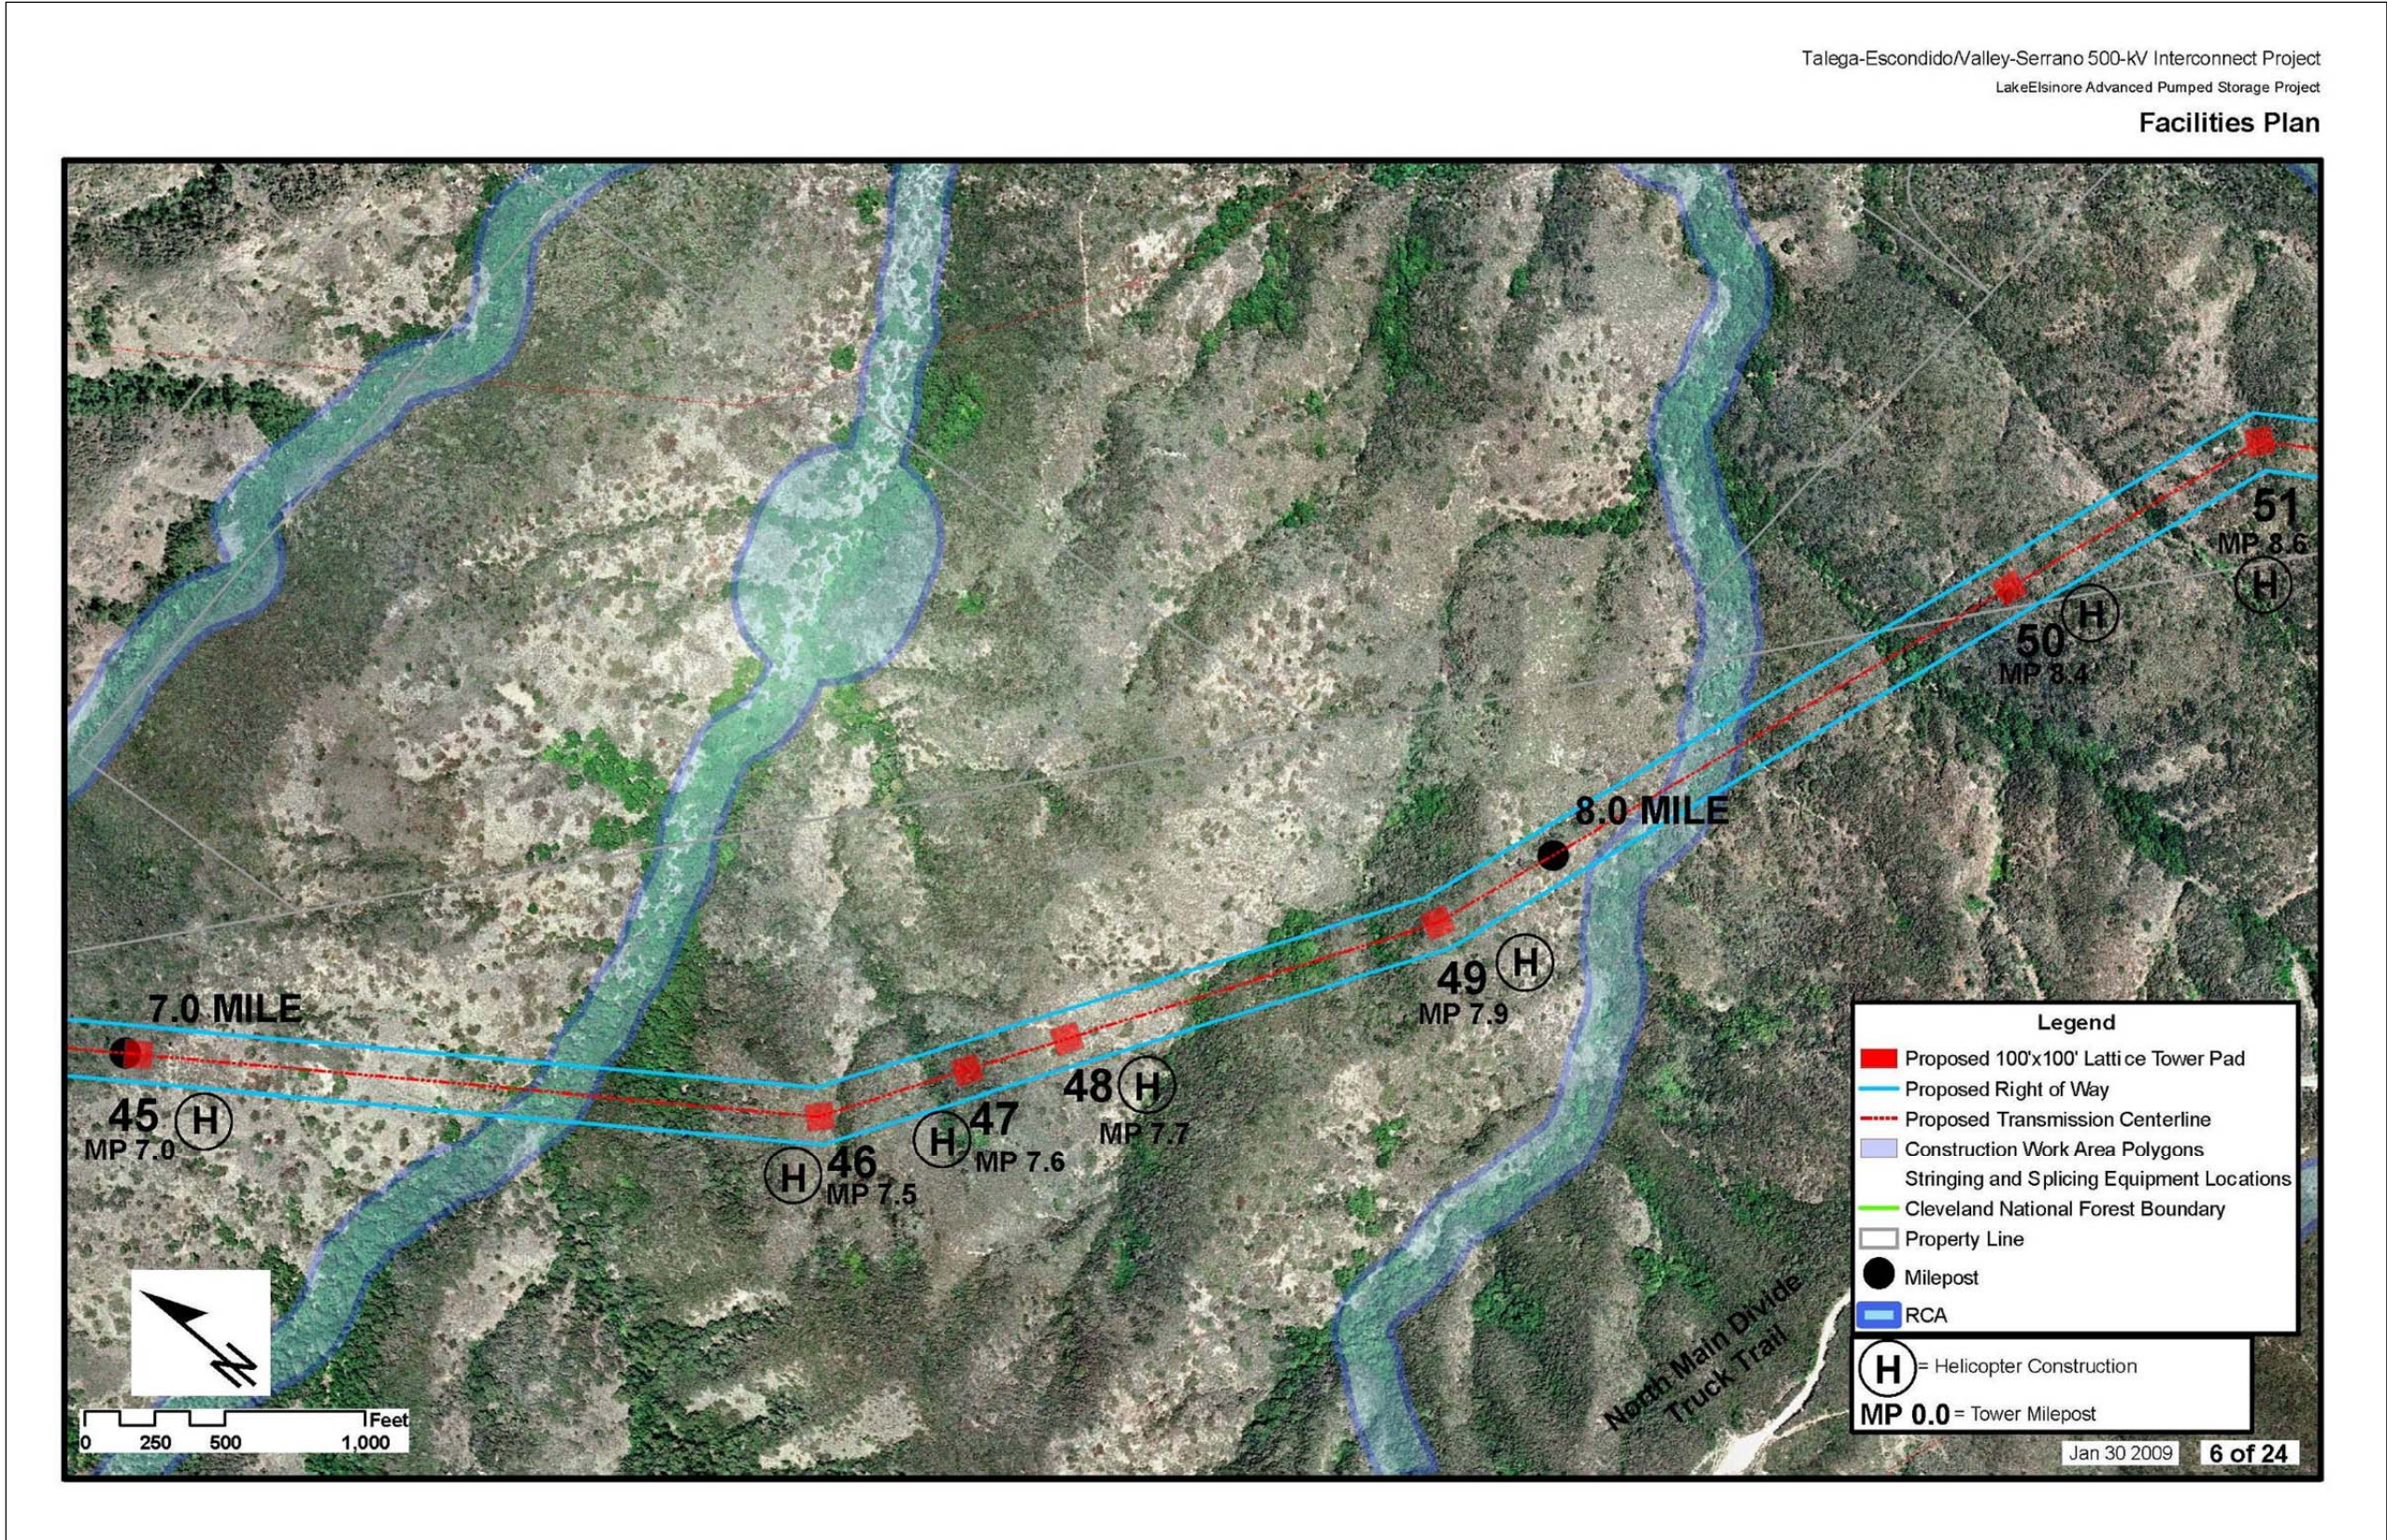

**Figure 3.1.1-4: (6 of 24) Talega-Escondido/Valley-Serrano 500 kV Interconnect Project**  
Source: The Nevada Hydro Company



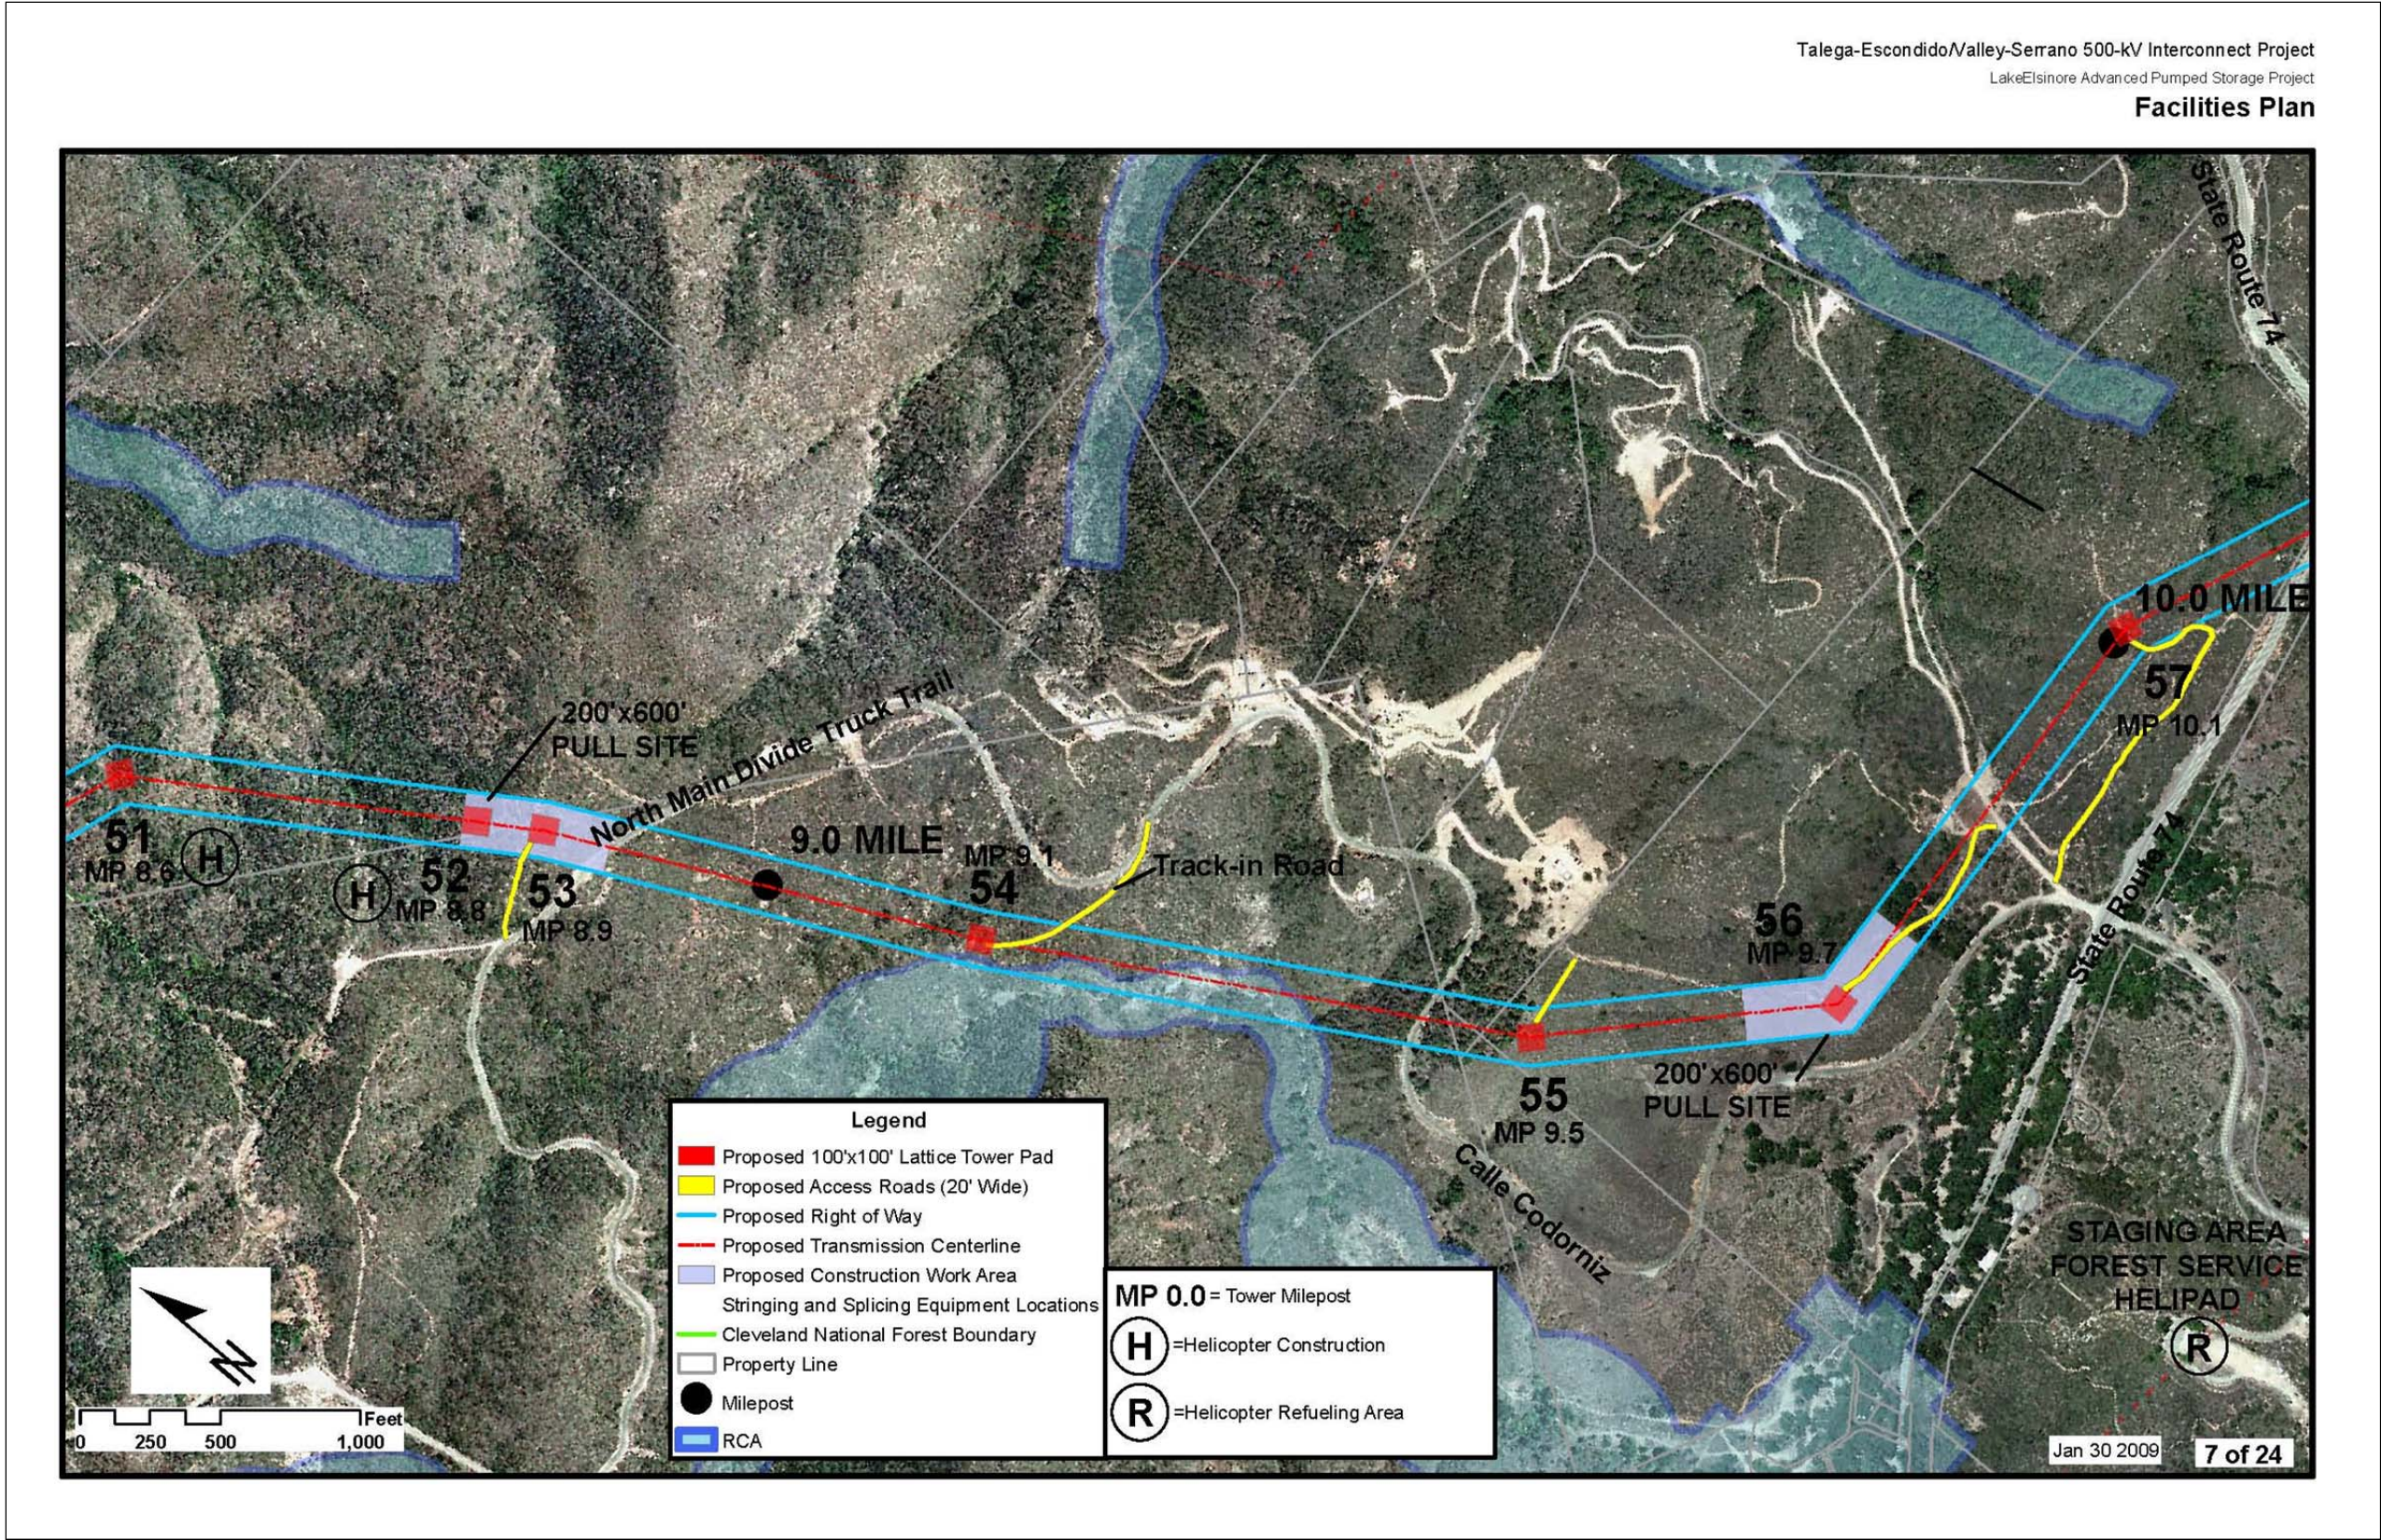

**Figure 3.1.1-4: (7 of 24) Talega-Escondido/Valley-Serrano 500 kV Interconnect Project**  
Source: The Nevada Hydro Company




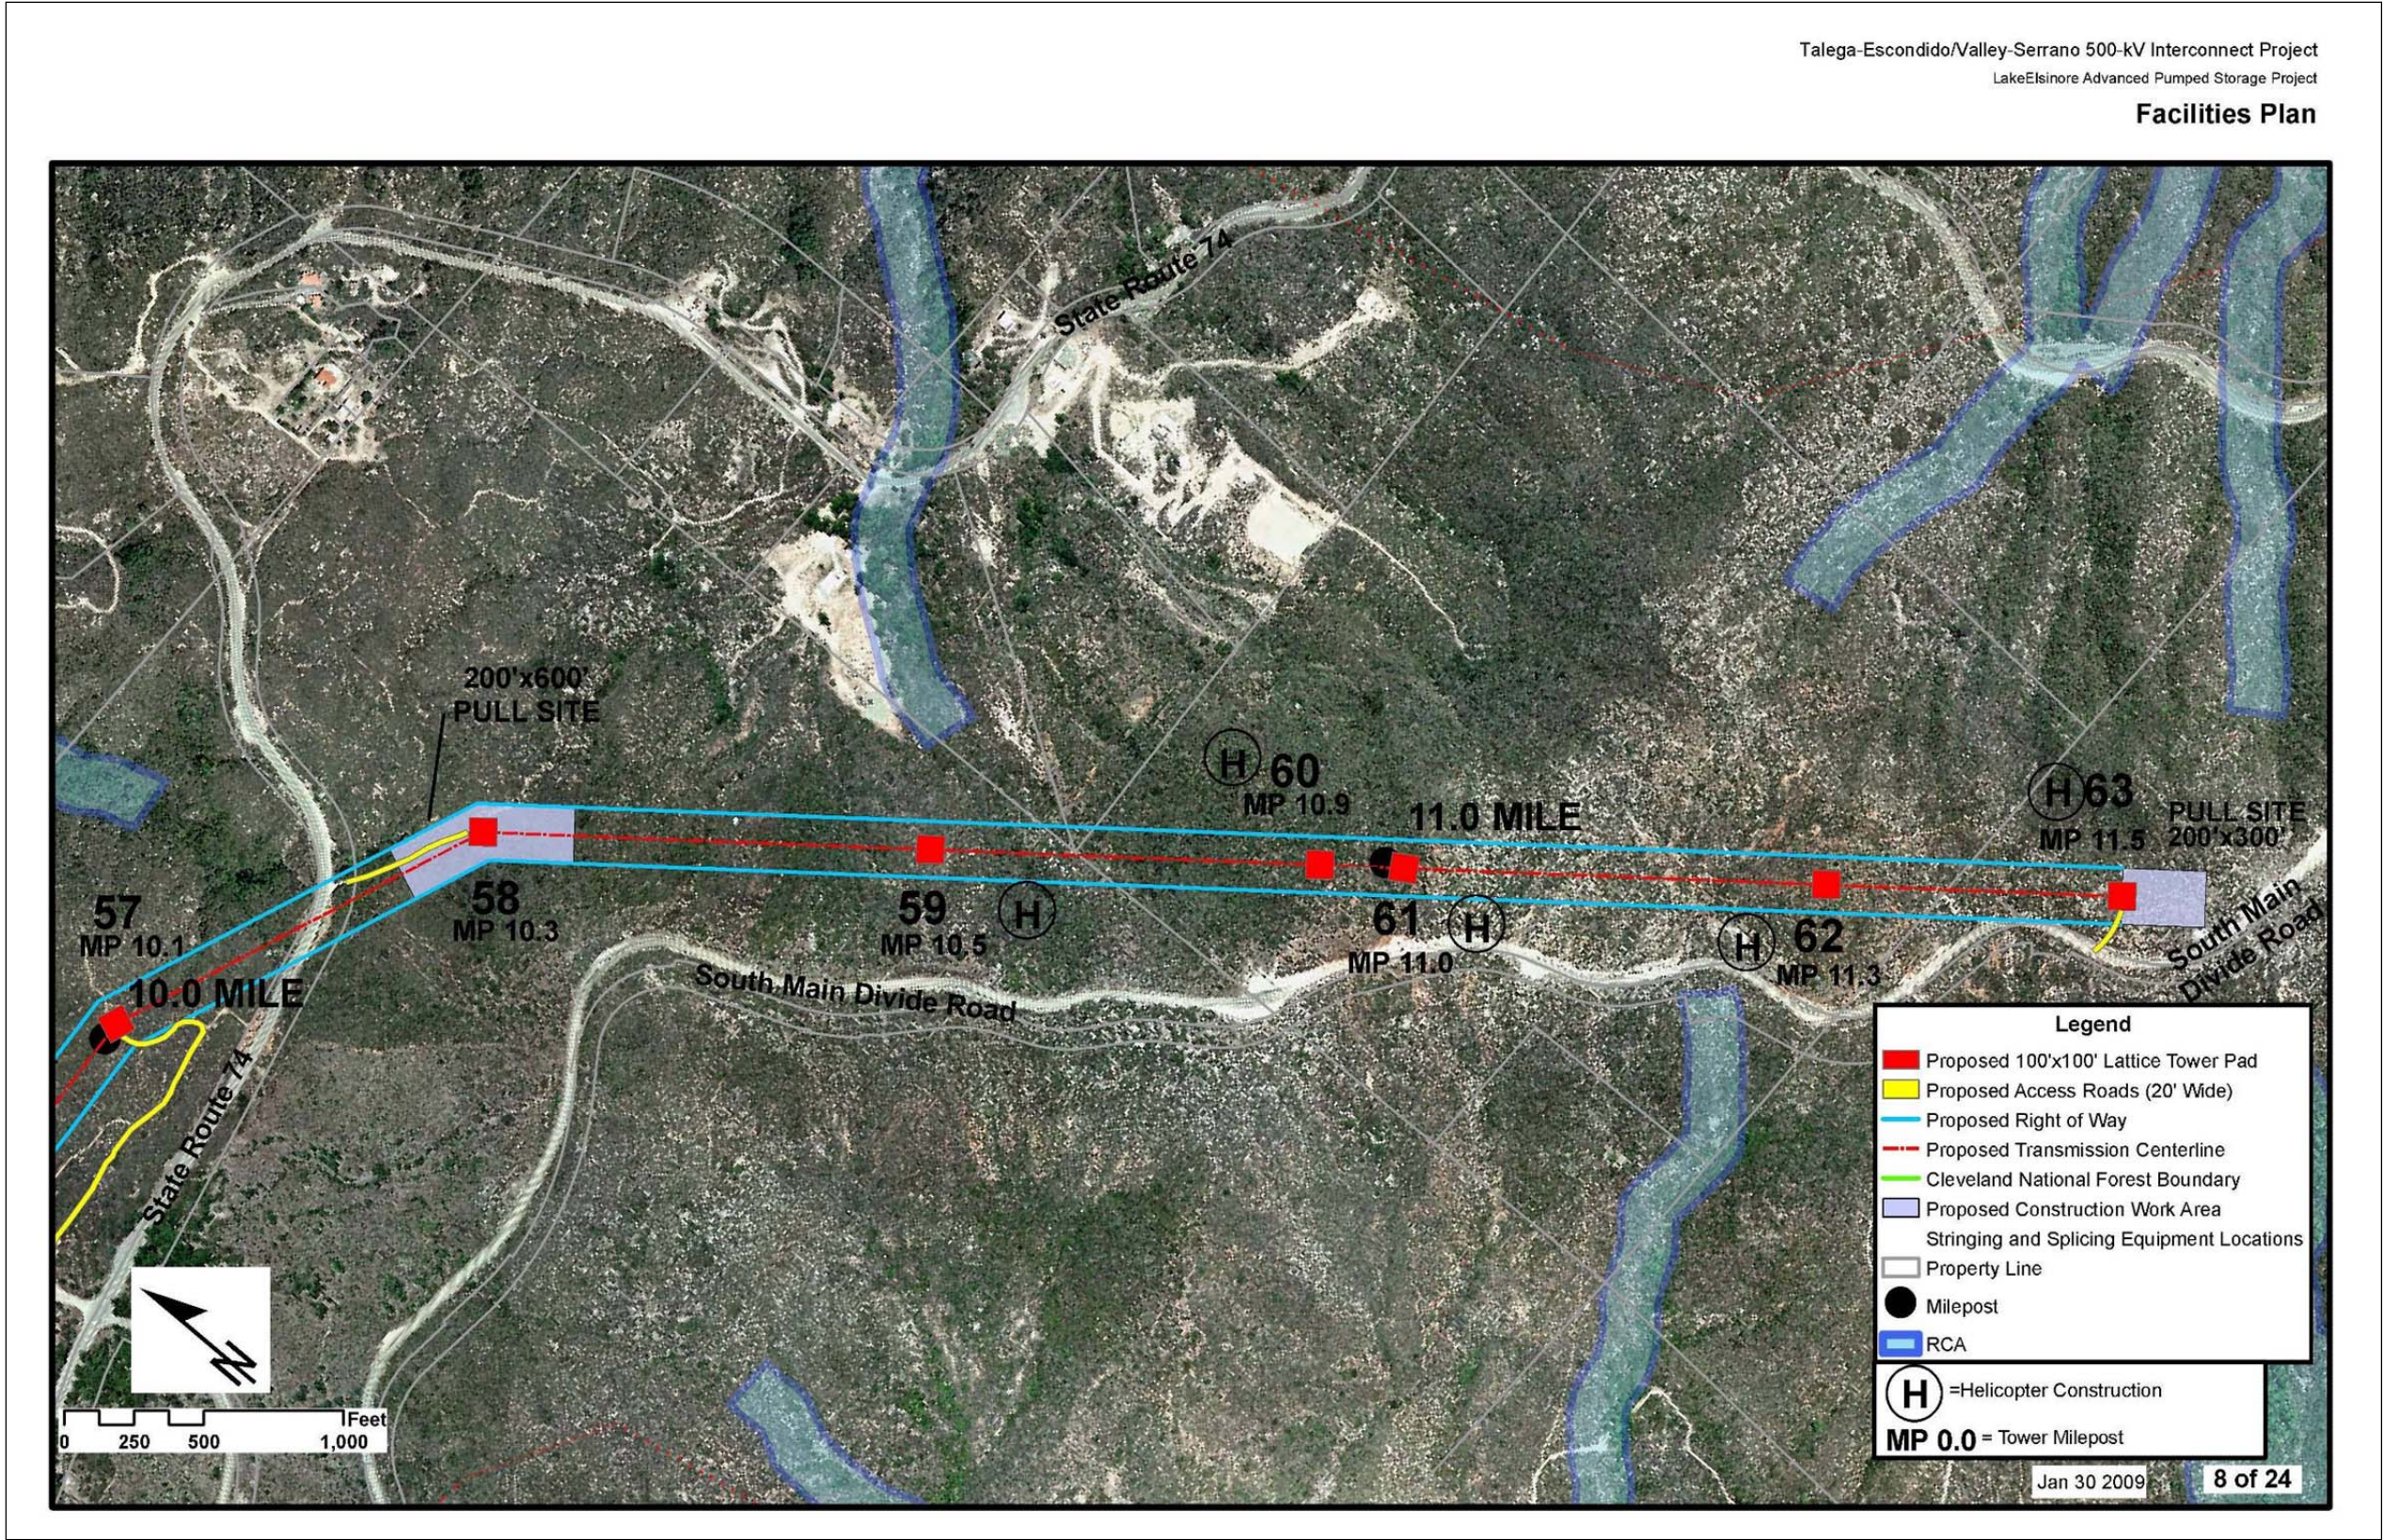


Figure 3.1.1-4: (8 of 24) Talega-Escondido/Valley-Serrano 500 kV Interconnect Project  
Source: The Nevada Hydro Company



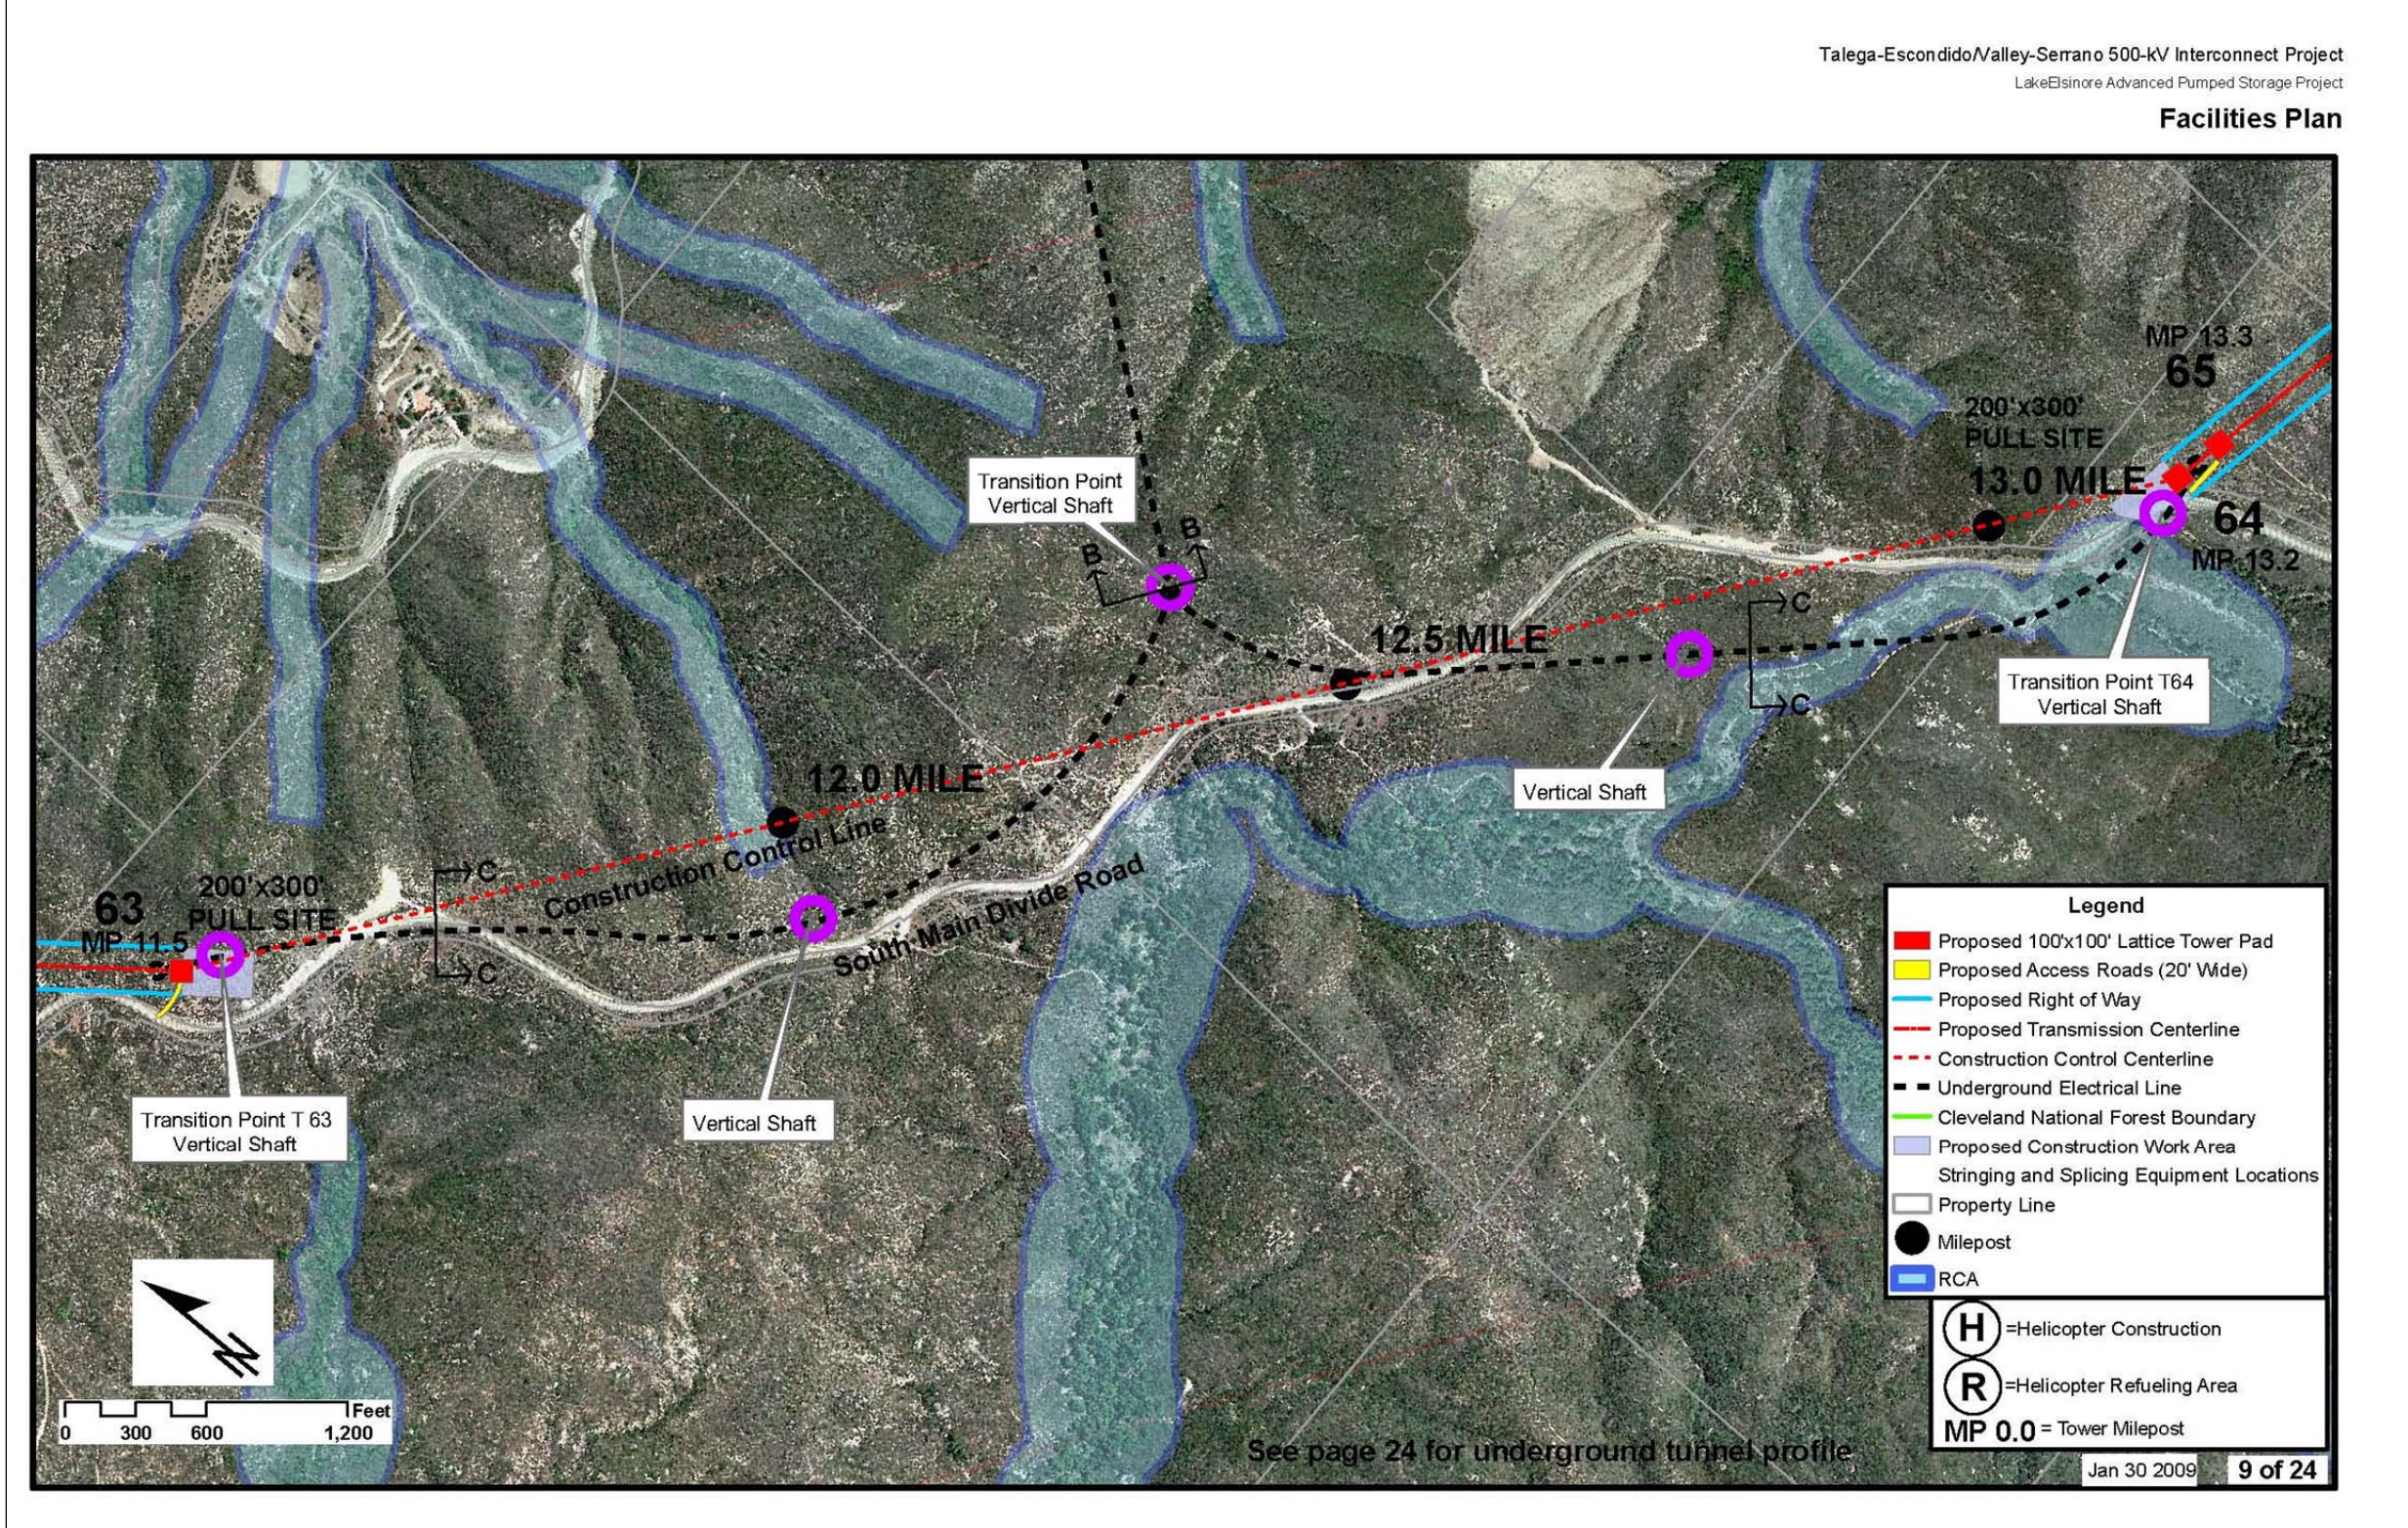

**Figure 3.1.1-4: (9 of 24) Talega-Escondido/Valley-Serrano 500 kV Interconnect Project**  
Source: The Nevada Hydro Company




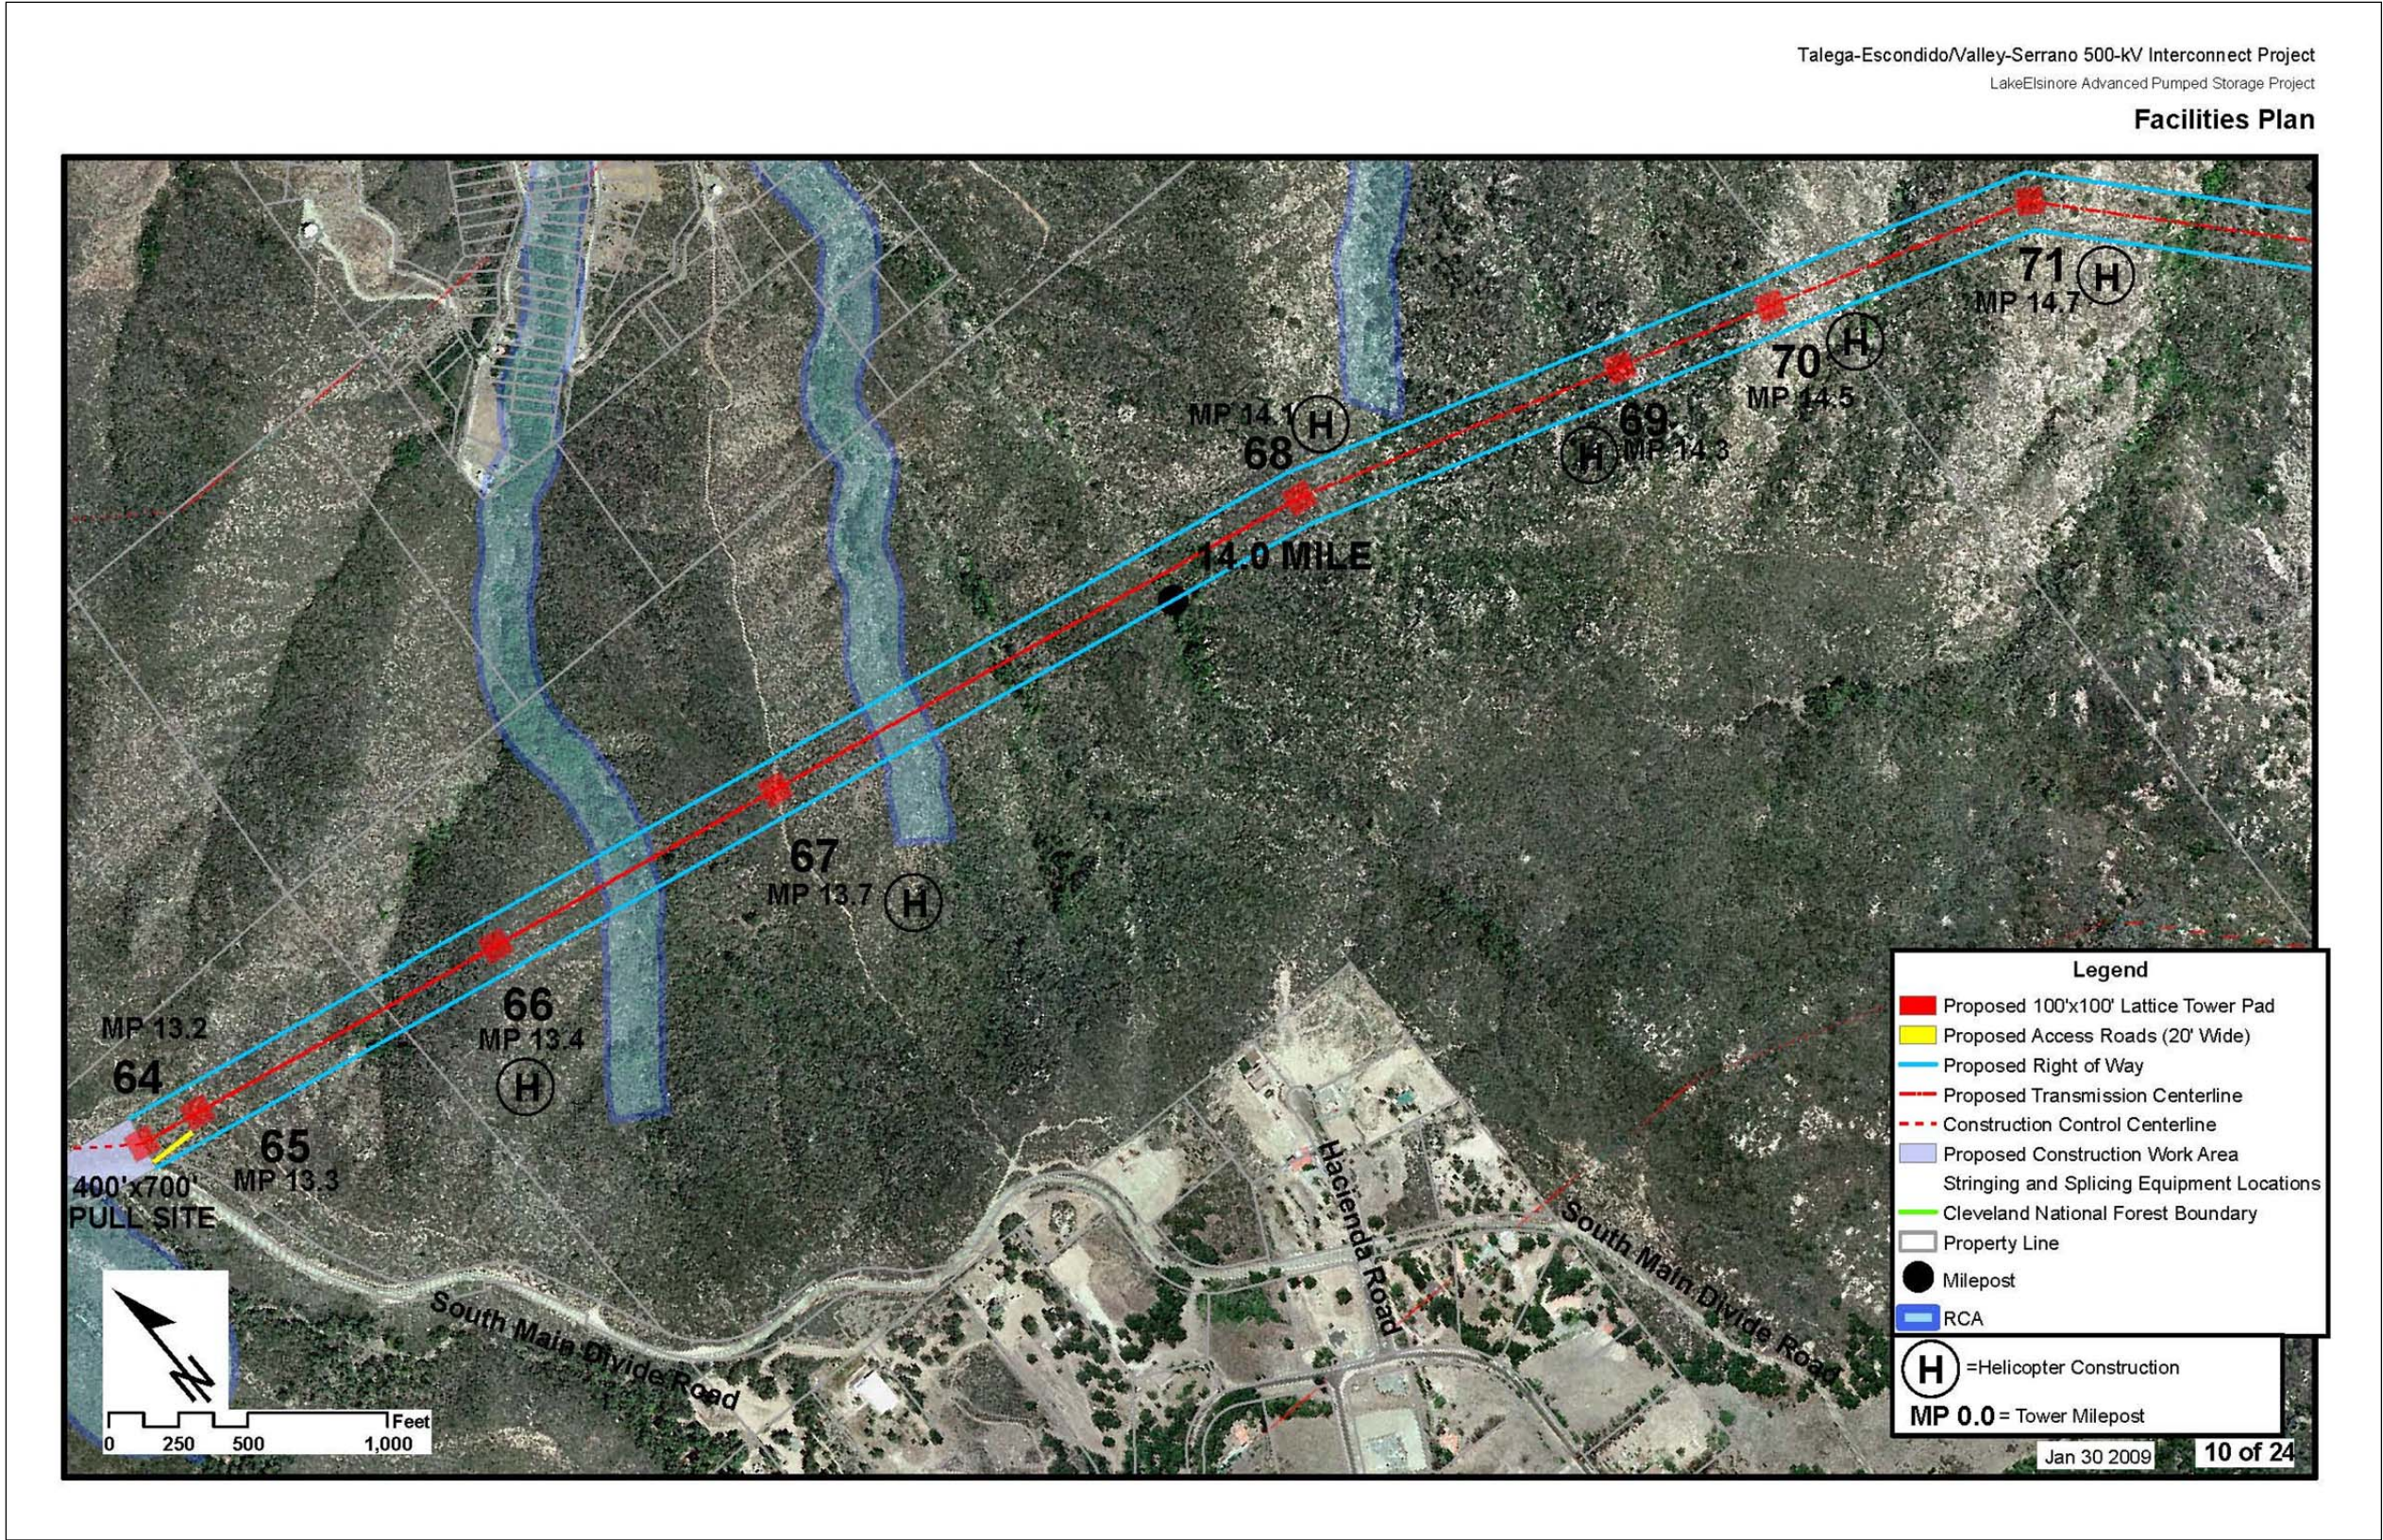


Figure 3.1.1-4: (10 of 24) Talega-Escondido/Valley-Serrano 500 kV Interconnect Project


Source: The Nevada Hydro Company



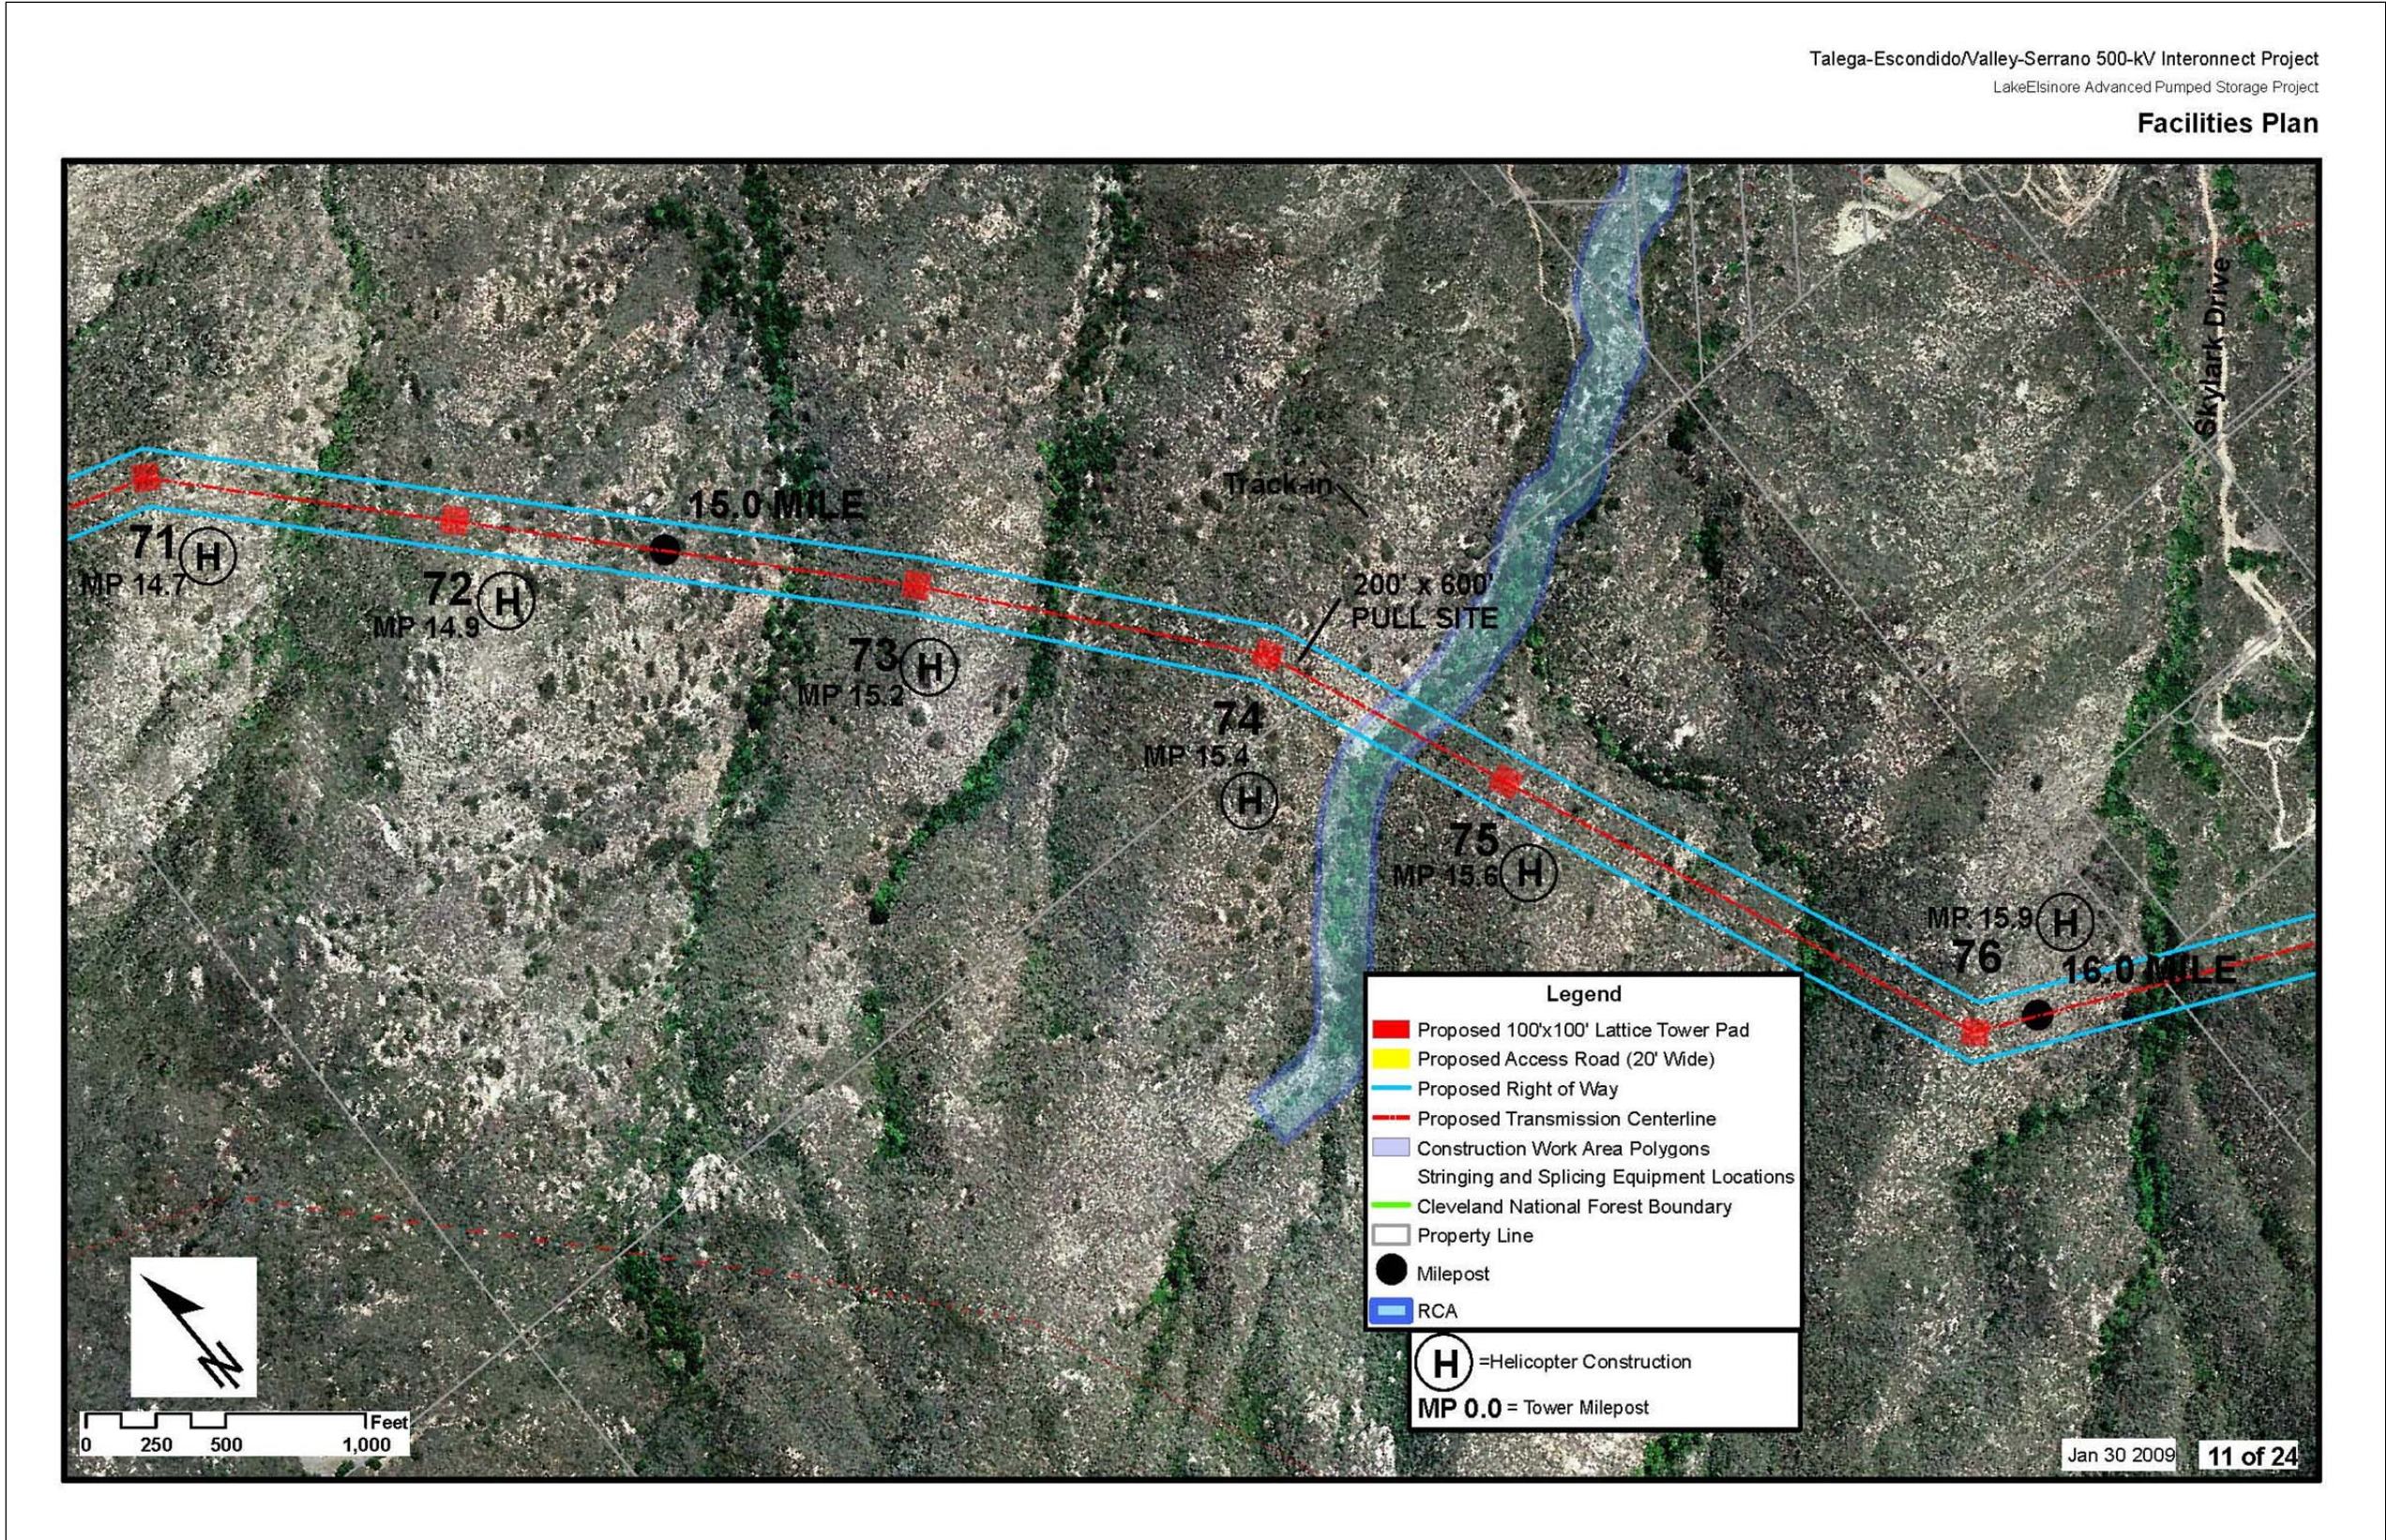


**Figure 3.1.1-4: (11 of 24) Talega-Escondido/Valley-Serrano 500 kV Interconnect Project**  
Source: The Nevada Hydro Company



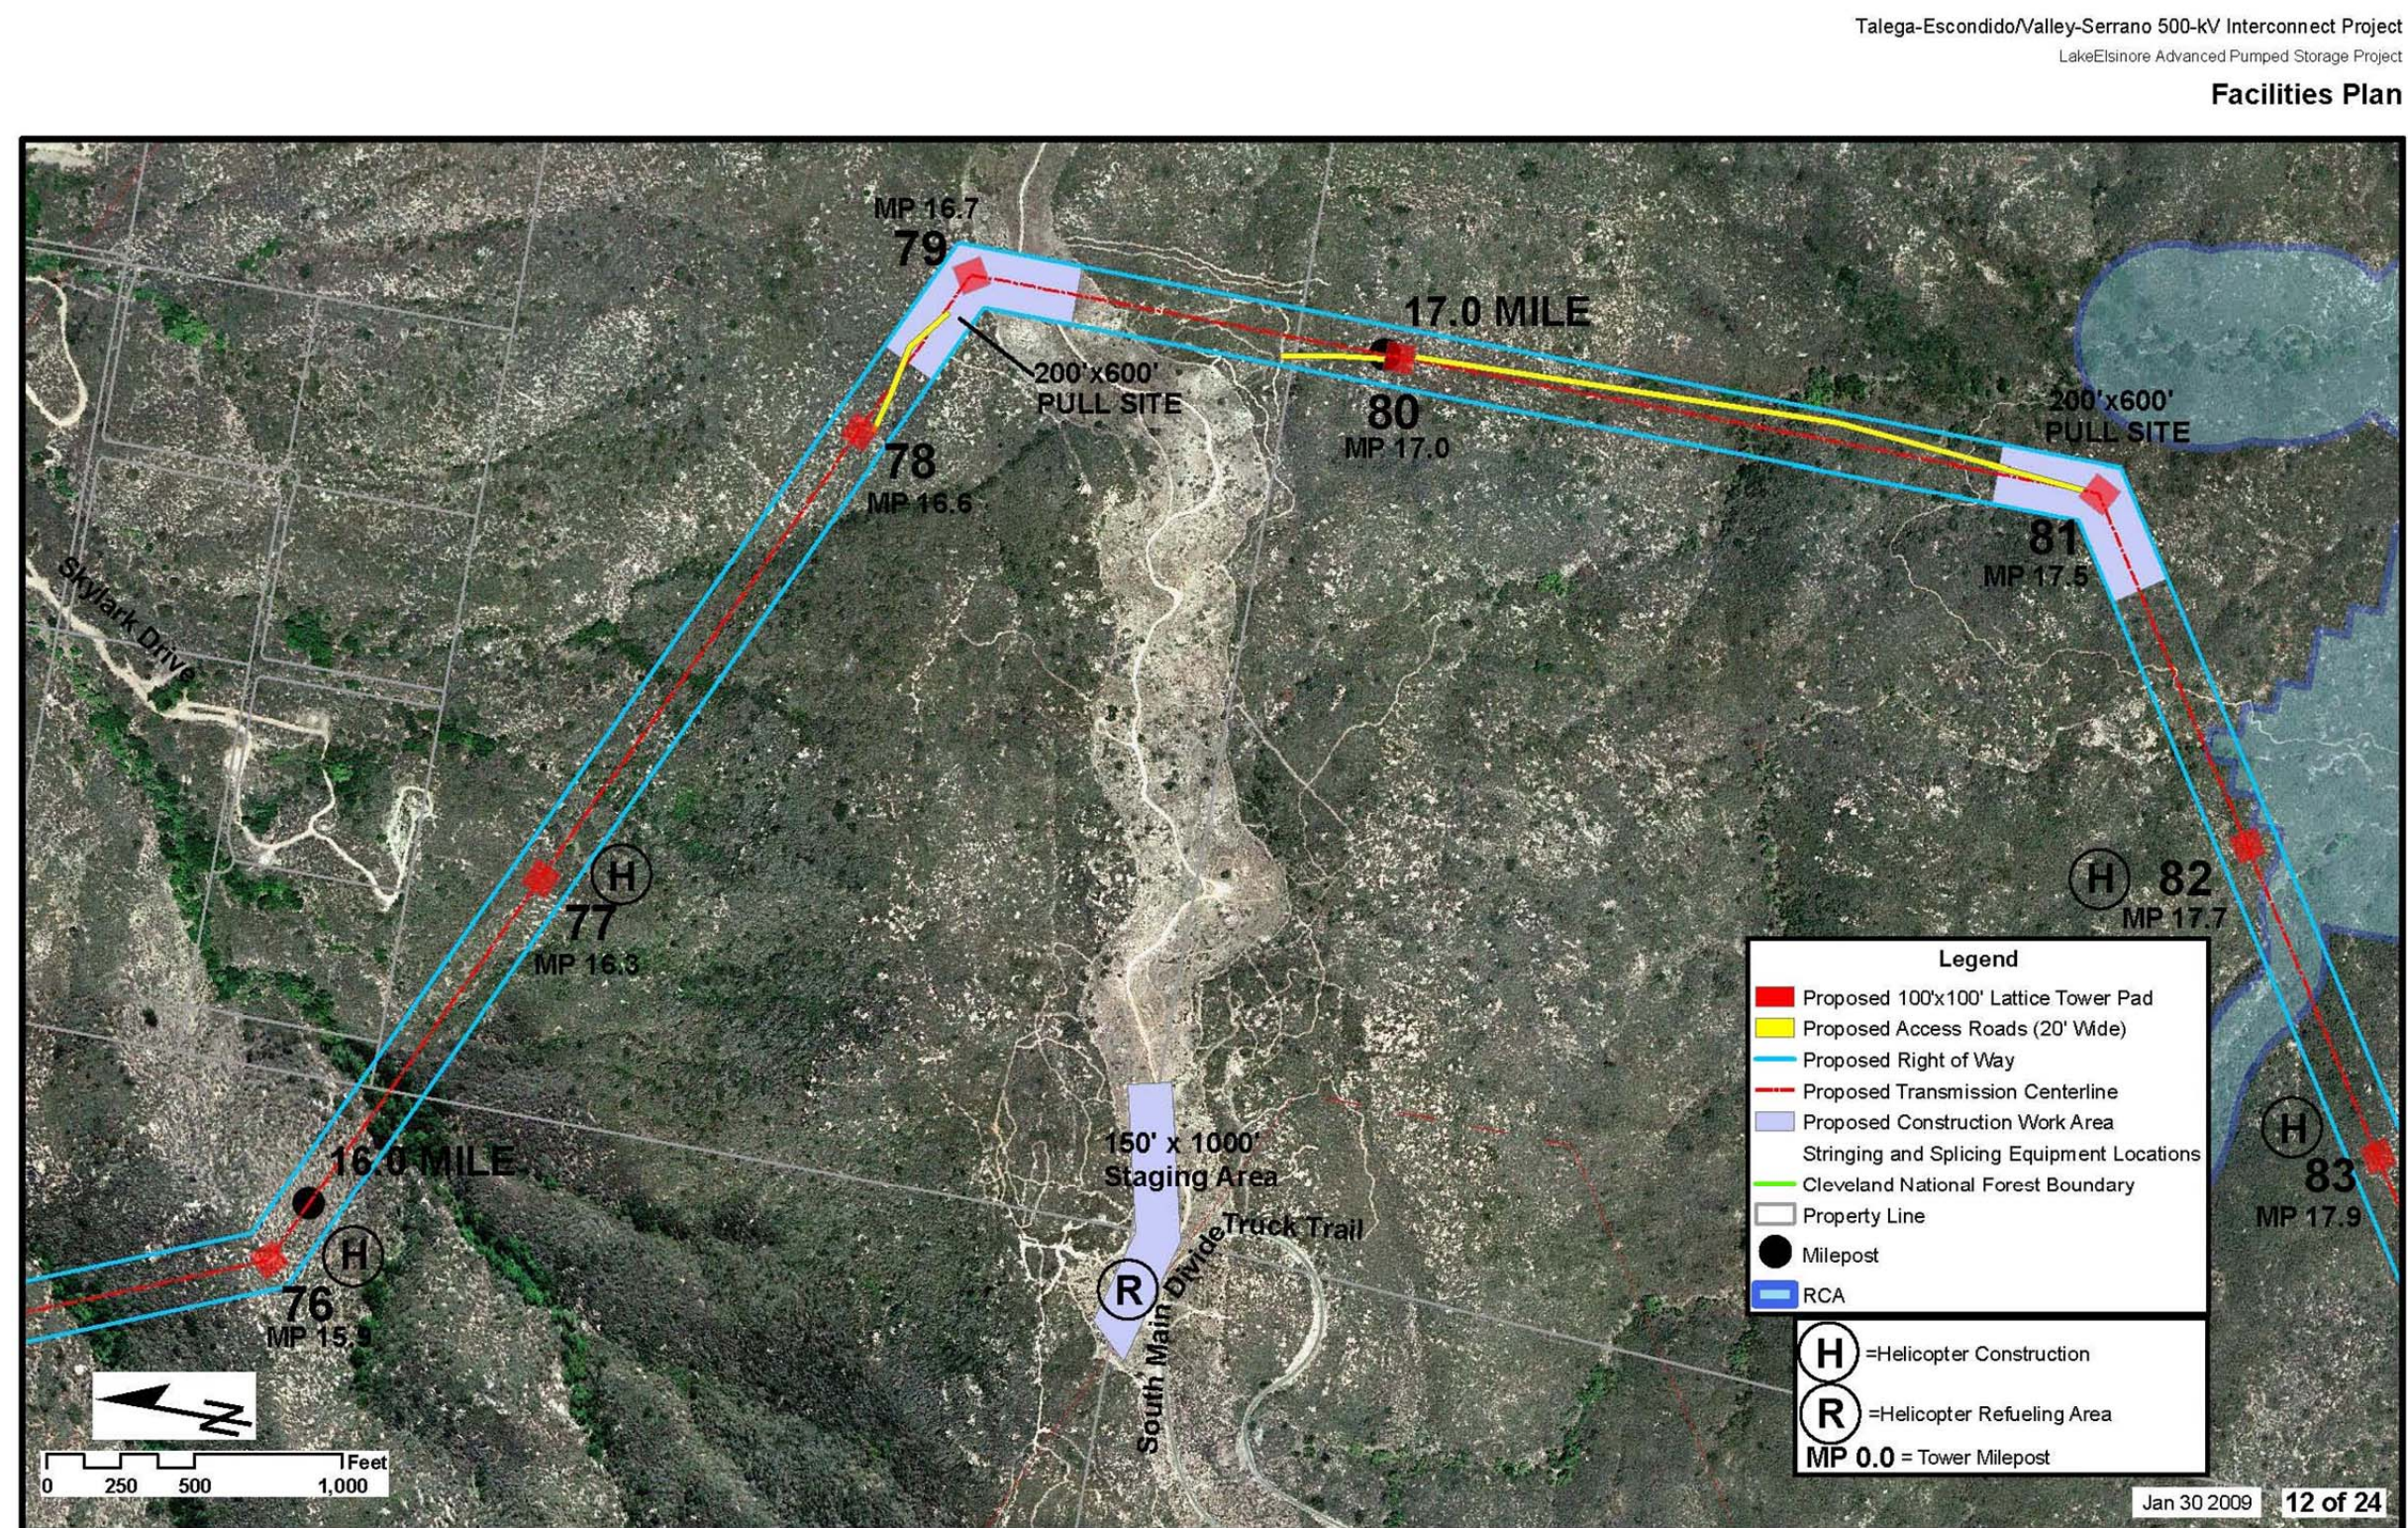




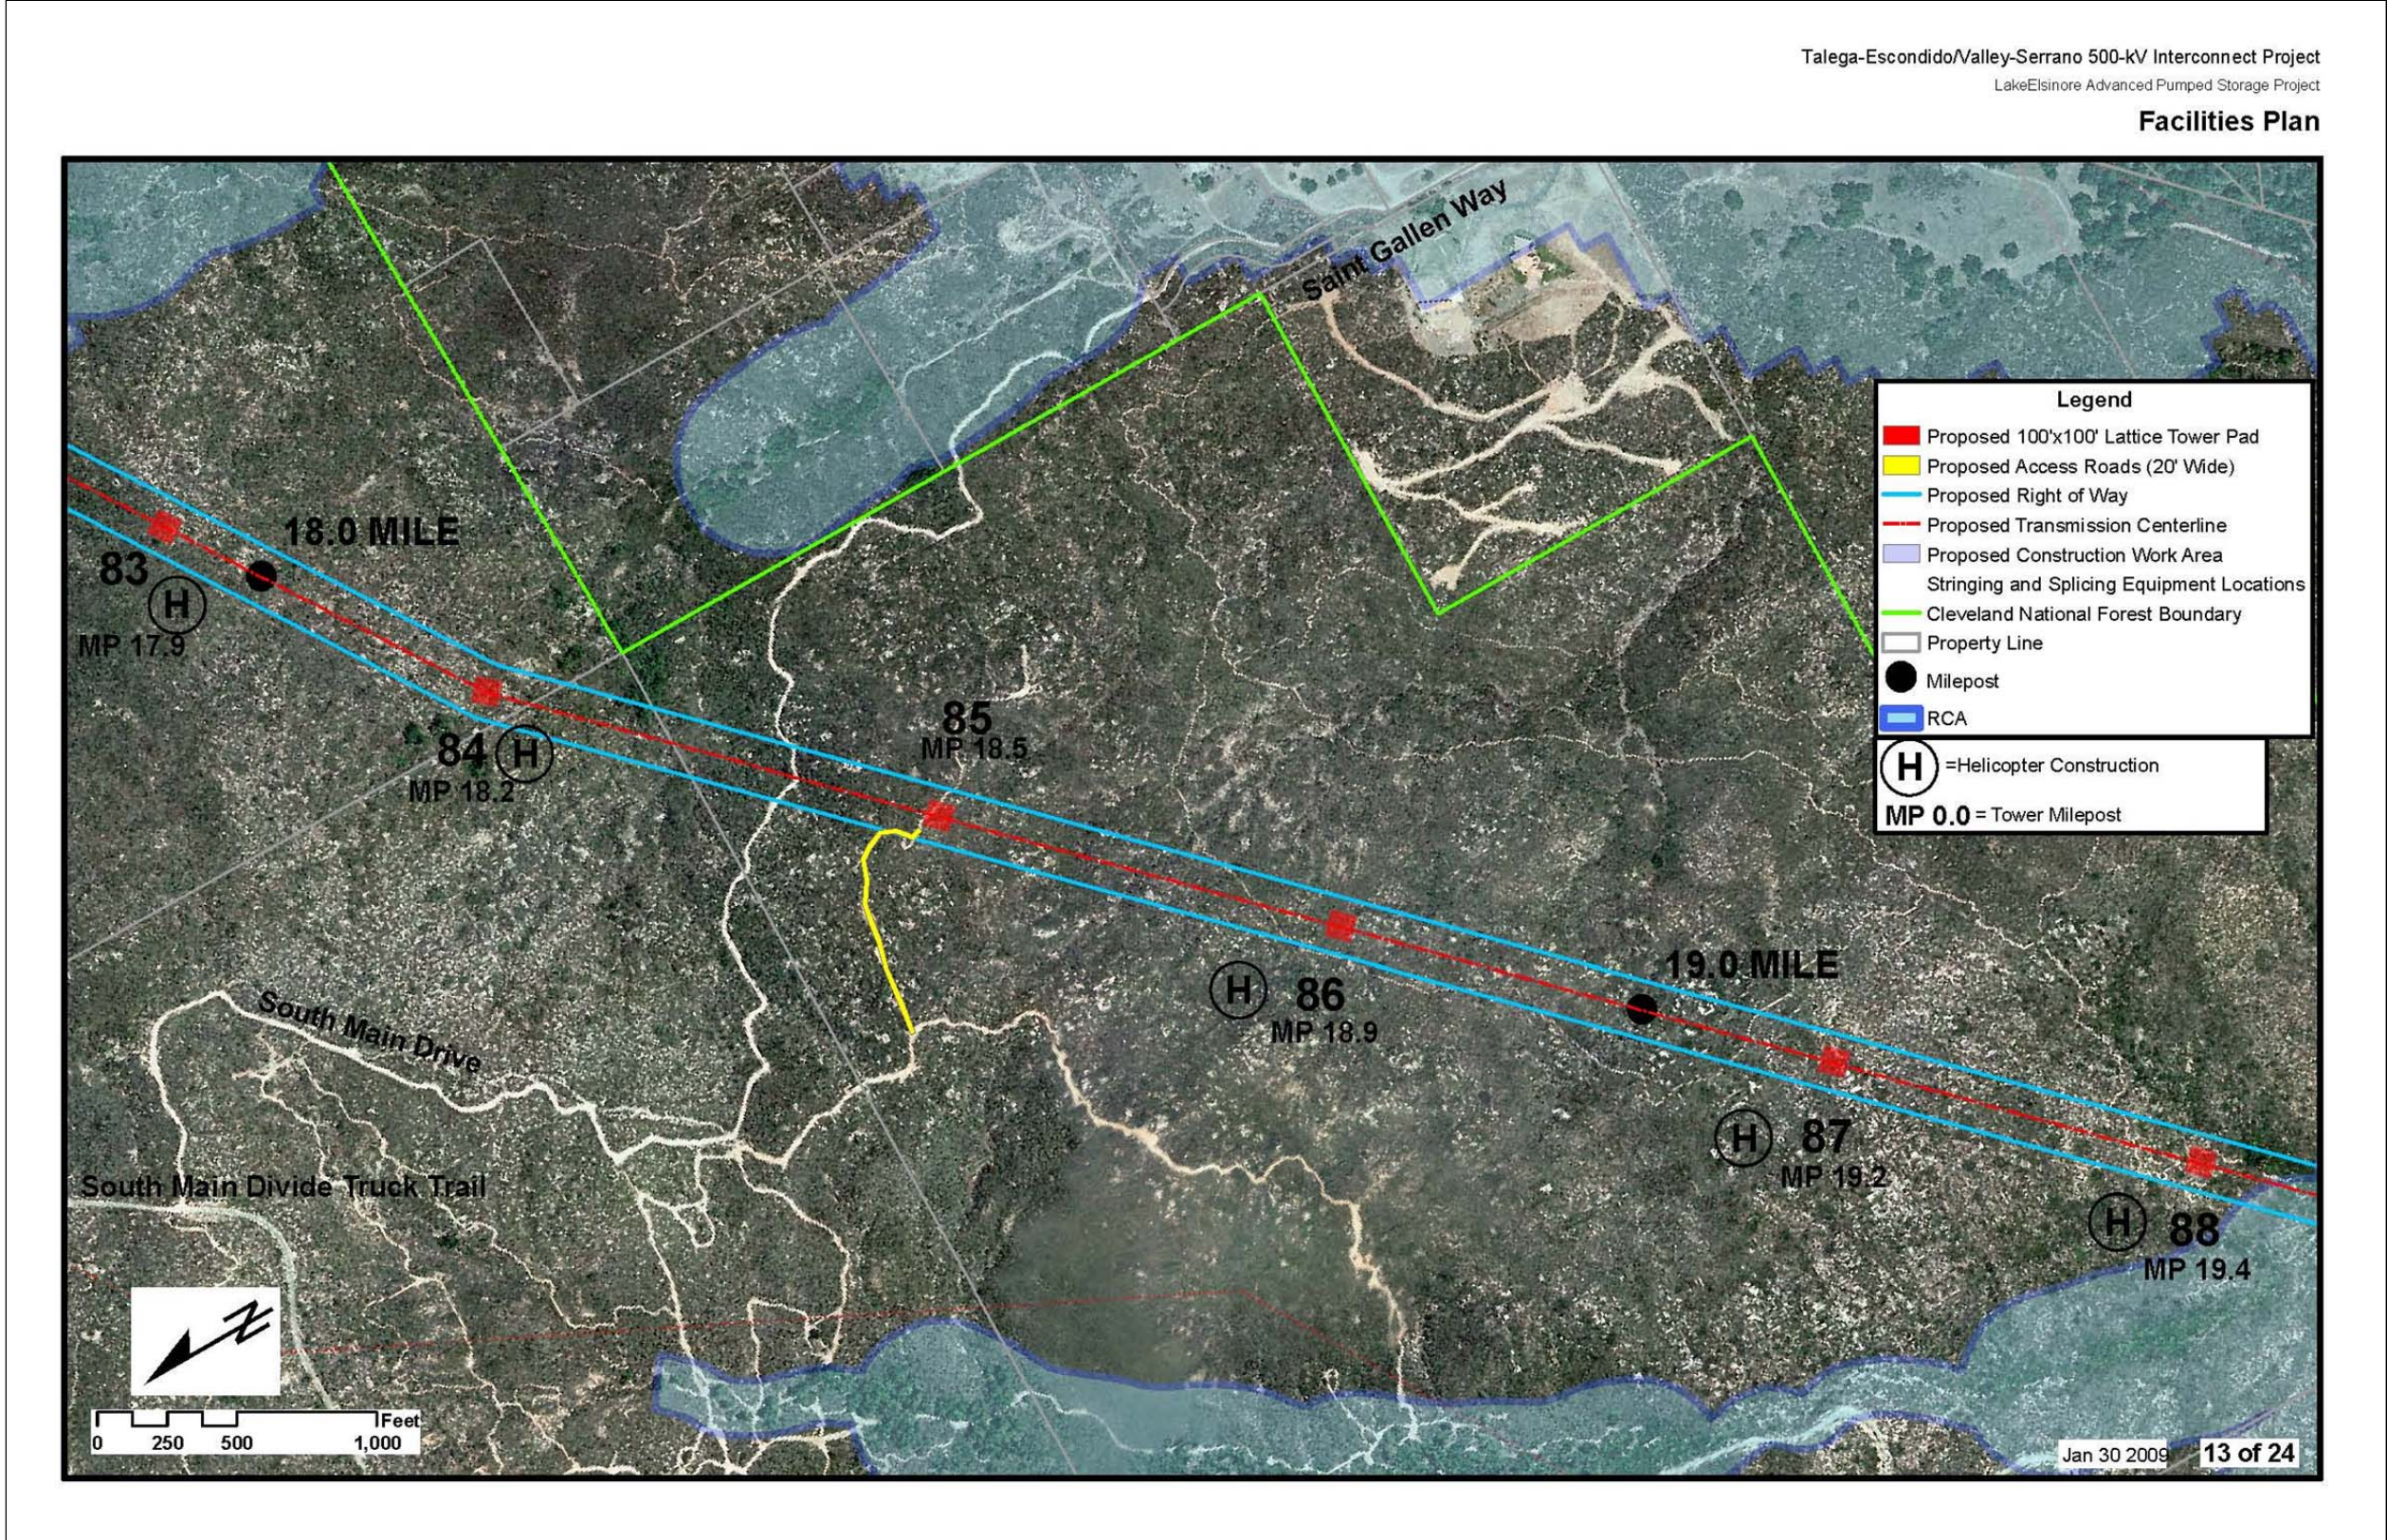


**Figure 3.1.1-4: (13 of 24) Talega-Escondido/Valley-Serrano 500 kV Interconnect Project**  
Source: The Nevada Hydro Company



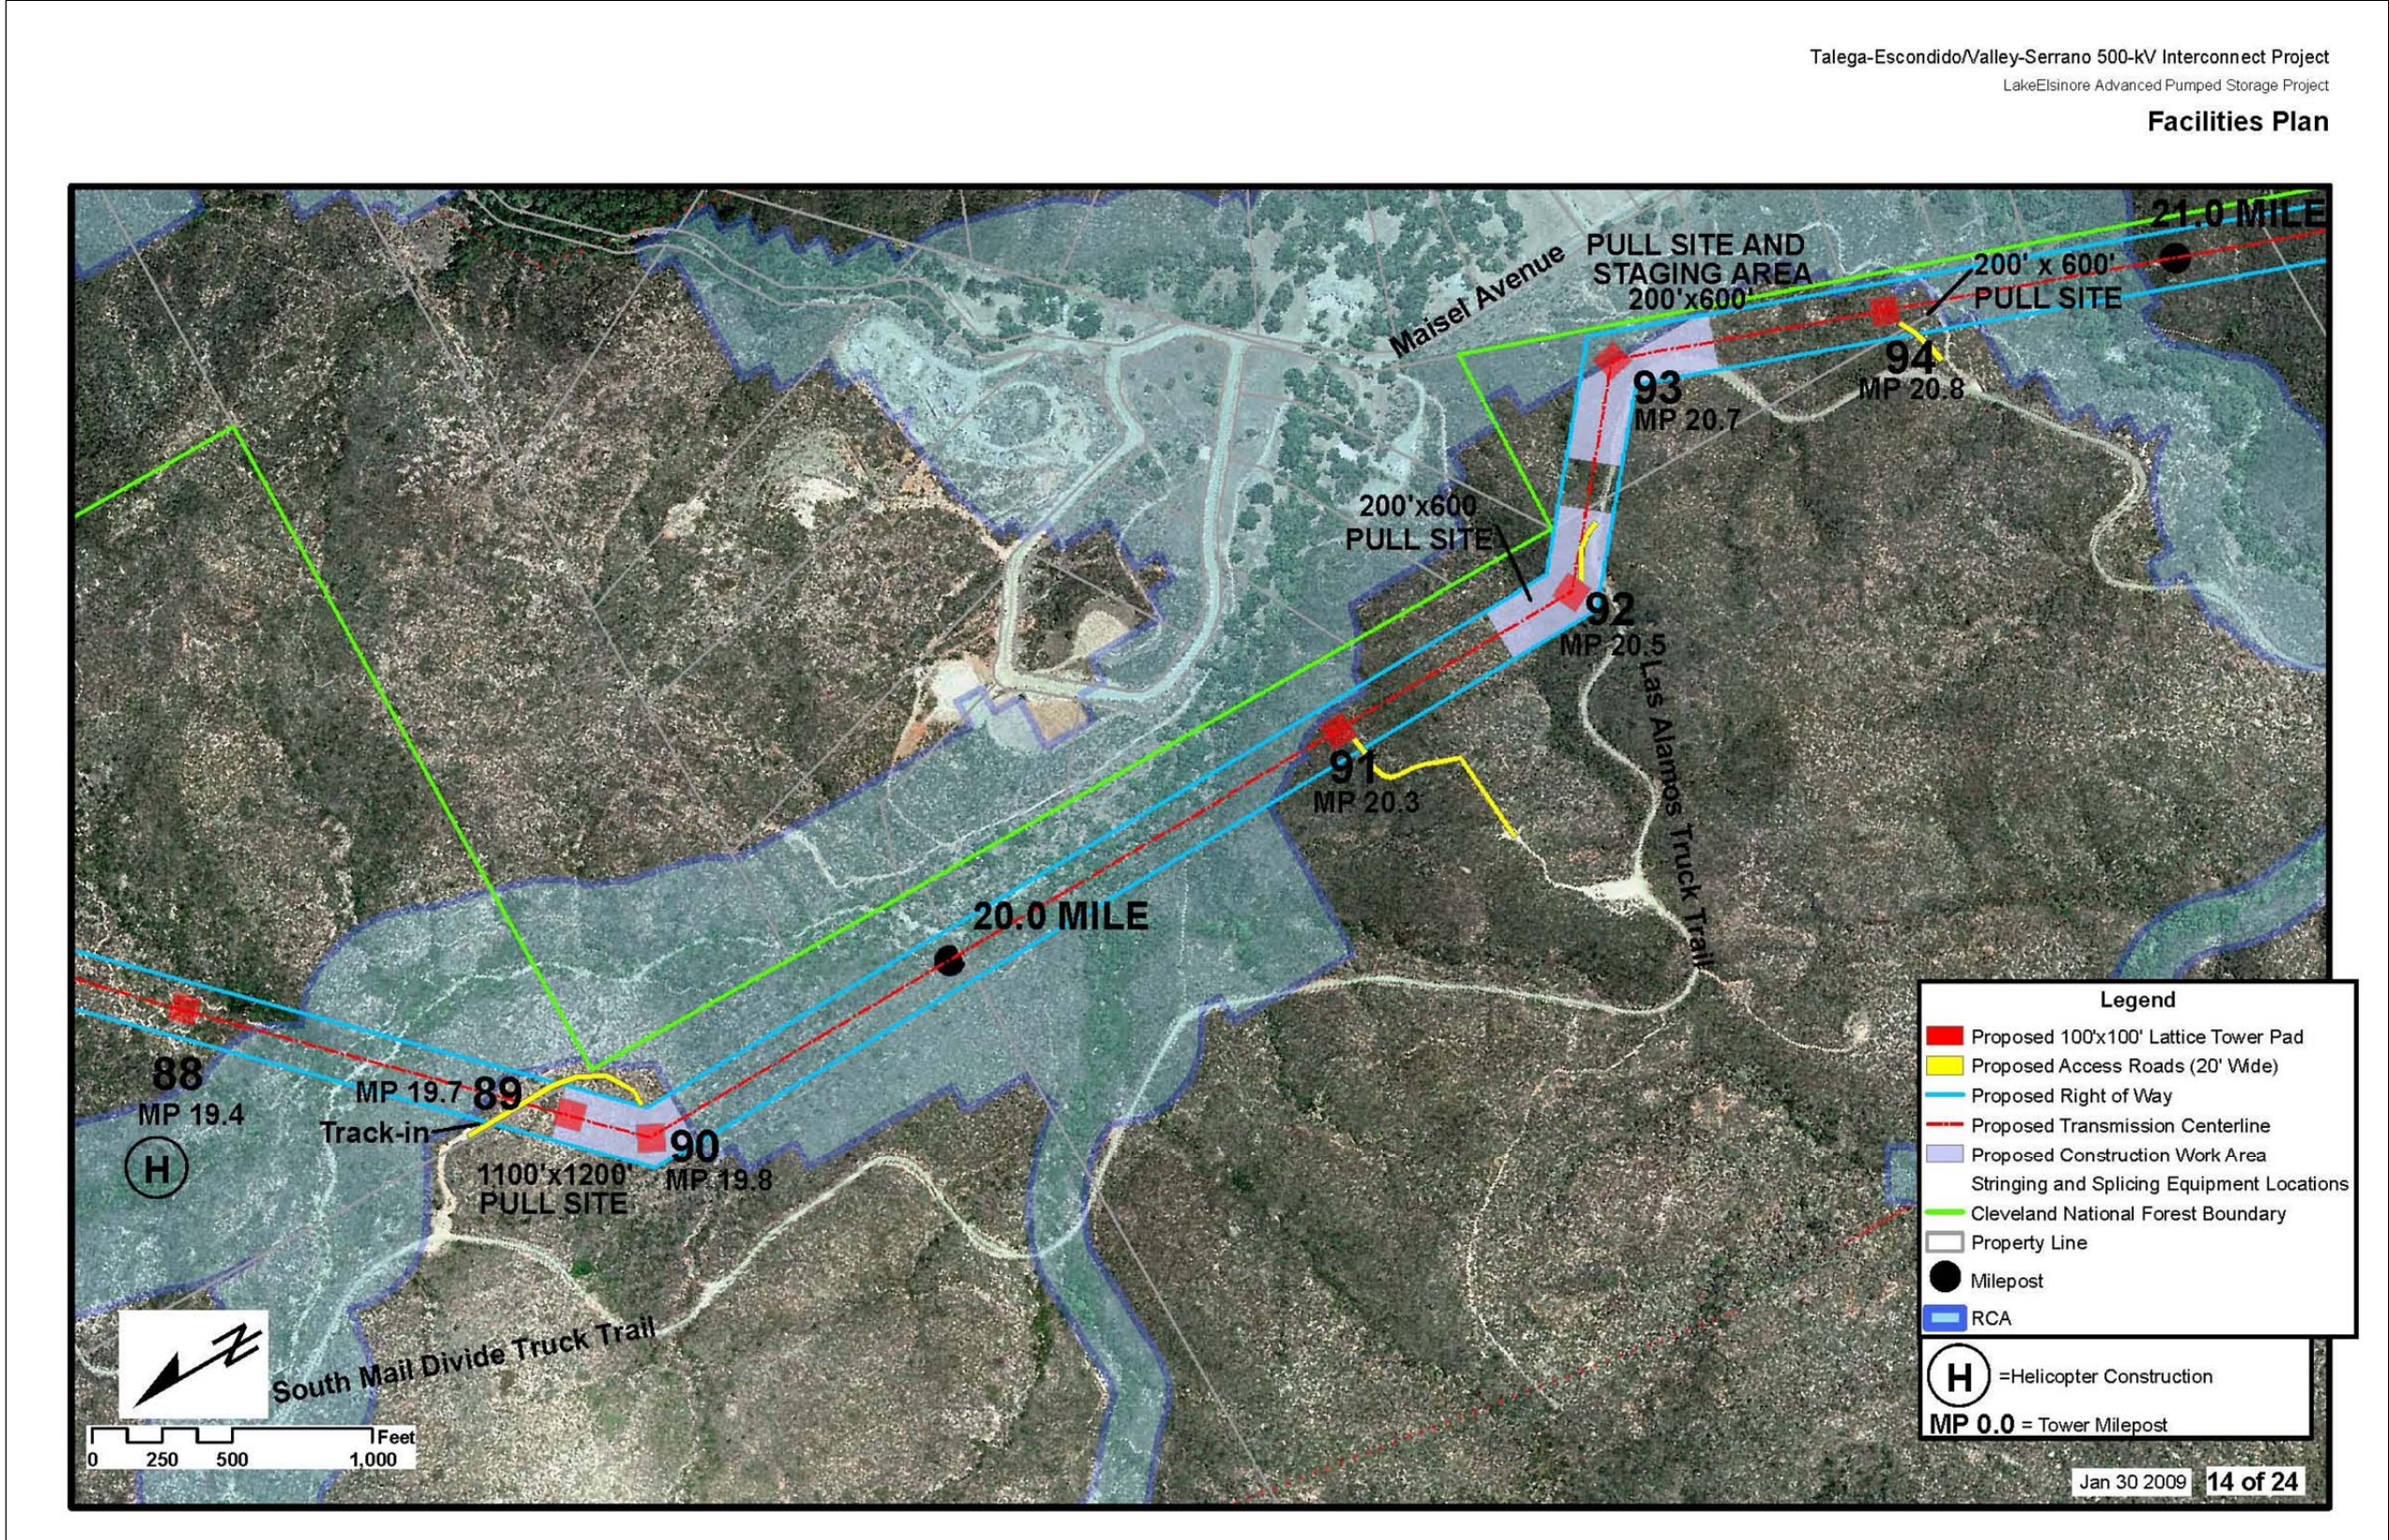


**Figure 3.1.1-4: (14 of 24) Talega-Escondido/Valley-Serrano 500 kV Interconnect Project**  
Source: The Nevada Hydro Company



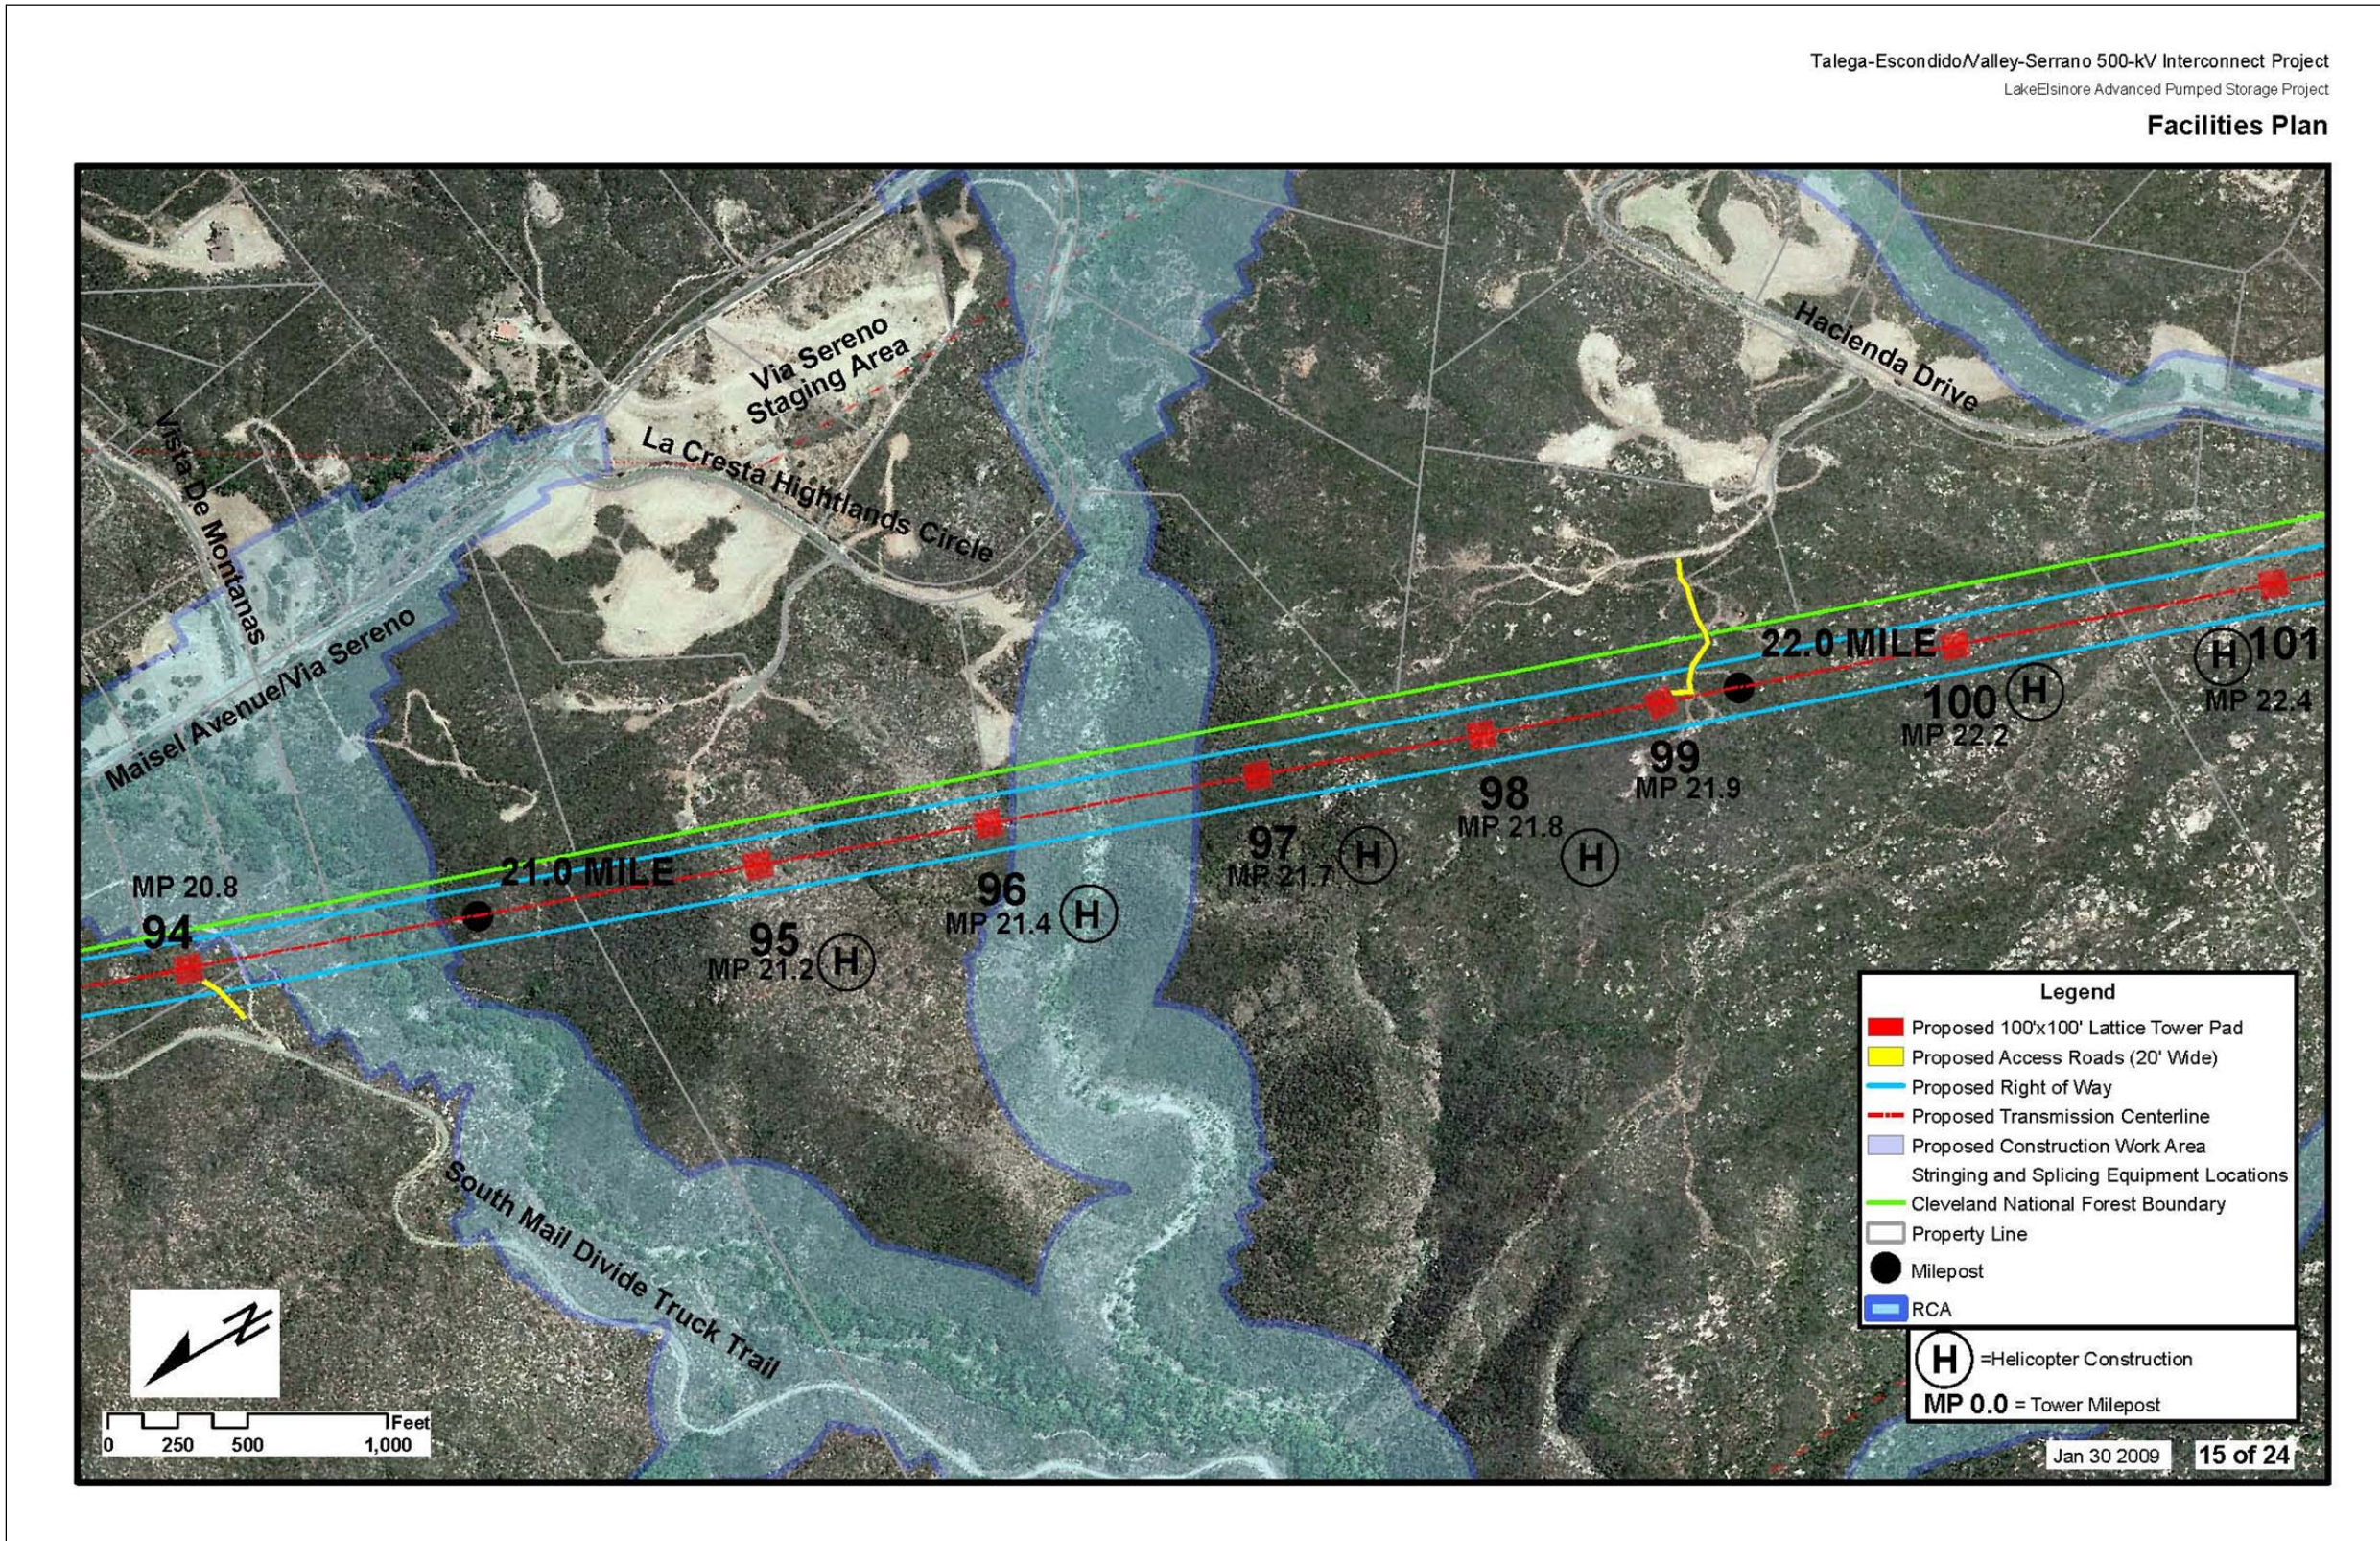

**Figure 3.1.1-4: (15 of 24) Talega-Escondido/Valley-Serrano 500 kV Interconnect Project**  
Source: The Nevada Hydro Company



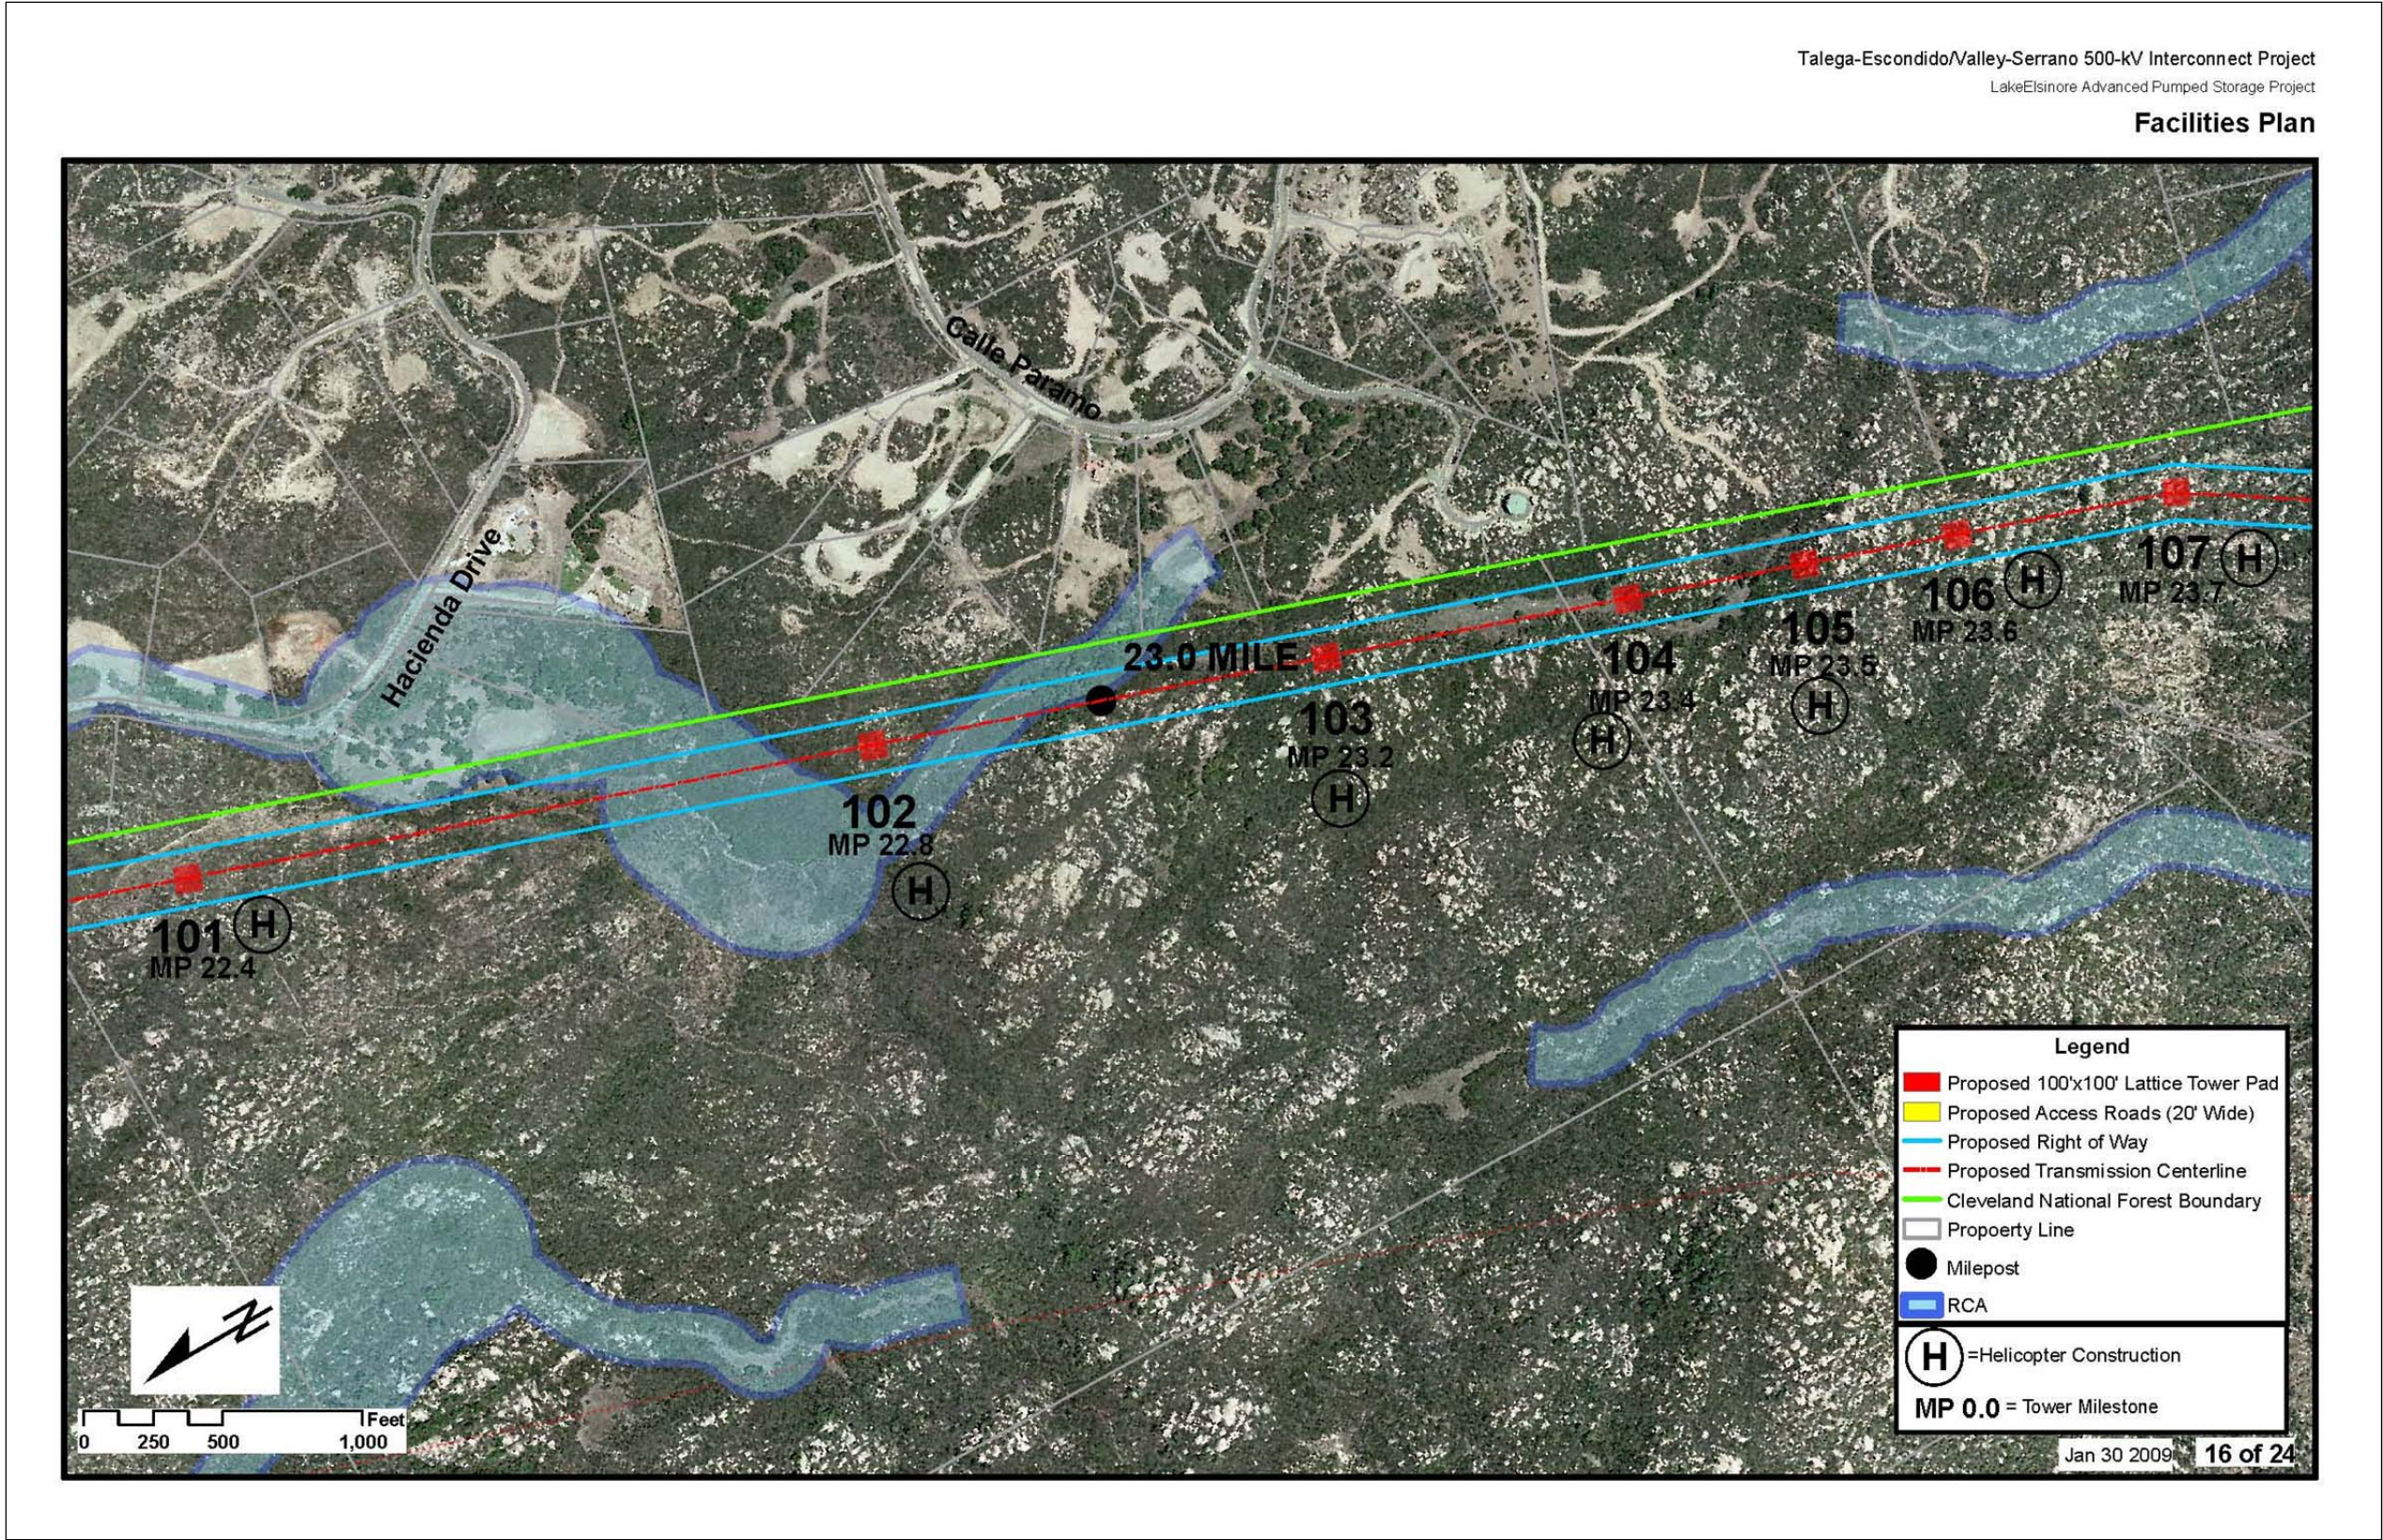

**Figure 3.1.1-4: (16 of 24) Talega-Escondido/Valley-Serrano 500 kV Interconnect Project**  
Source: The Nevada Hydro Company




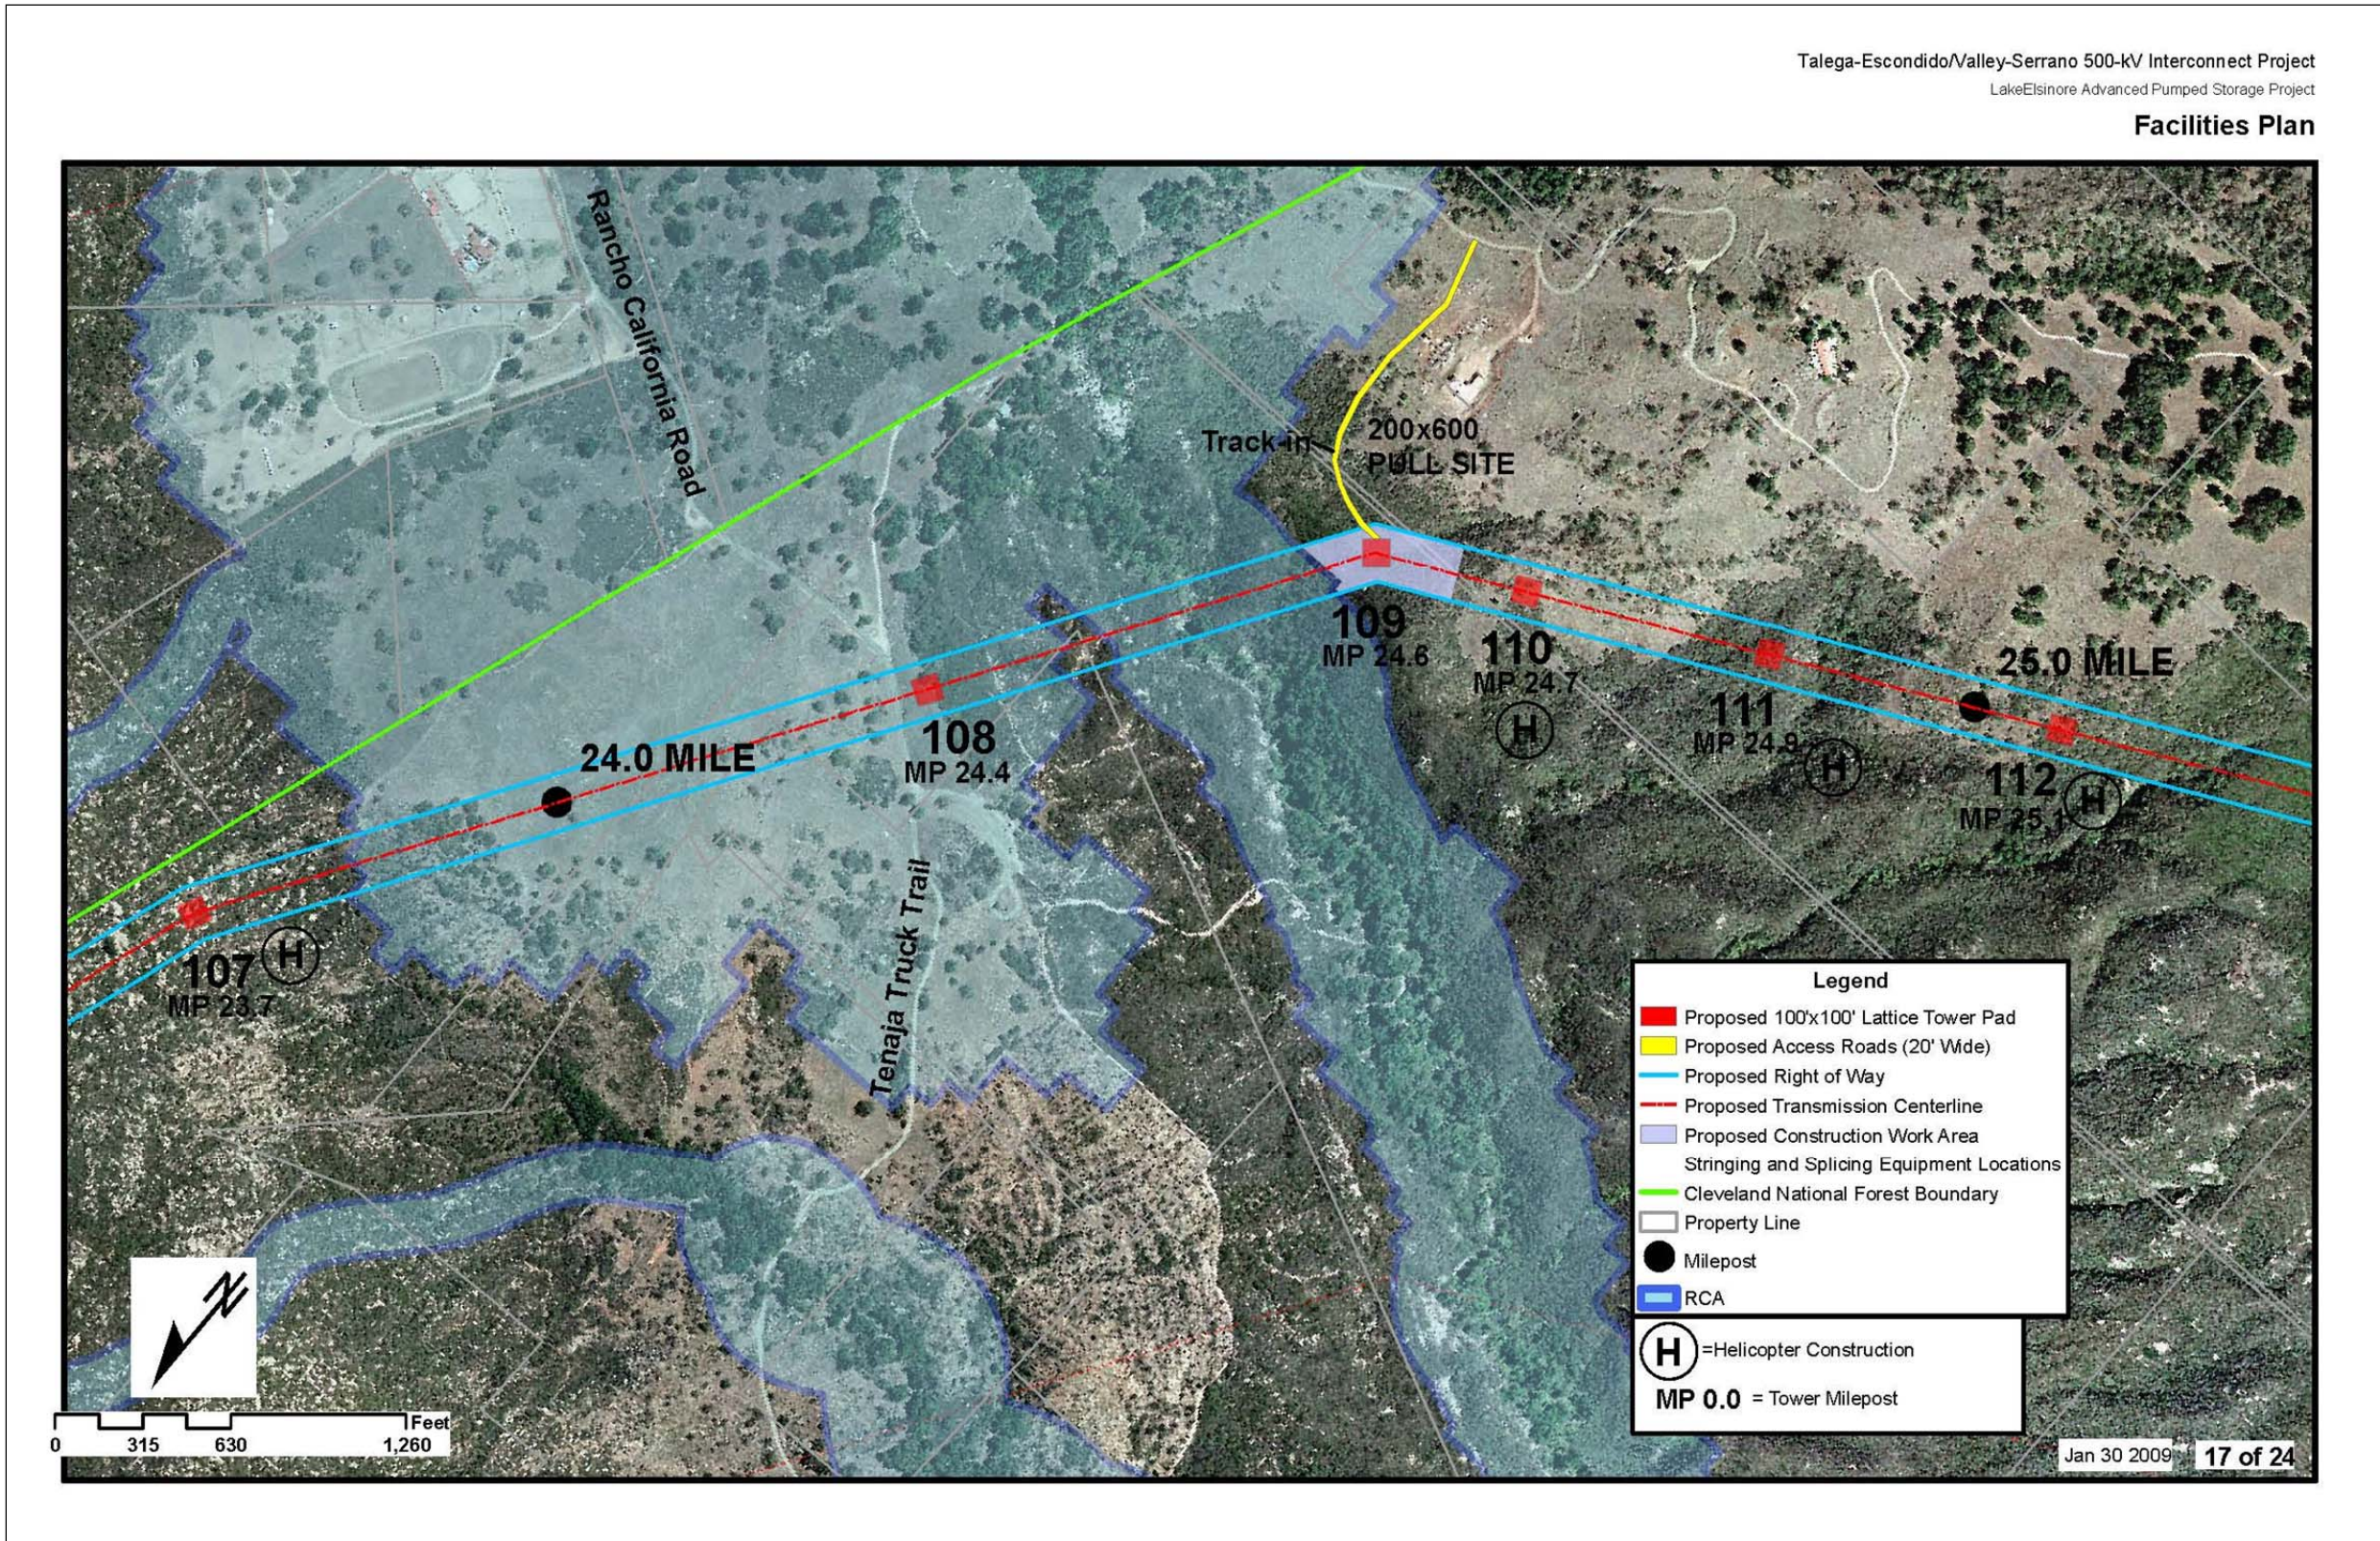



Figure 3.1.1-4: (17 of 24) Talega-Escondido/Valley-Serrano 500 kV Interconnect Project  
Source: The Nevada Hydro Company






**Figure 3.1.1-4: (18 of 24) Talega-Escondido/Valley-Serrano 500 kV Interconnect Project**  
Source: The Nevada Hydro Company

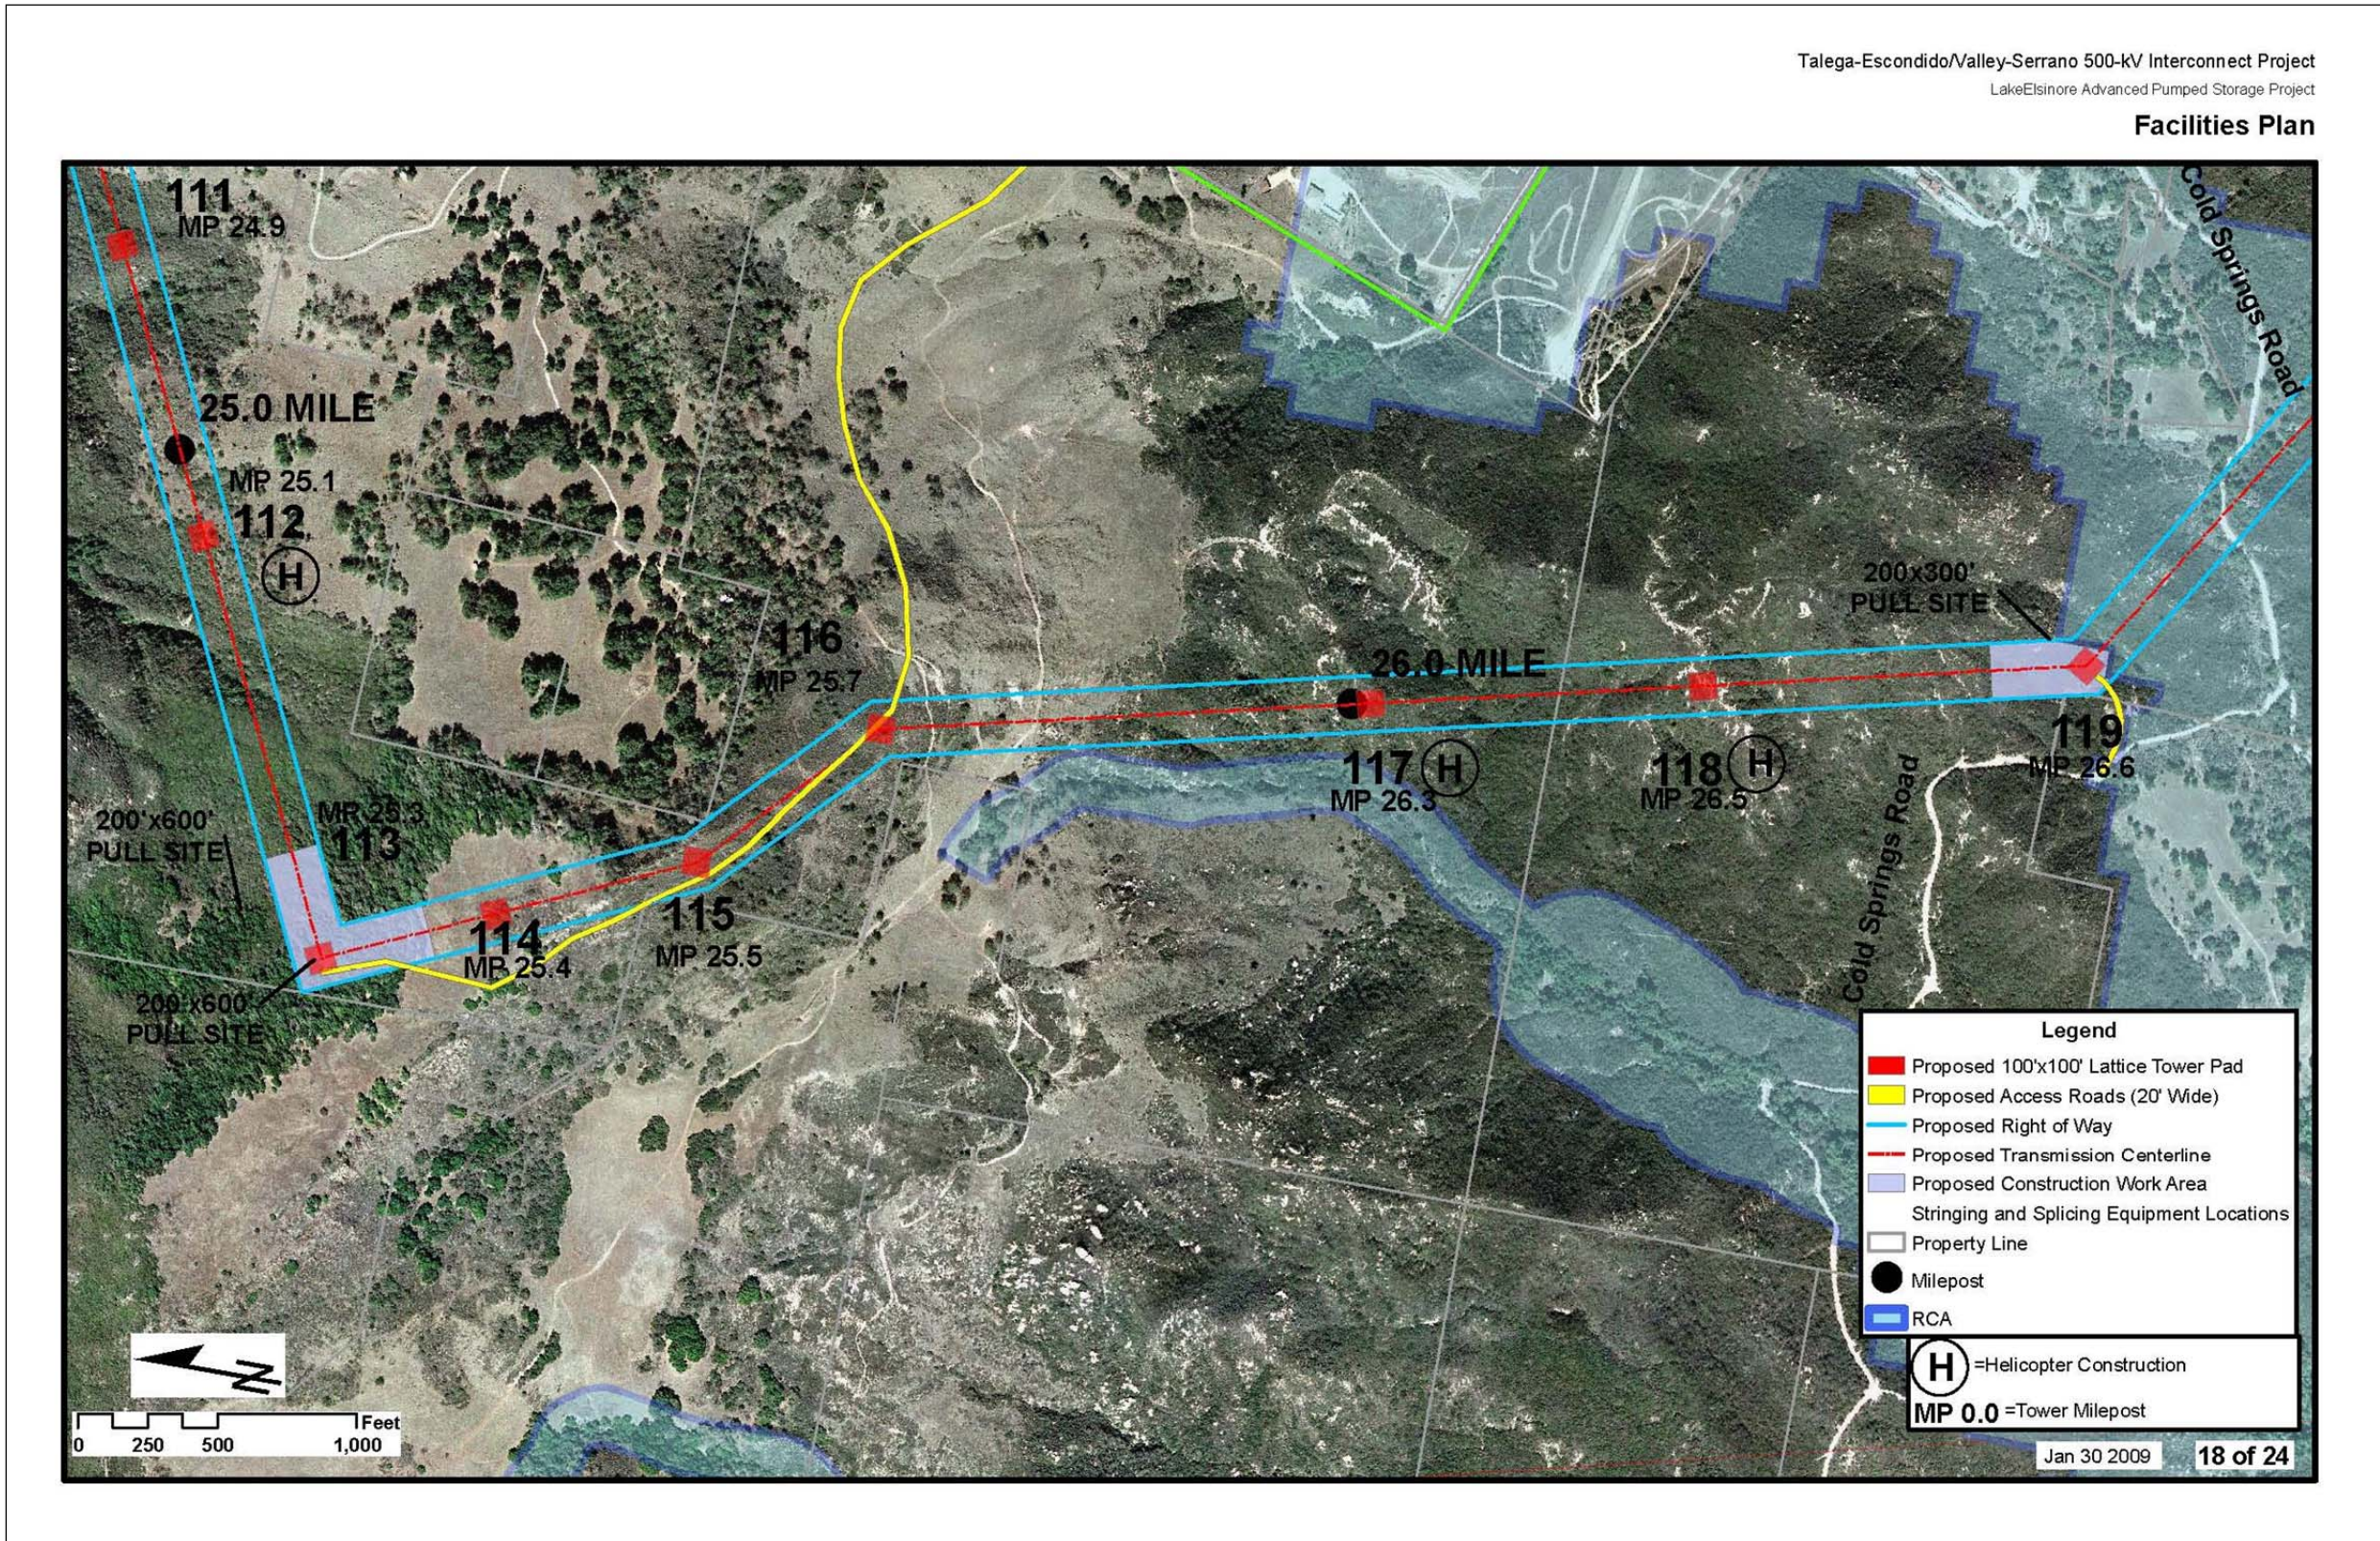

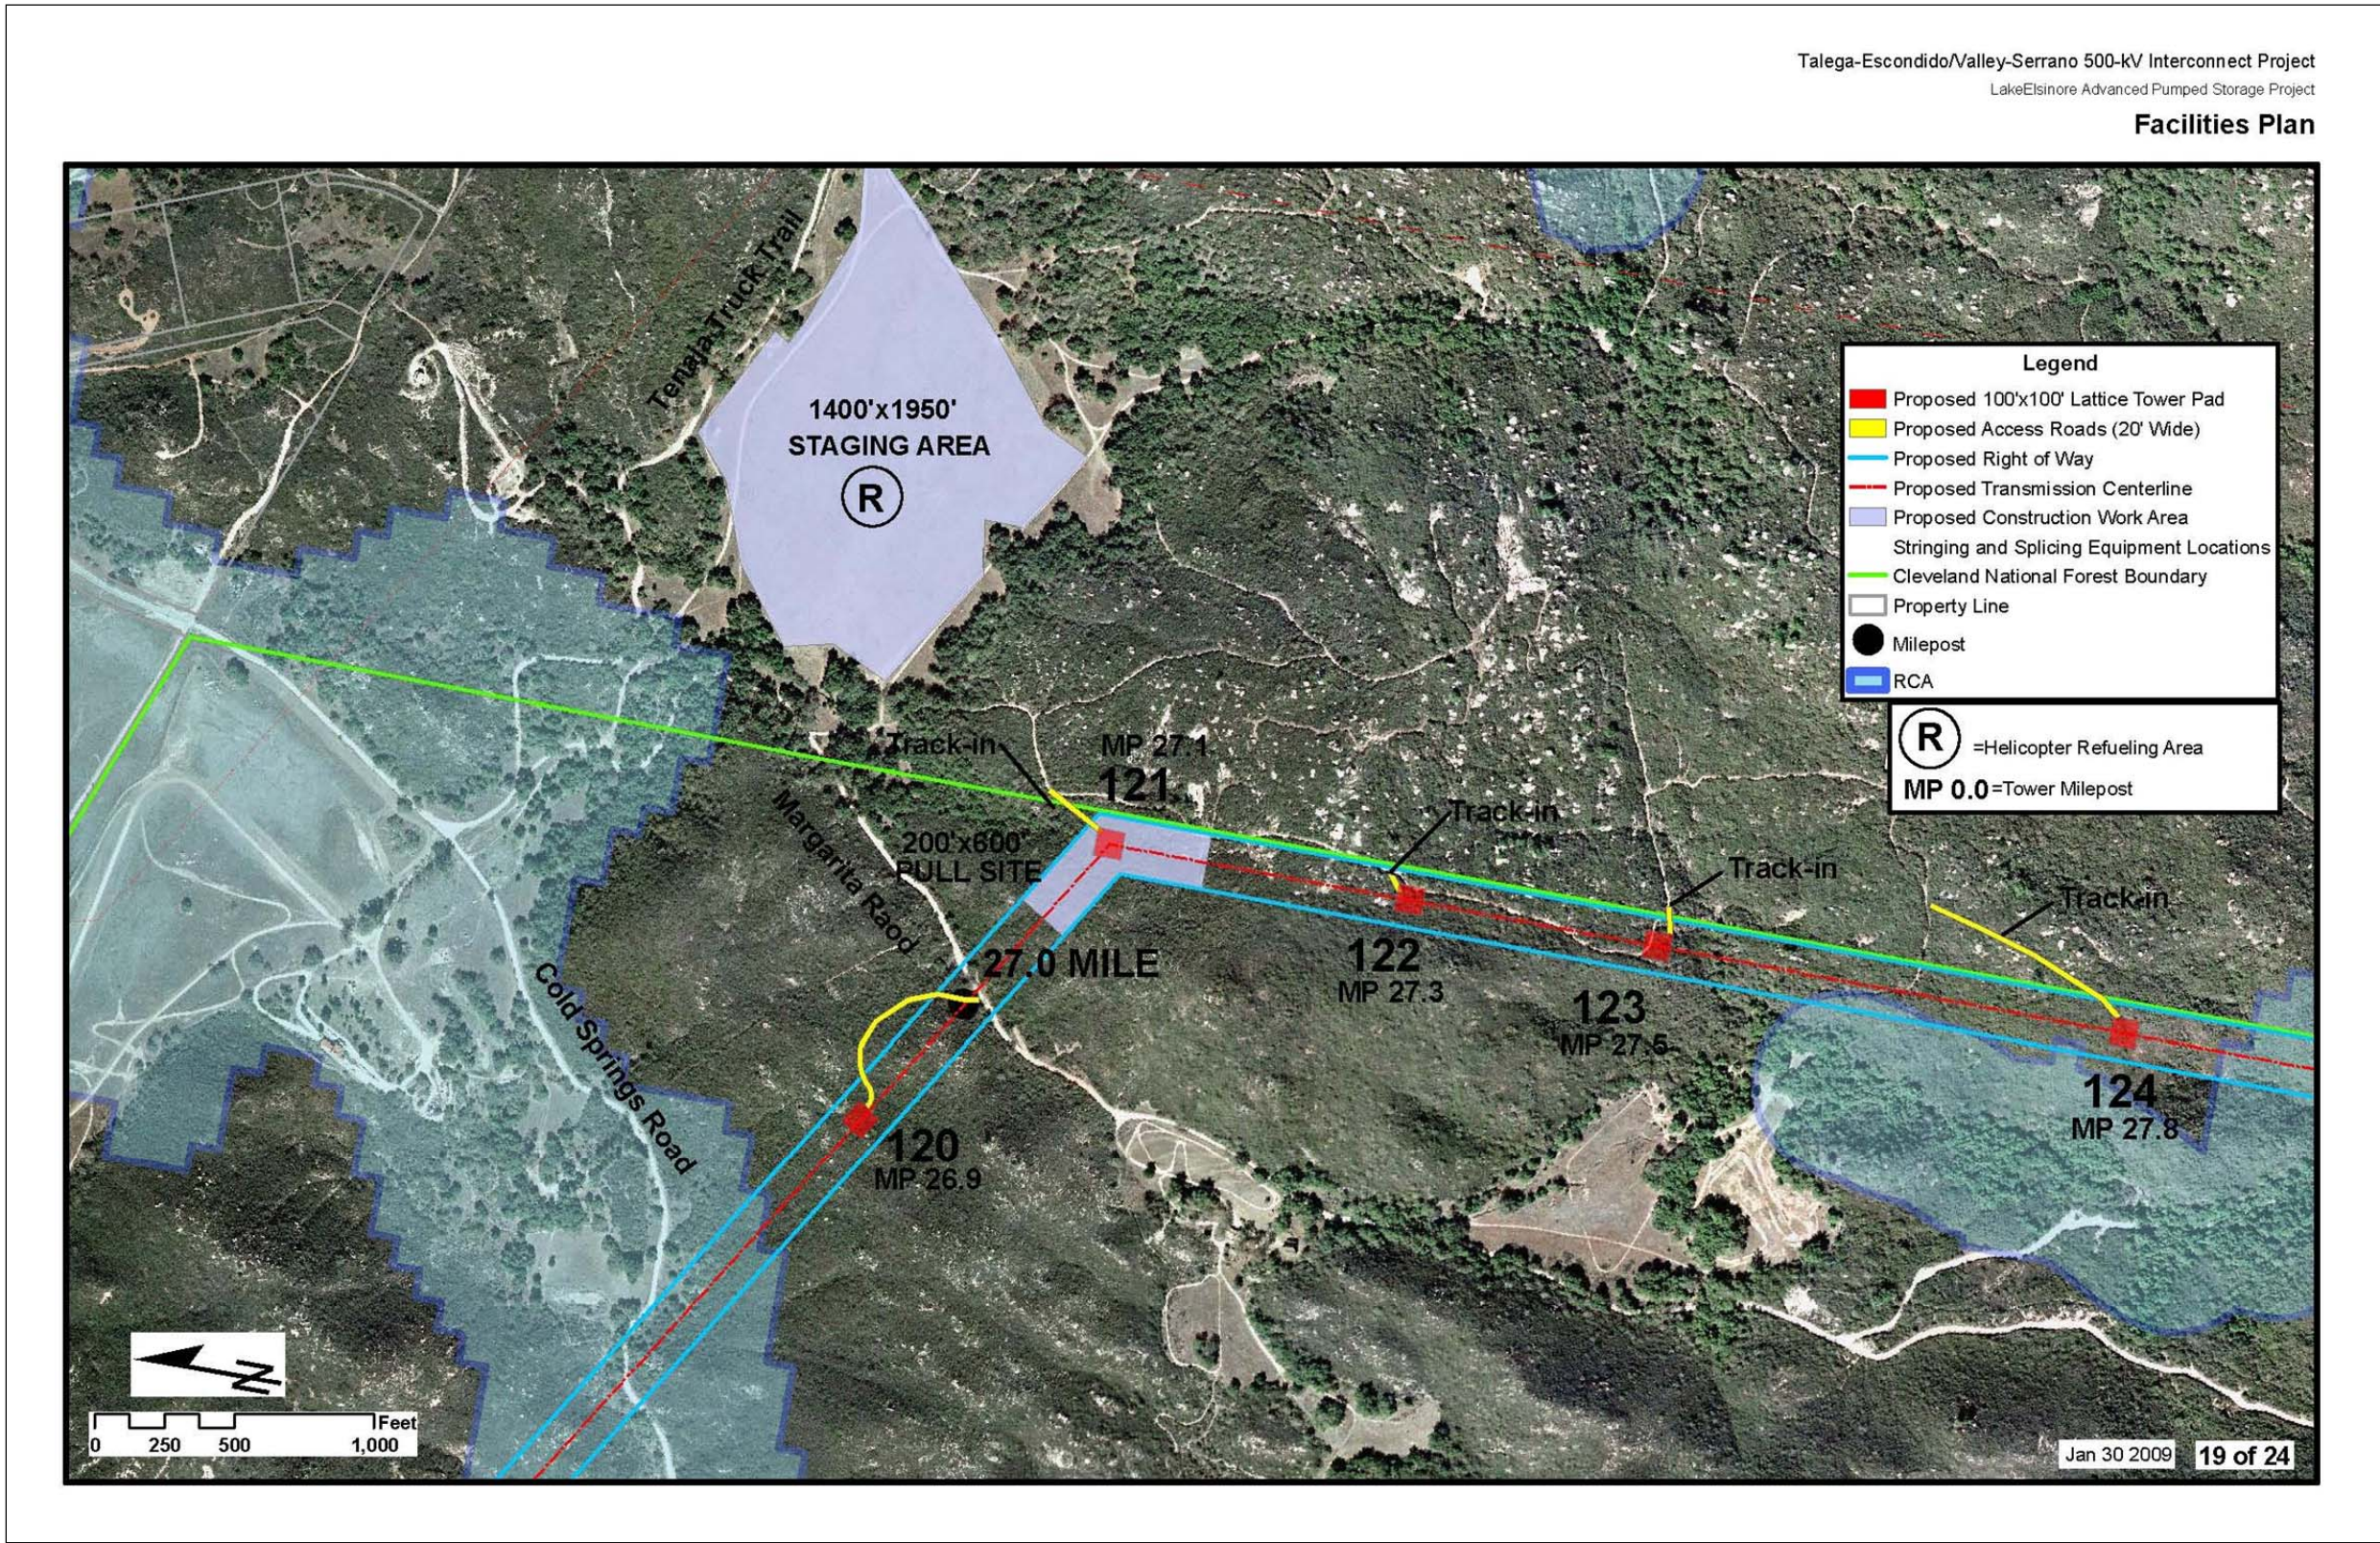

**Figure 3.1.1-4: (19 of 24) Talega-Escondido/Valley-Serrano 500 kV Interconnect Project**  
Source: The Nevada Hydro Company



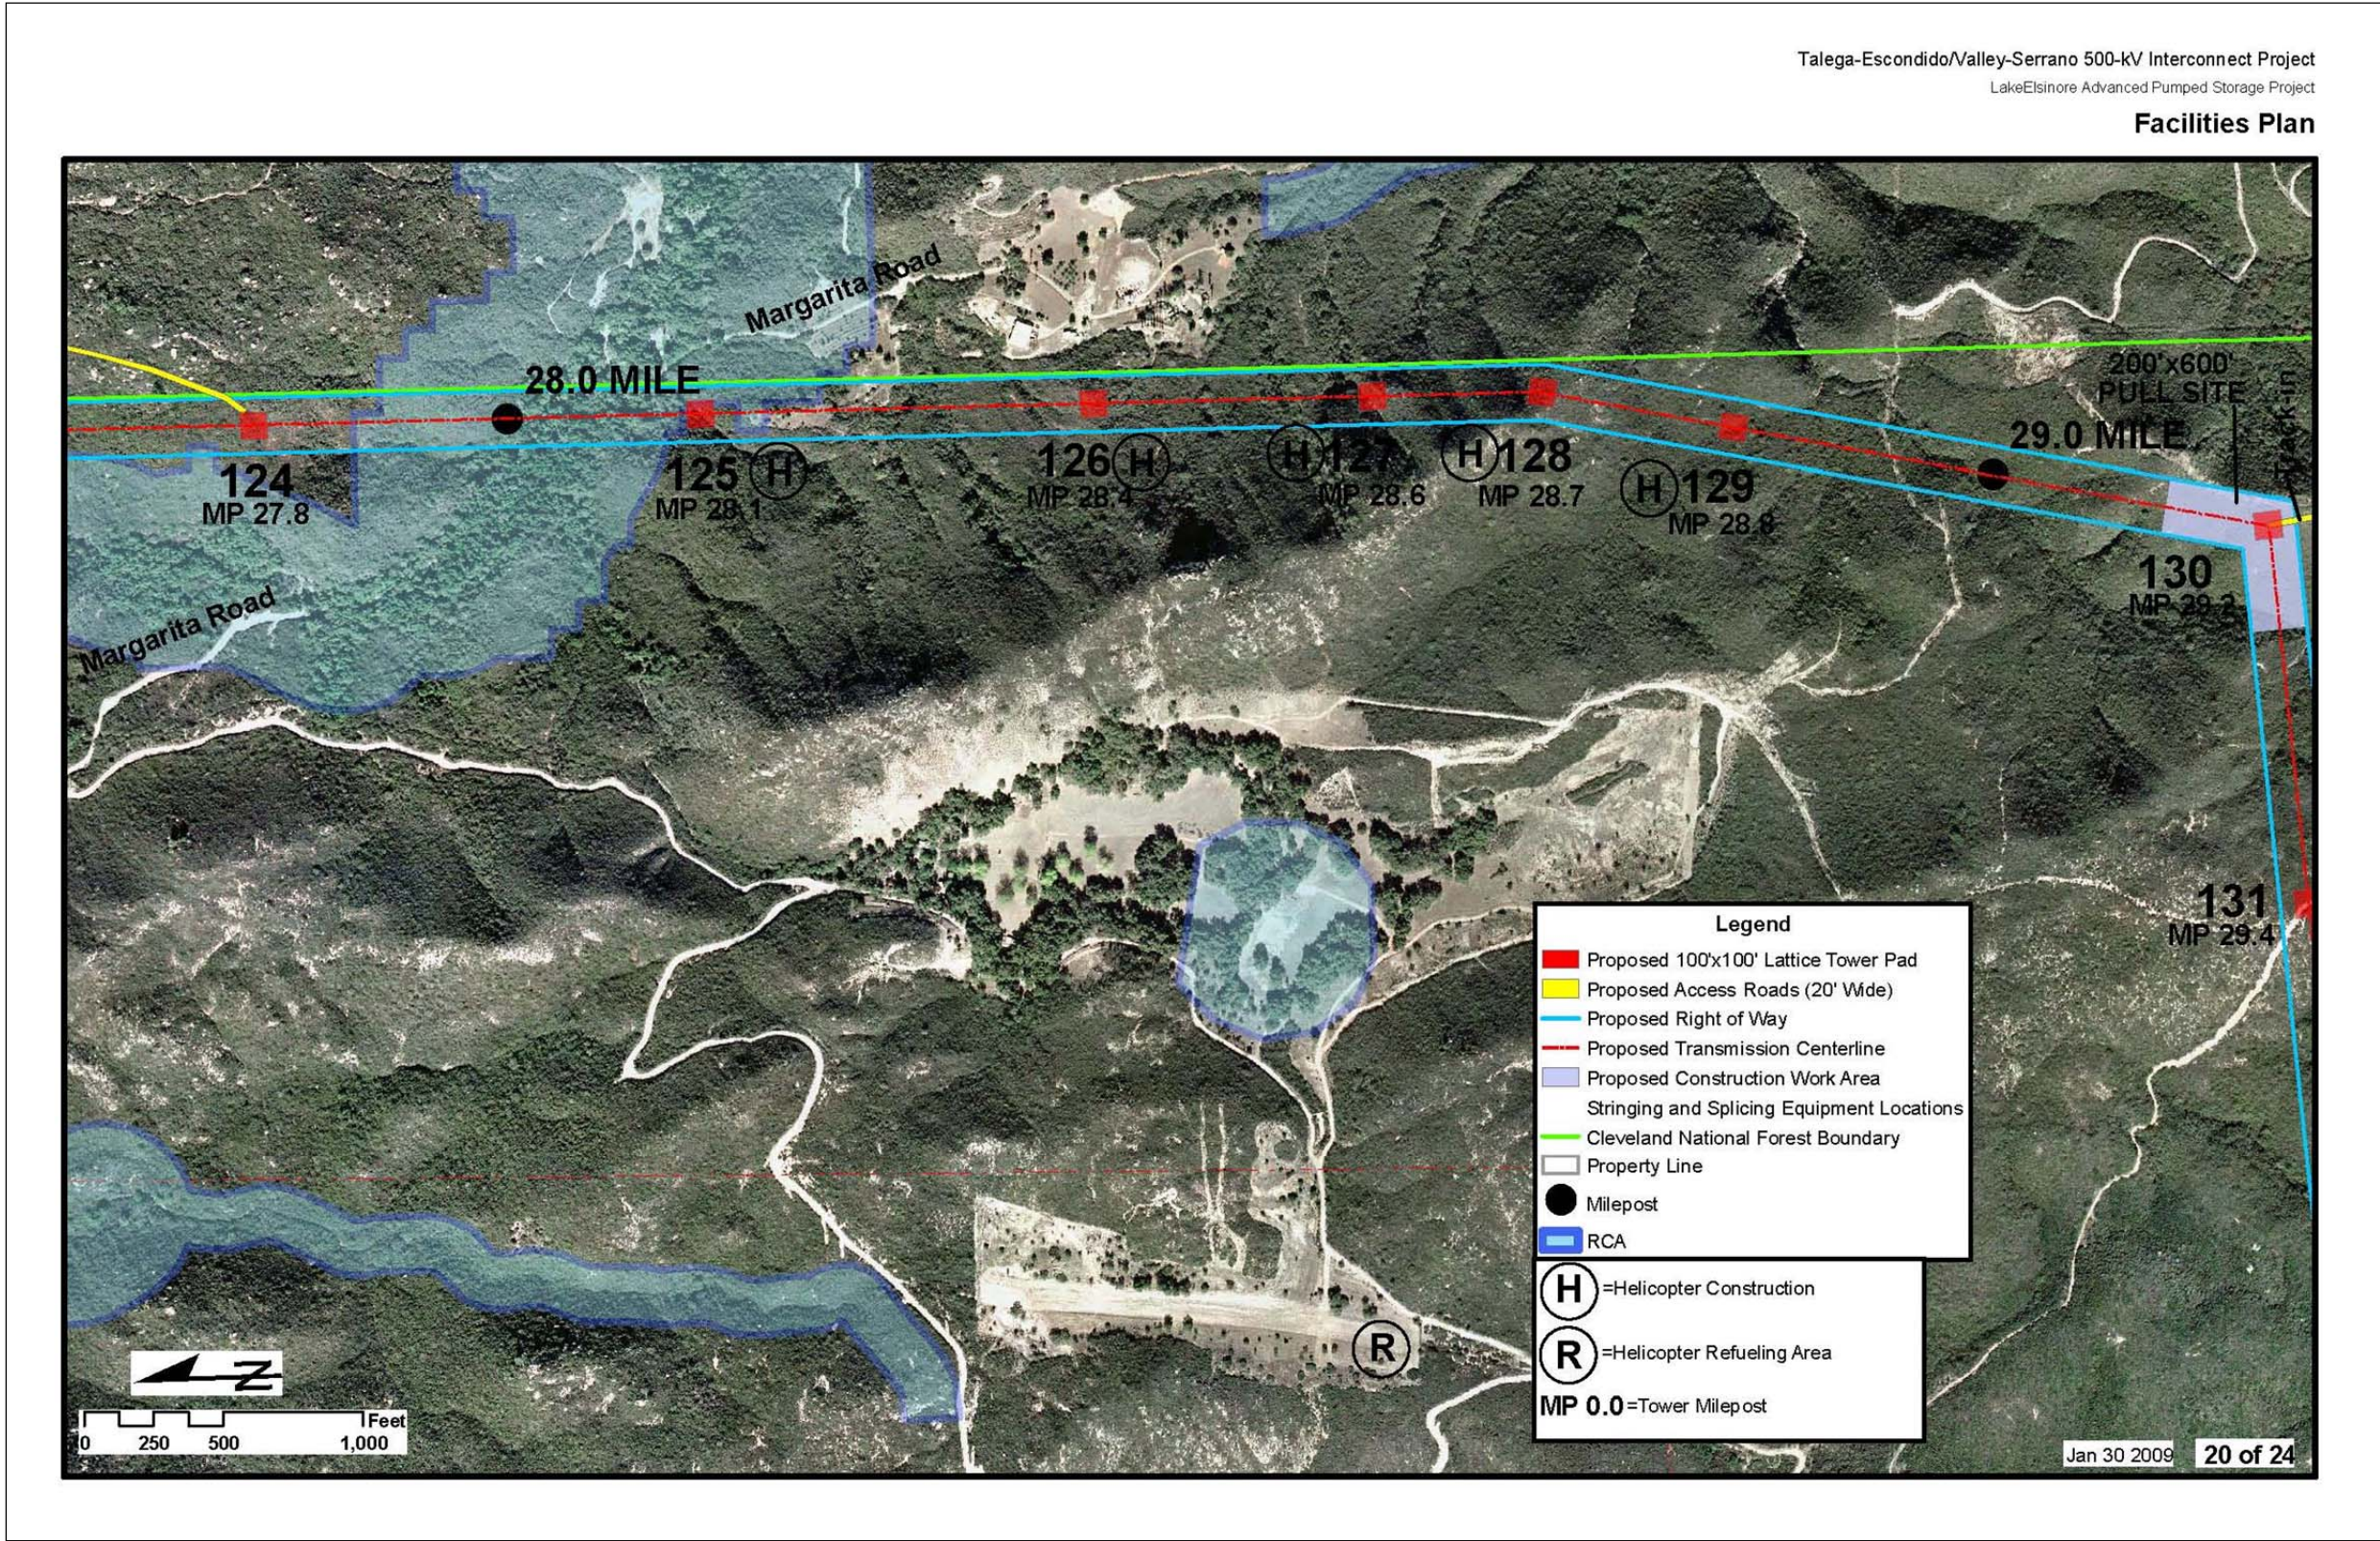

**Figure 3.1.1-4: (20 of 24) Talega-Escondido/Valley-Serrano 500 kV Interconnect Project**  
Source: The Nevada Hydro Company




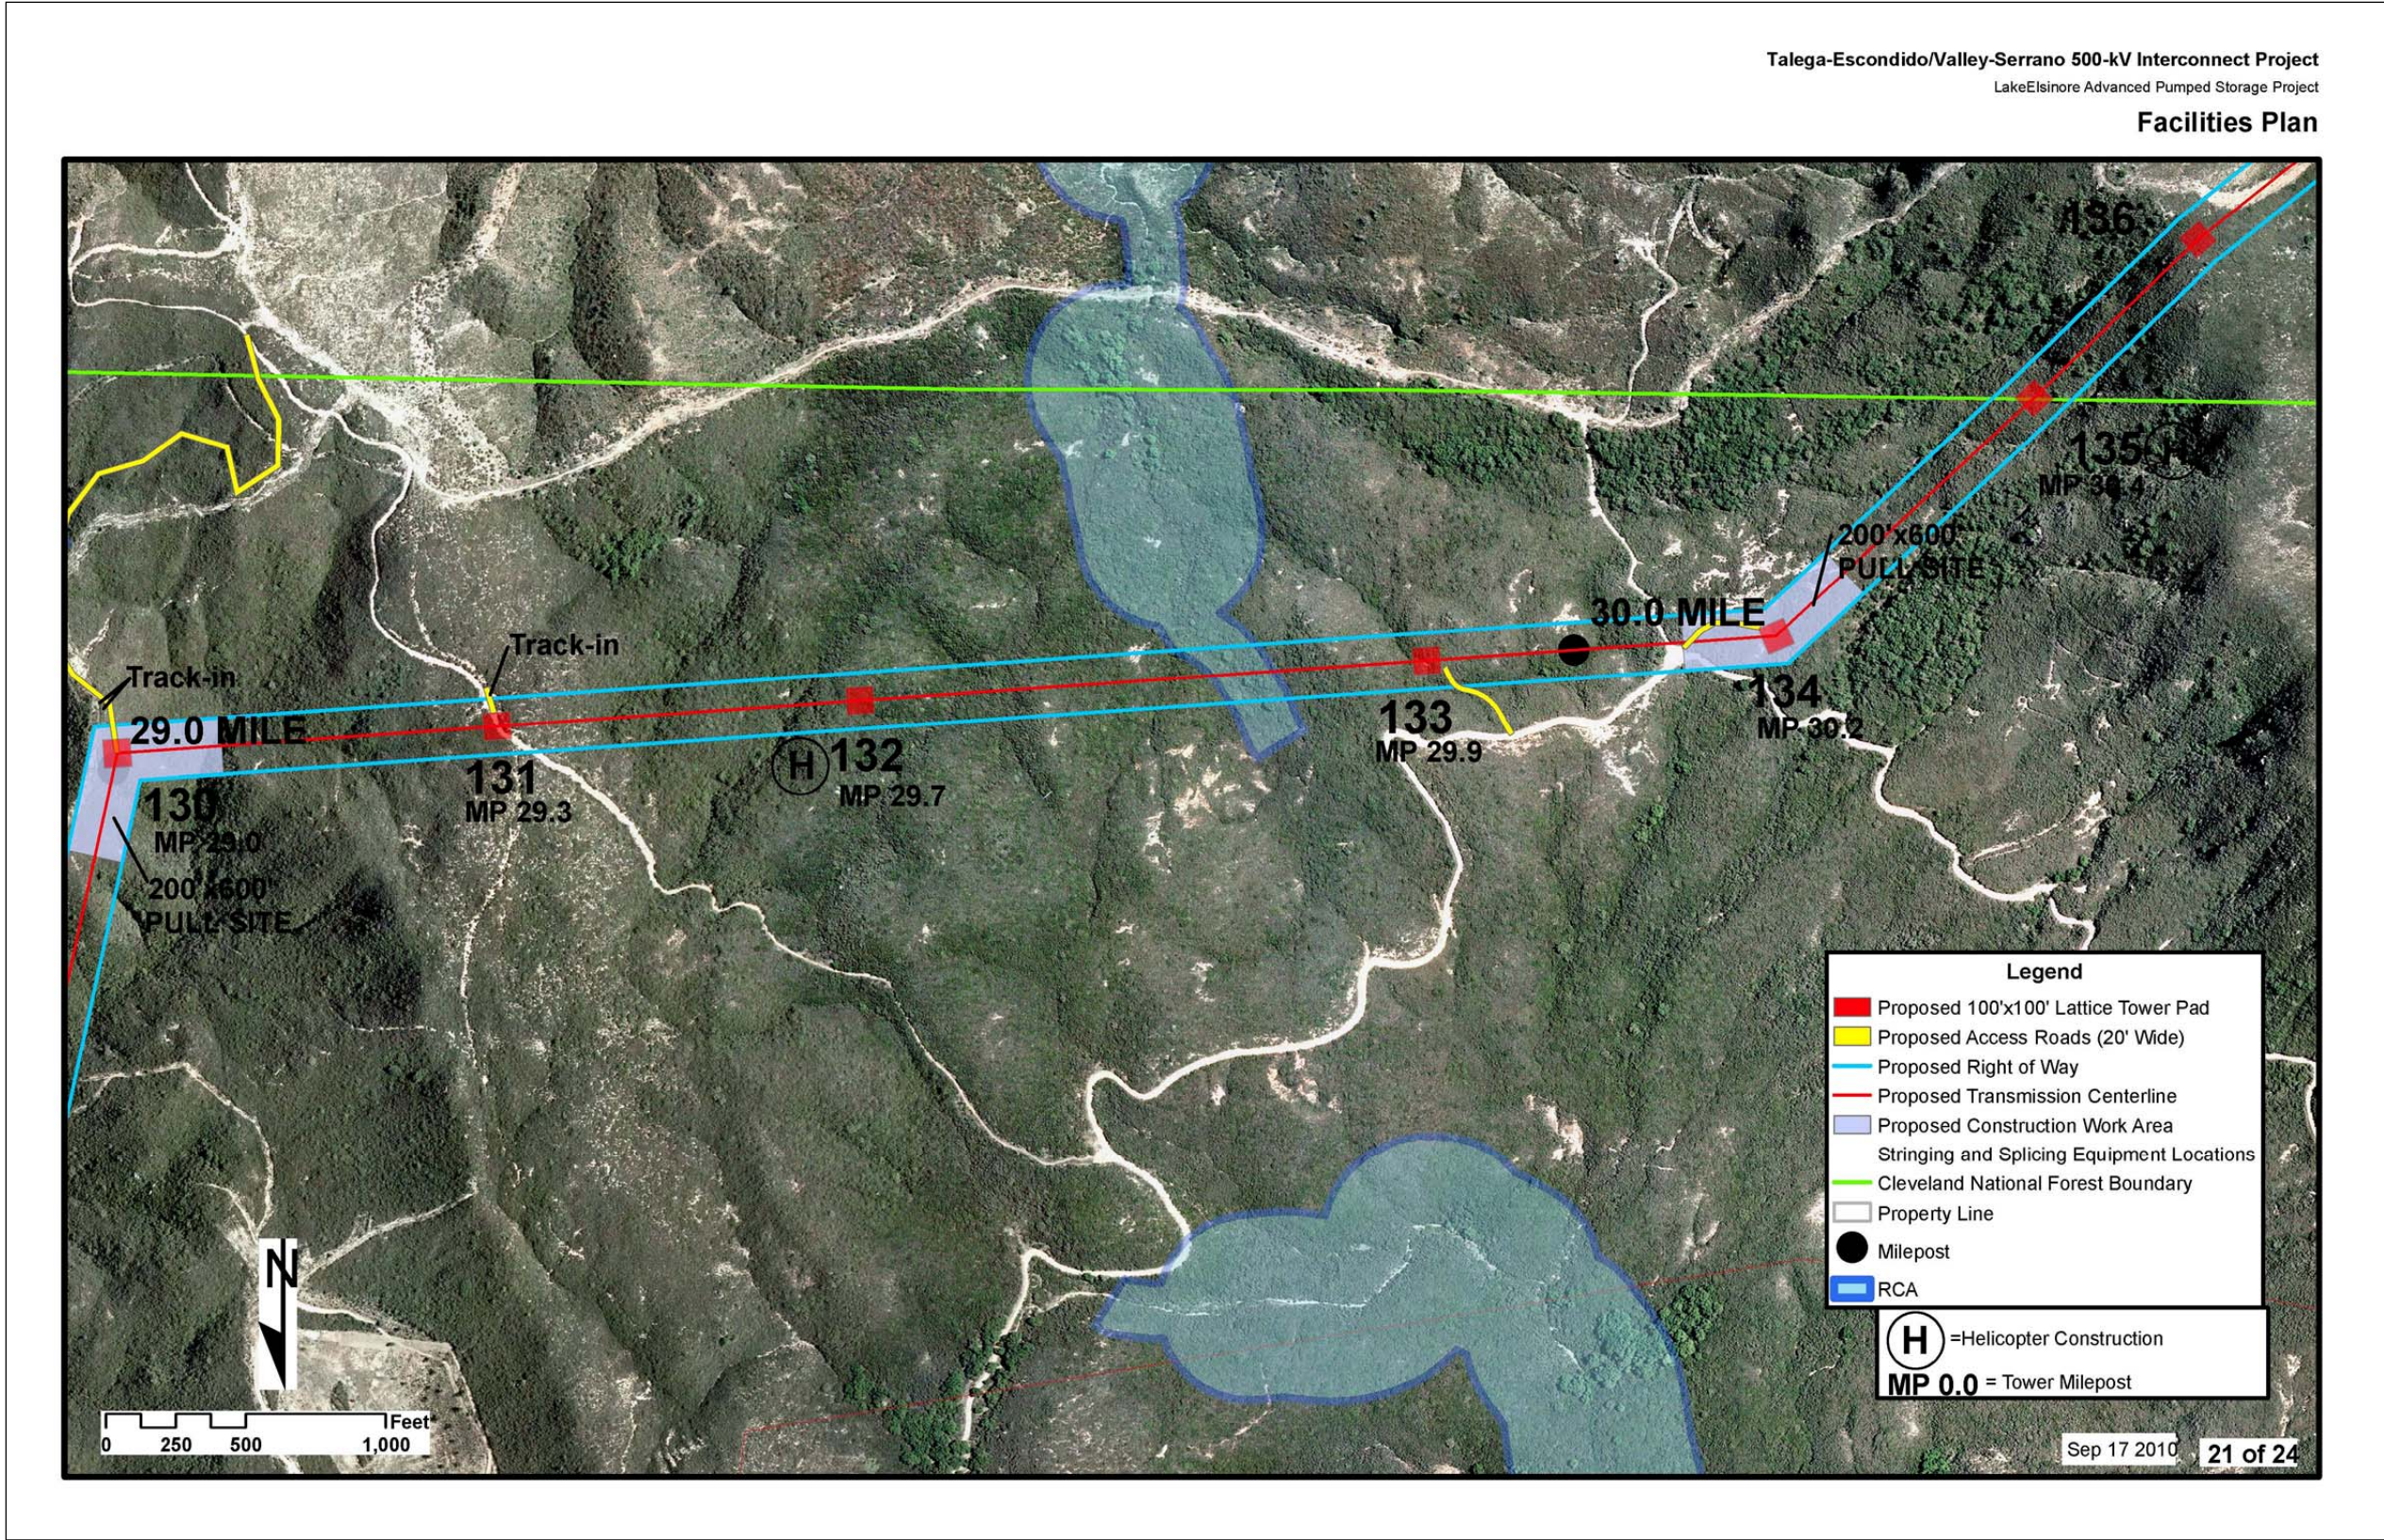


Figure 3.1.1-4: (21 of 24) Talega-Escondido/Valley-Serrano 500 kV Interconnect Project

Source: The Nevada Hydro Company



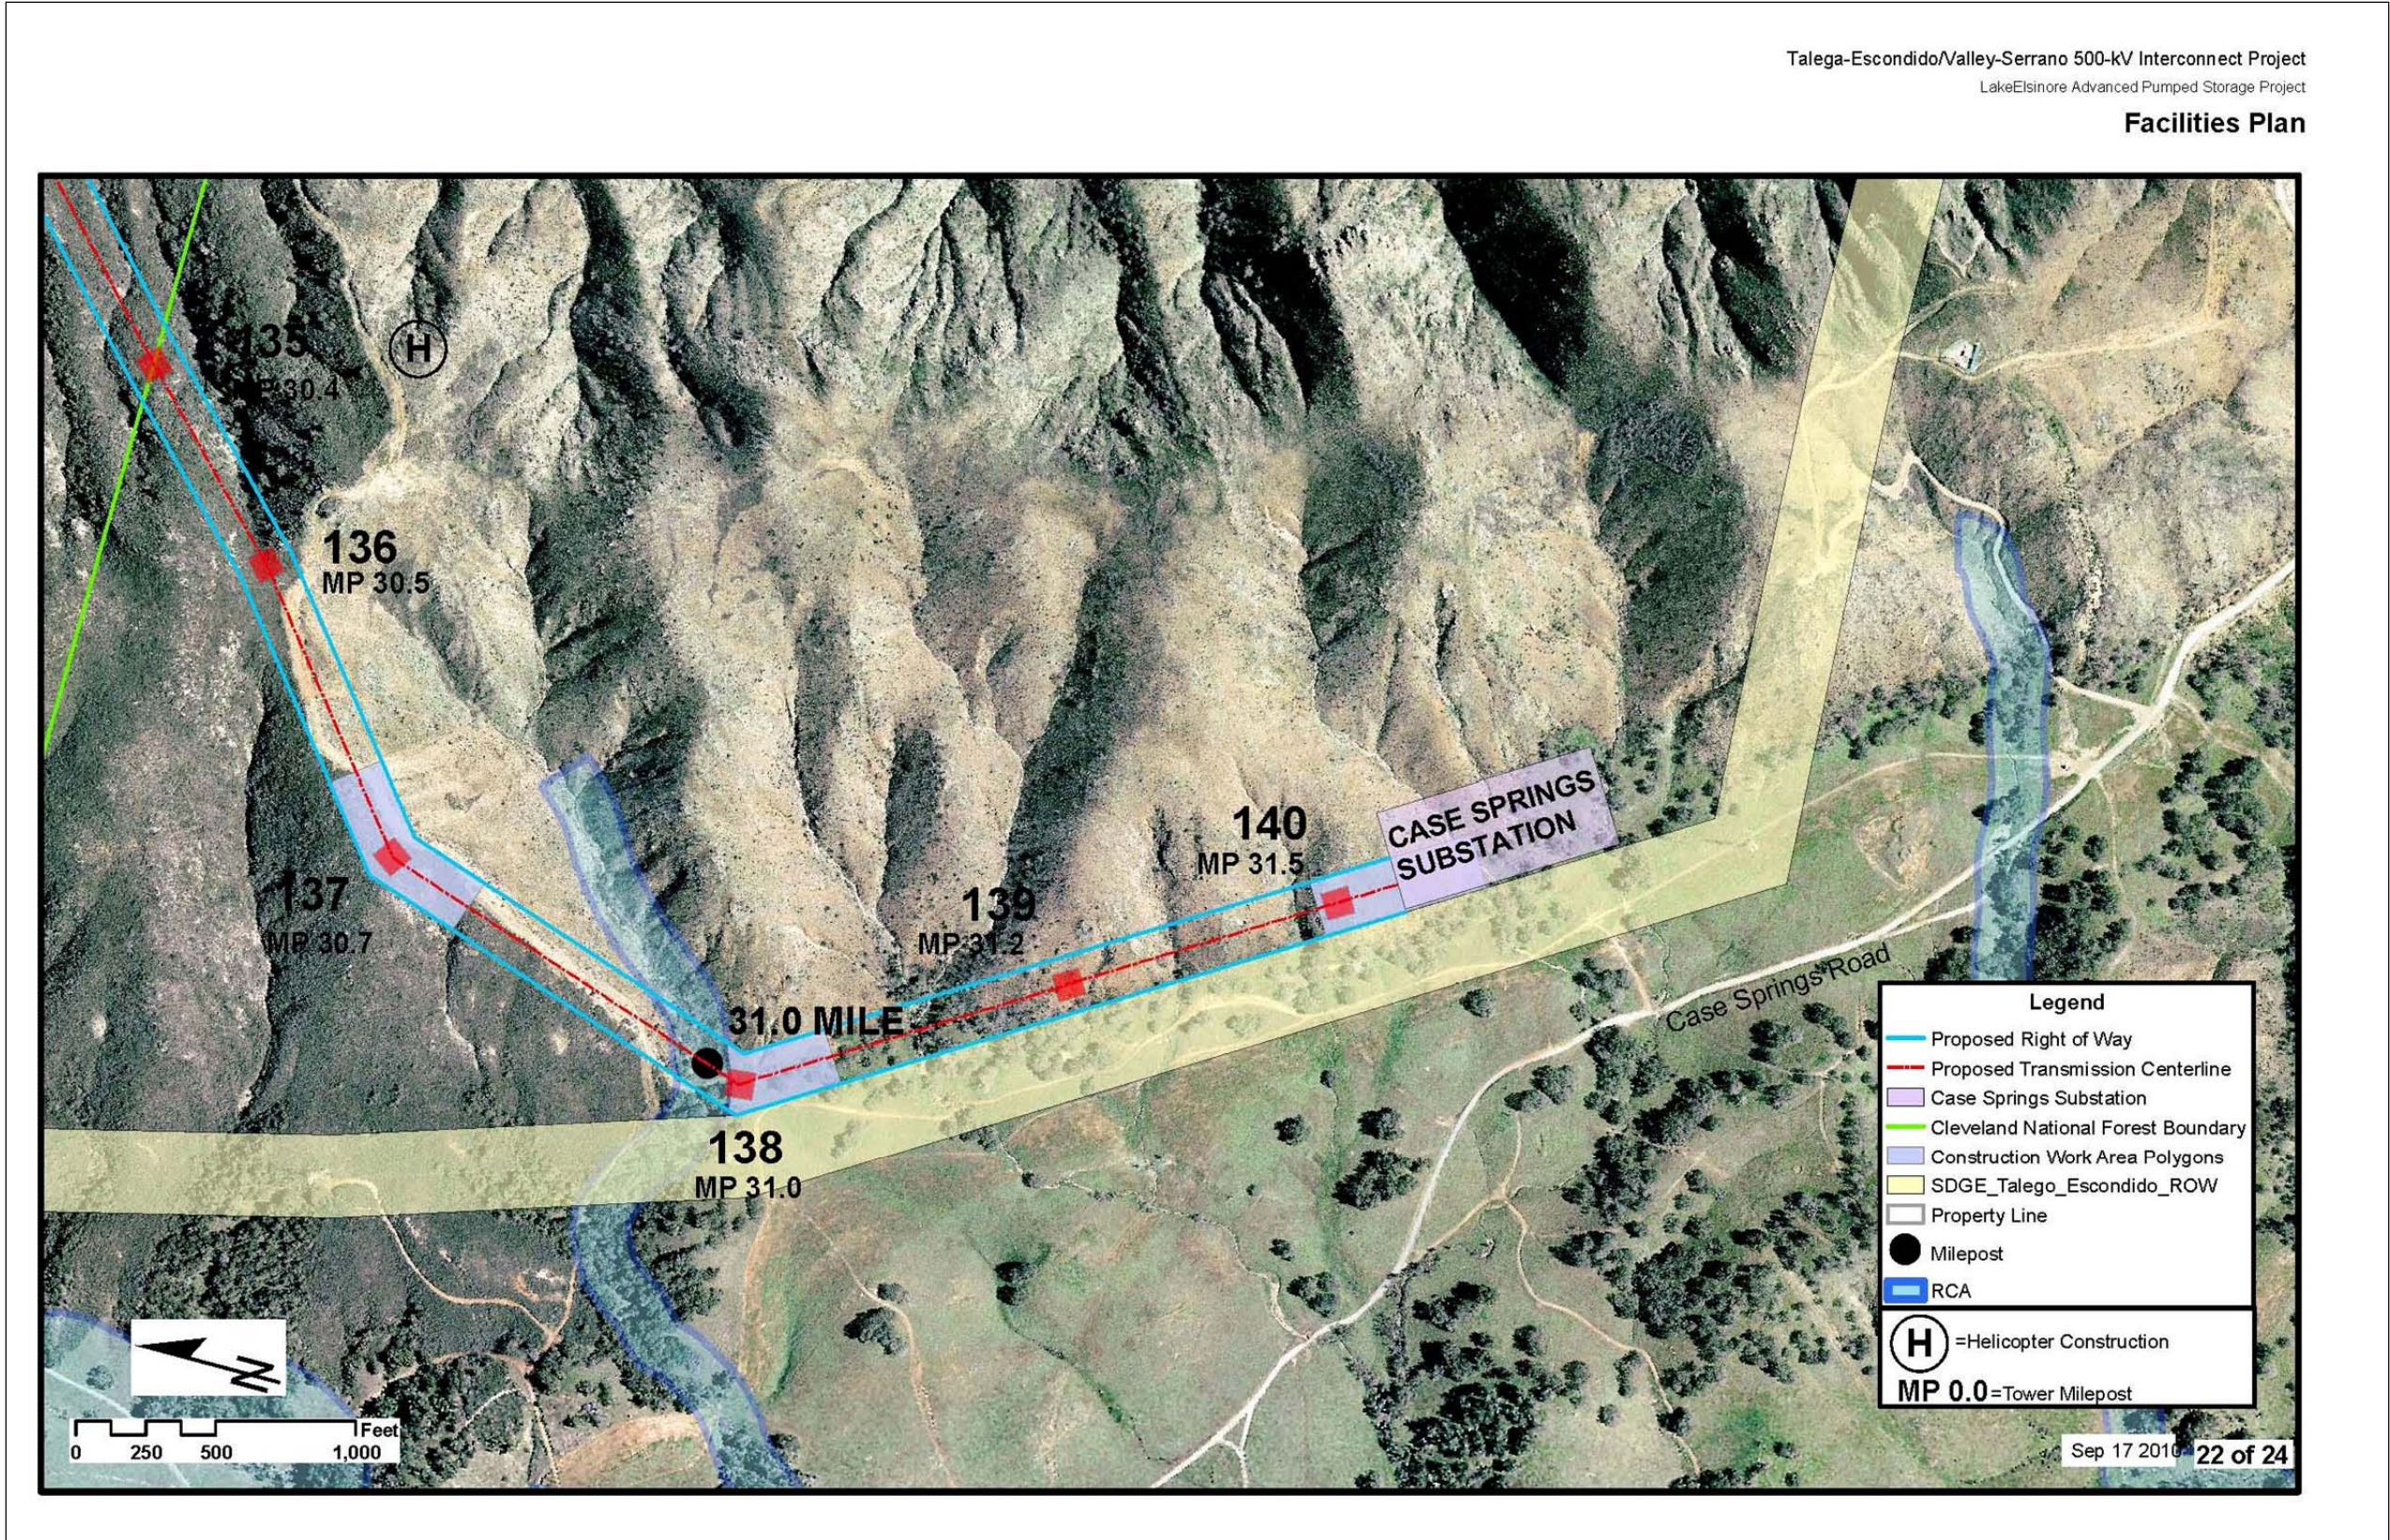


**Figure 3.1.1-4: (22 of 24) Talega-Escondido/Valley-Serrano 500 kV Interconnect Project**  
Source: The Nevada Hydro Company





**Figure 3.1.1-4: (23 of 24) Talega-Escondido/Valley-Serrano 500 kV Interconnect Project**  
Source: The Nevada Hydro Company



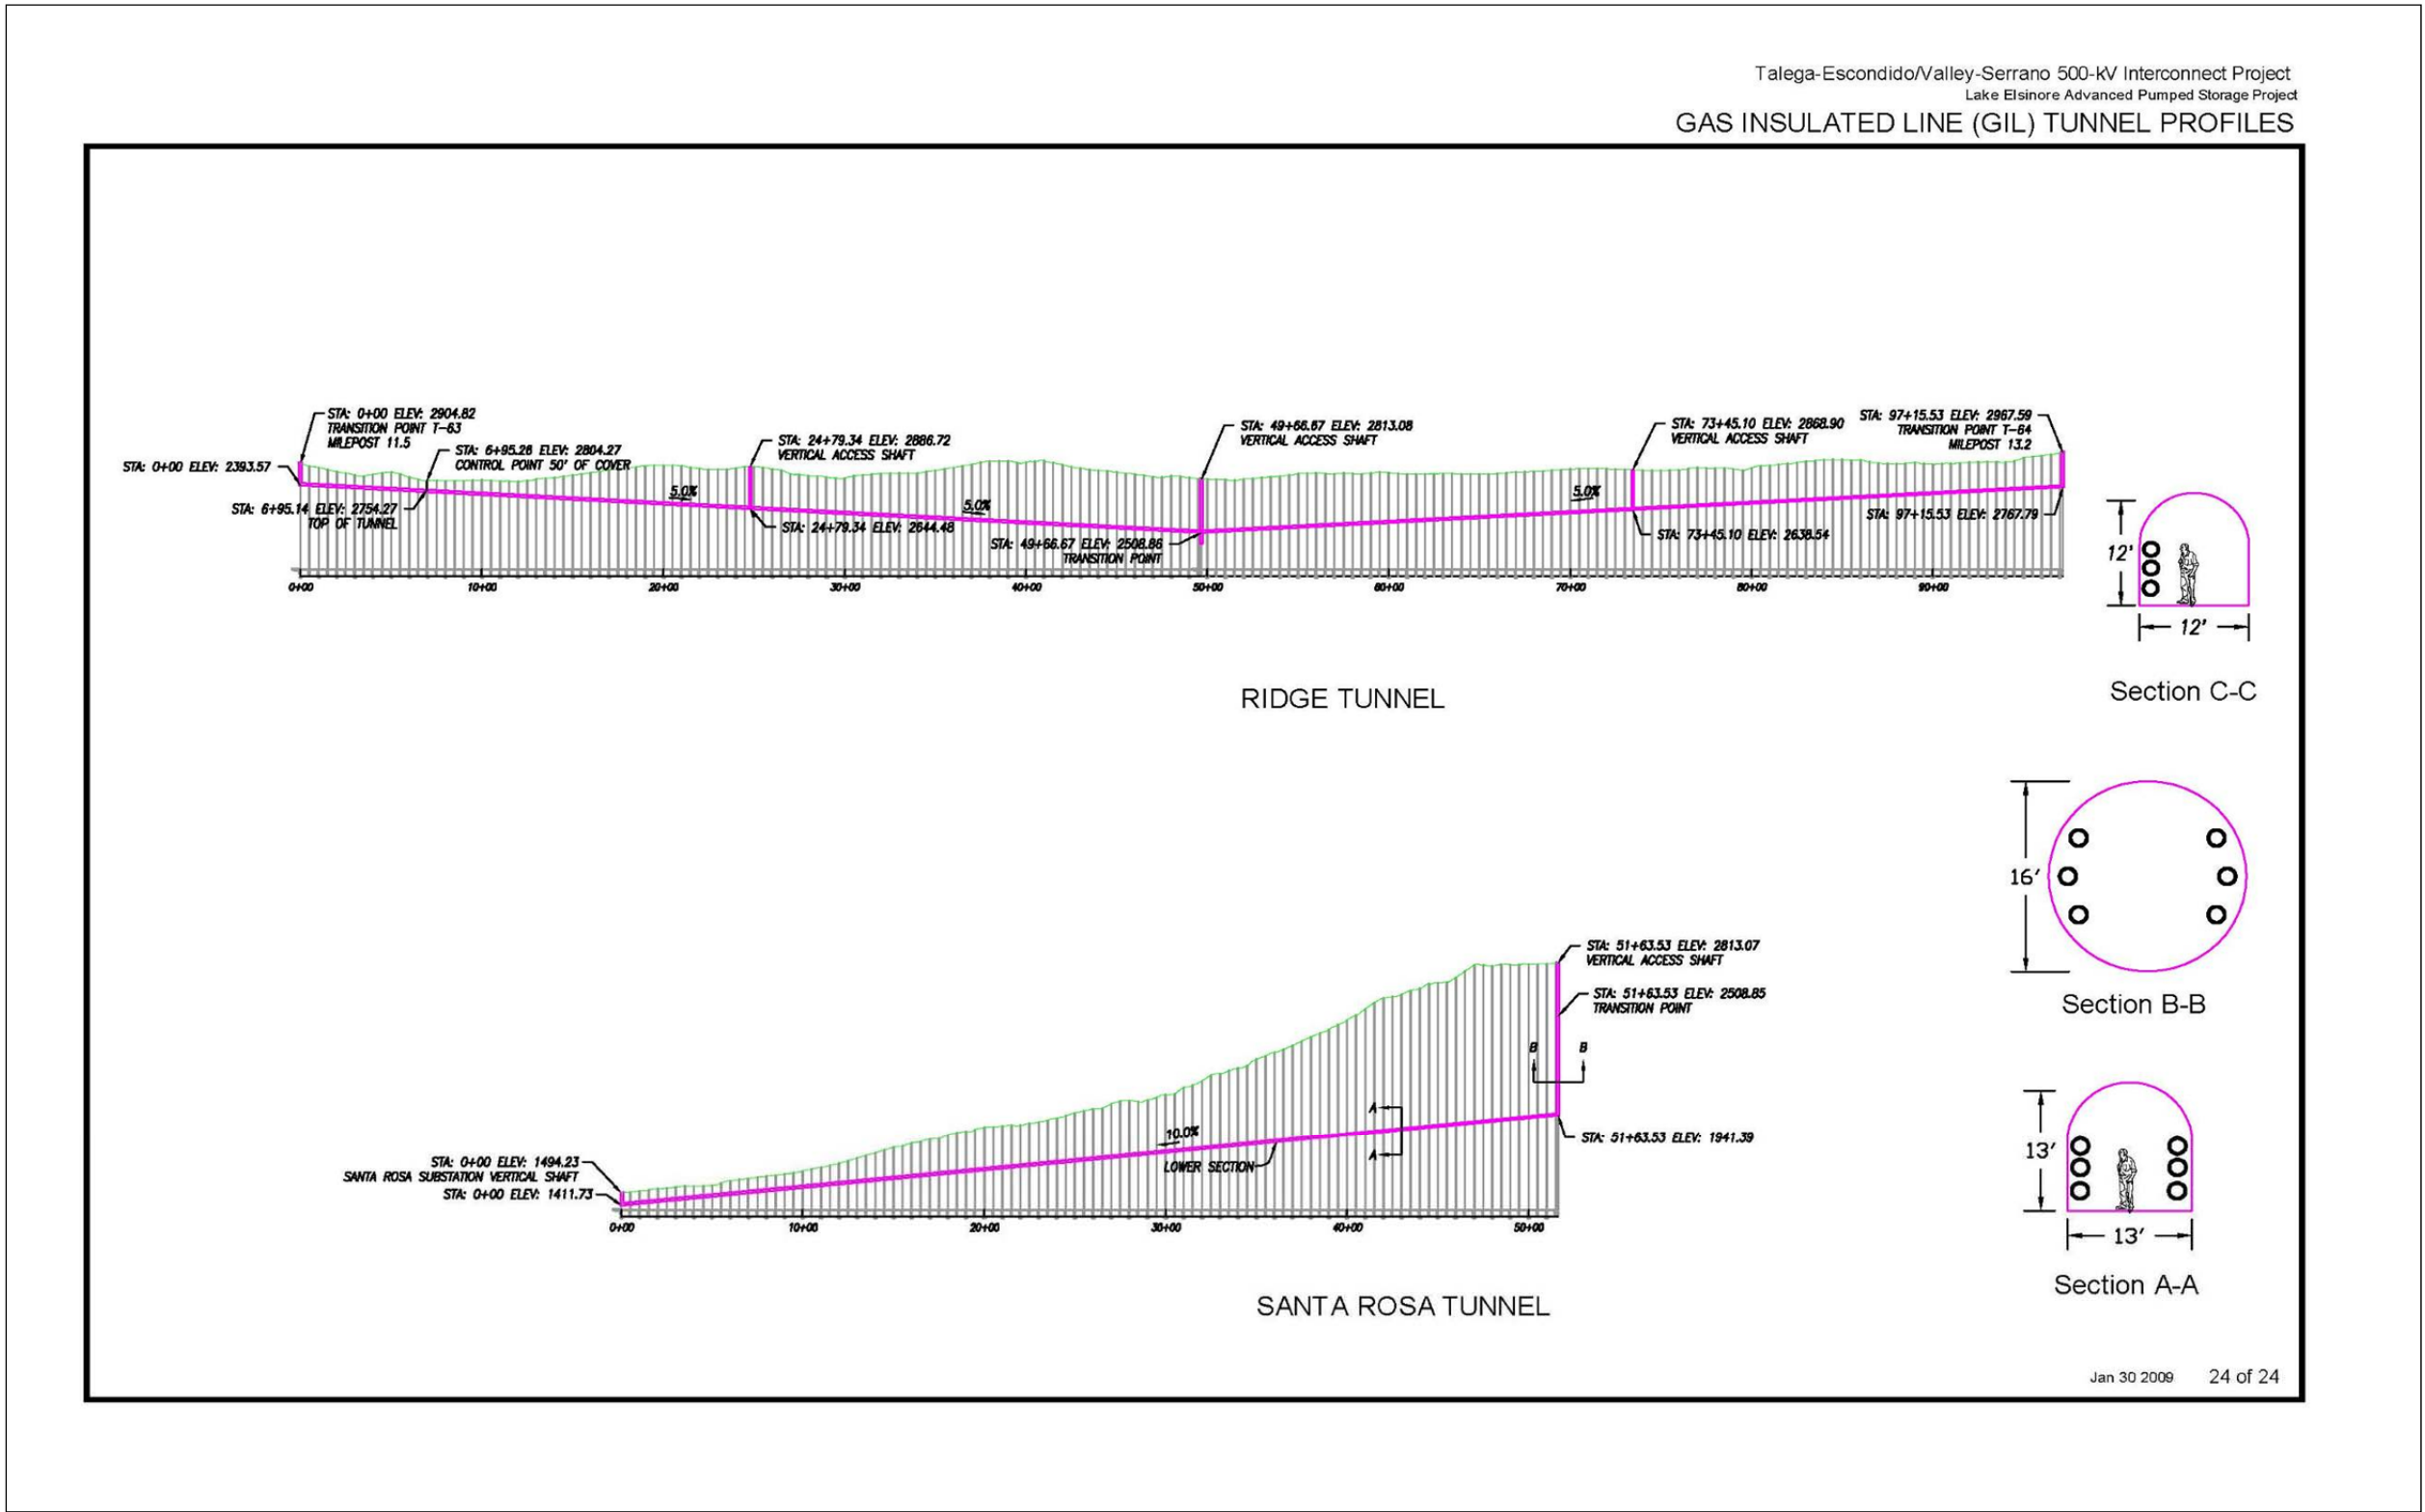

**Figure 3.1.1-4: (24 of 24) Talega-Escondido/Valley-Serrano 500 kV Interconnect Project**  
Source: The Nevada Hydro Company