
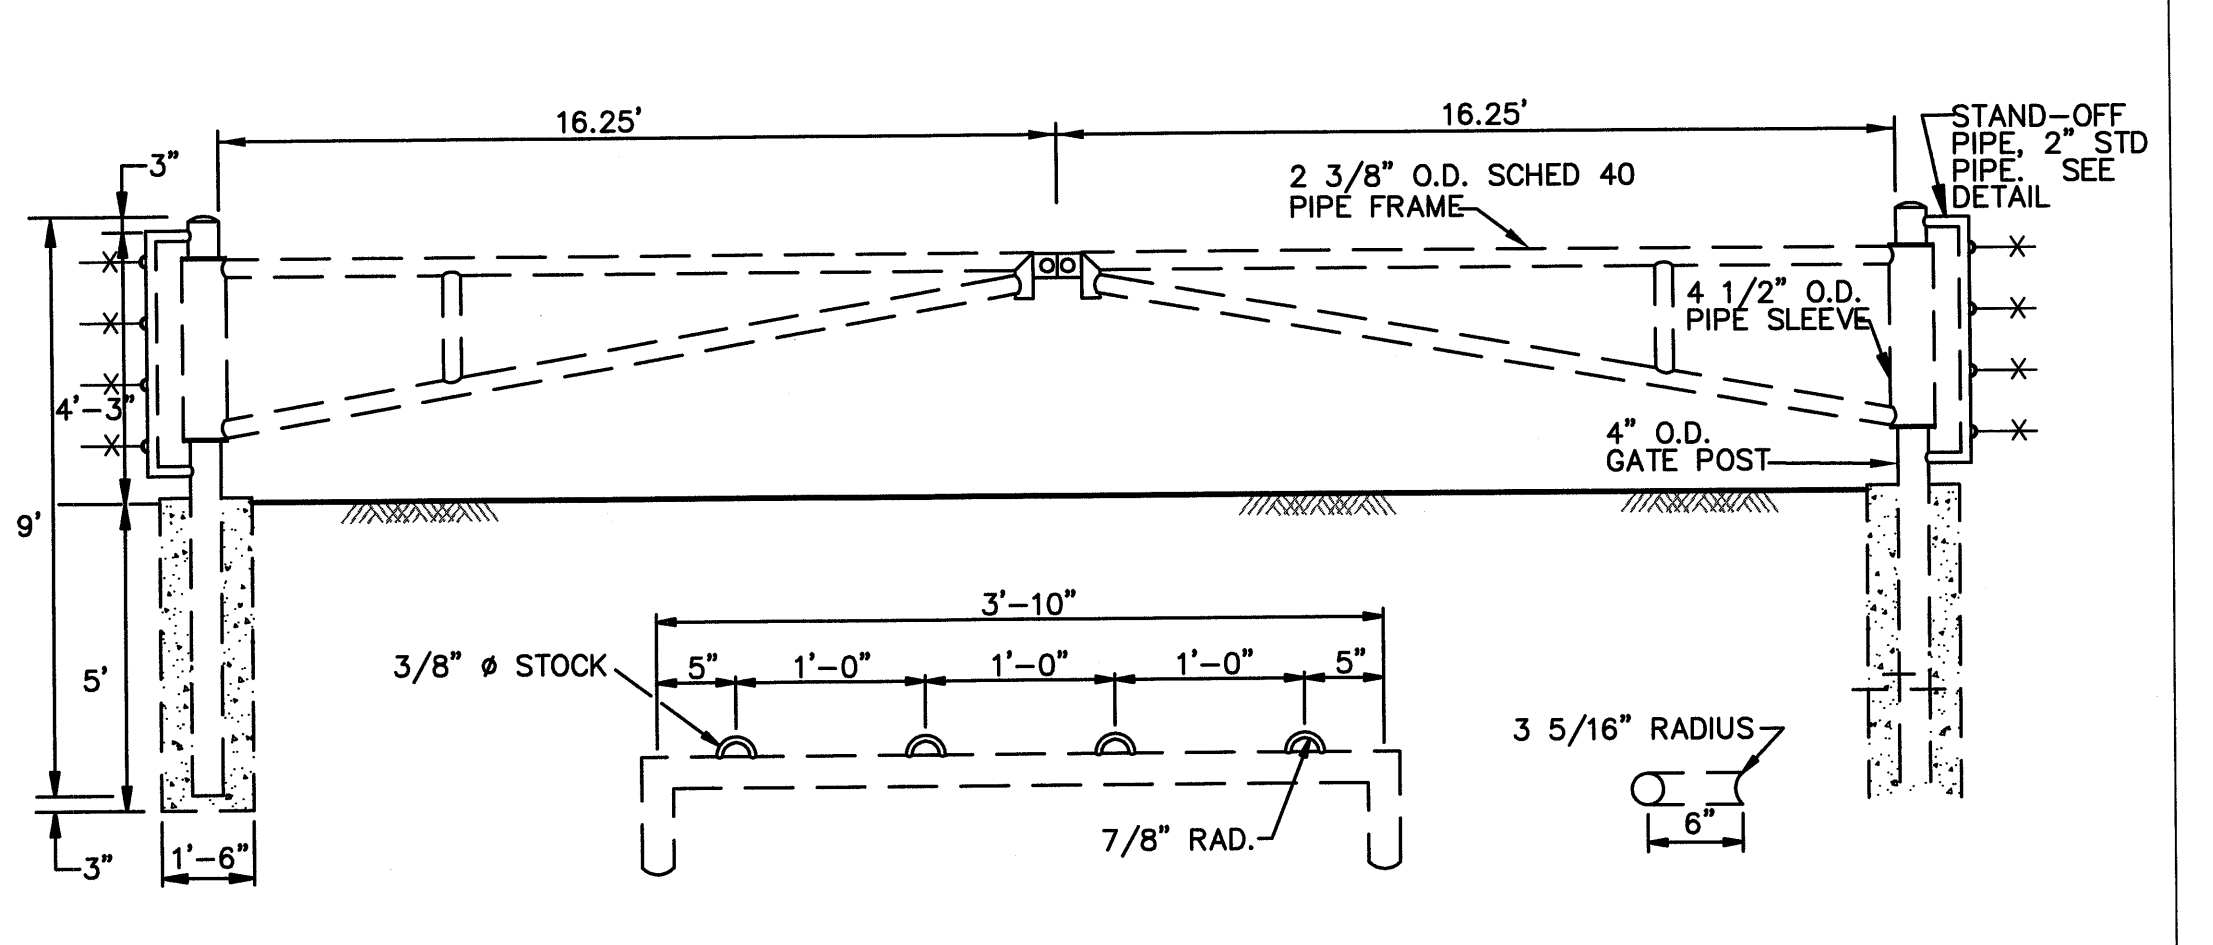


- NOTE:
- CUT SLOPES ARE 1:1 OR 1.5:1 WHERE SHOWN ON PLAN.
  - FILL SLOPE ARE 1.5:1 OR 2:1 WHERE SHOWN ON PLAN.

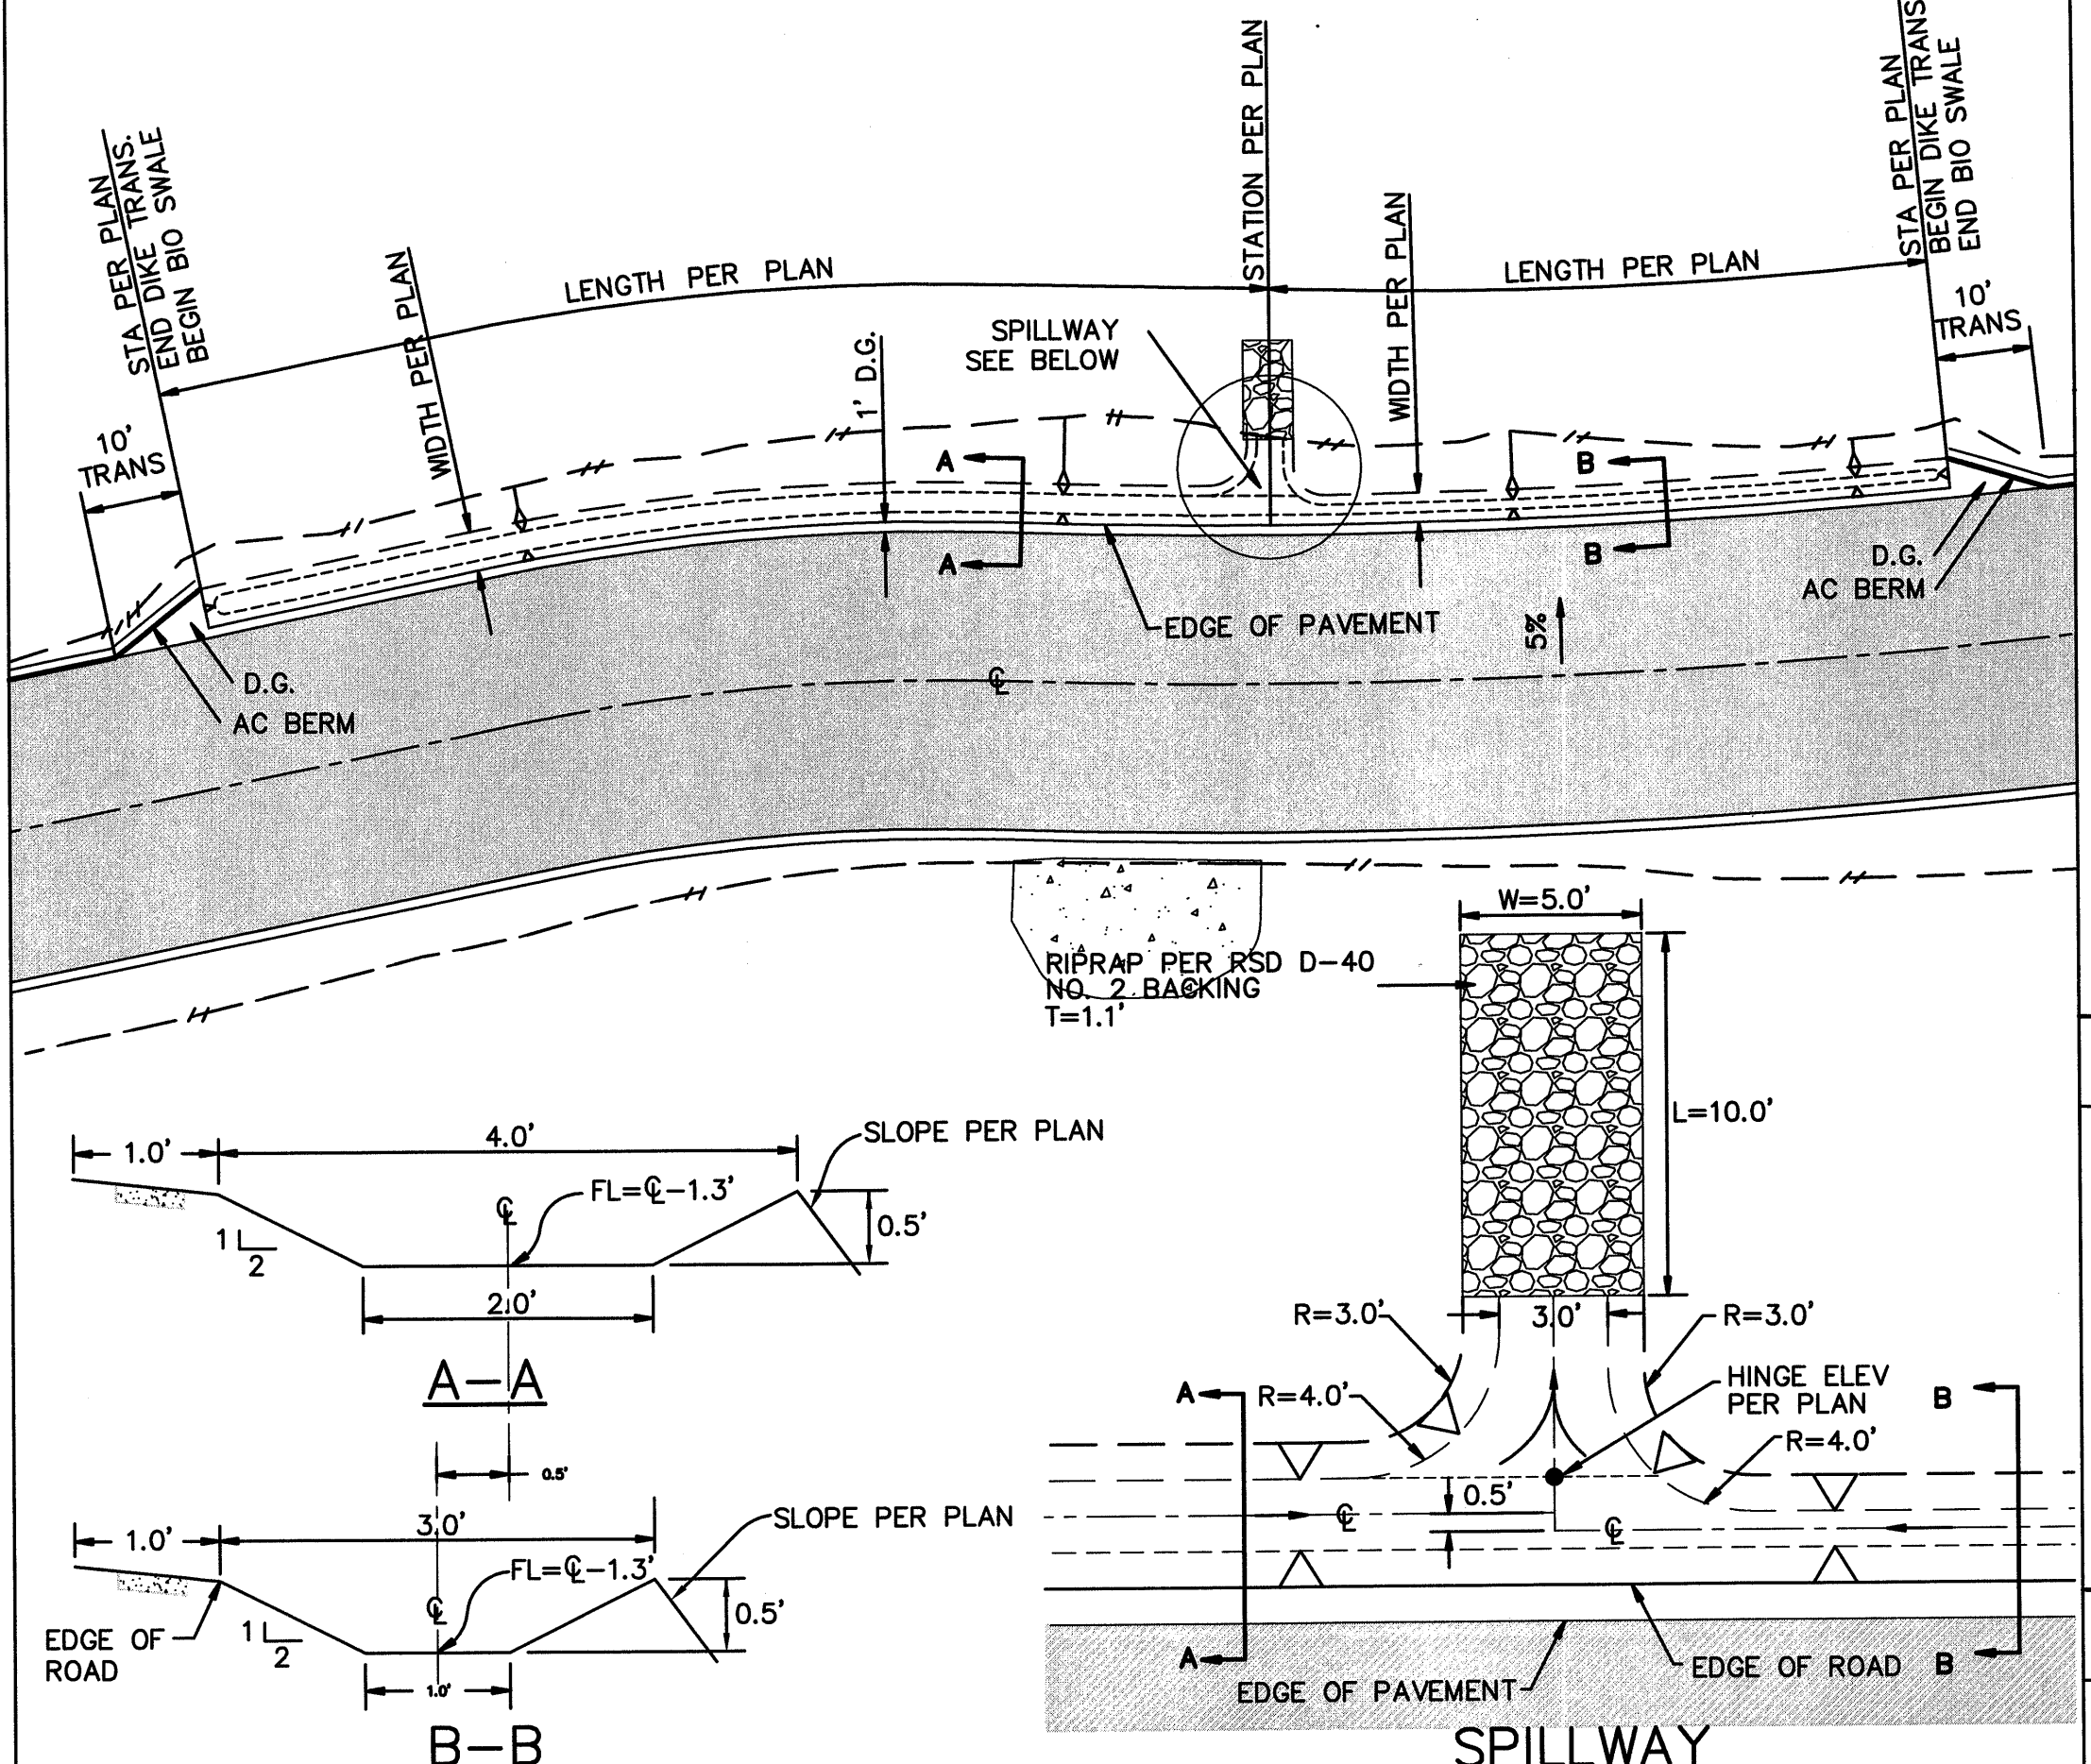

- NOTES
- LEFT AND RIGHT SIDE OF GATE ARE IDENTICAL.
  - FOOTINGS SHALL BE MINIMUM 3000 PSI CONCRETE.

**B AIR & VACUUM VALVE ENCLOSURE**


NO SCALE

**C WATER QUALITY BIO SWALE**

NO SCALE


**D PIPE SWING GATE**

NO SCALE

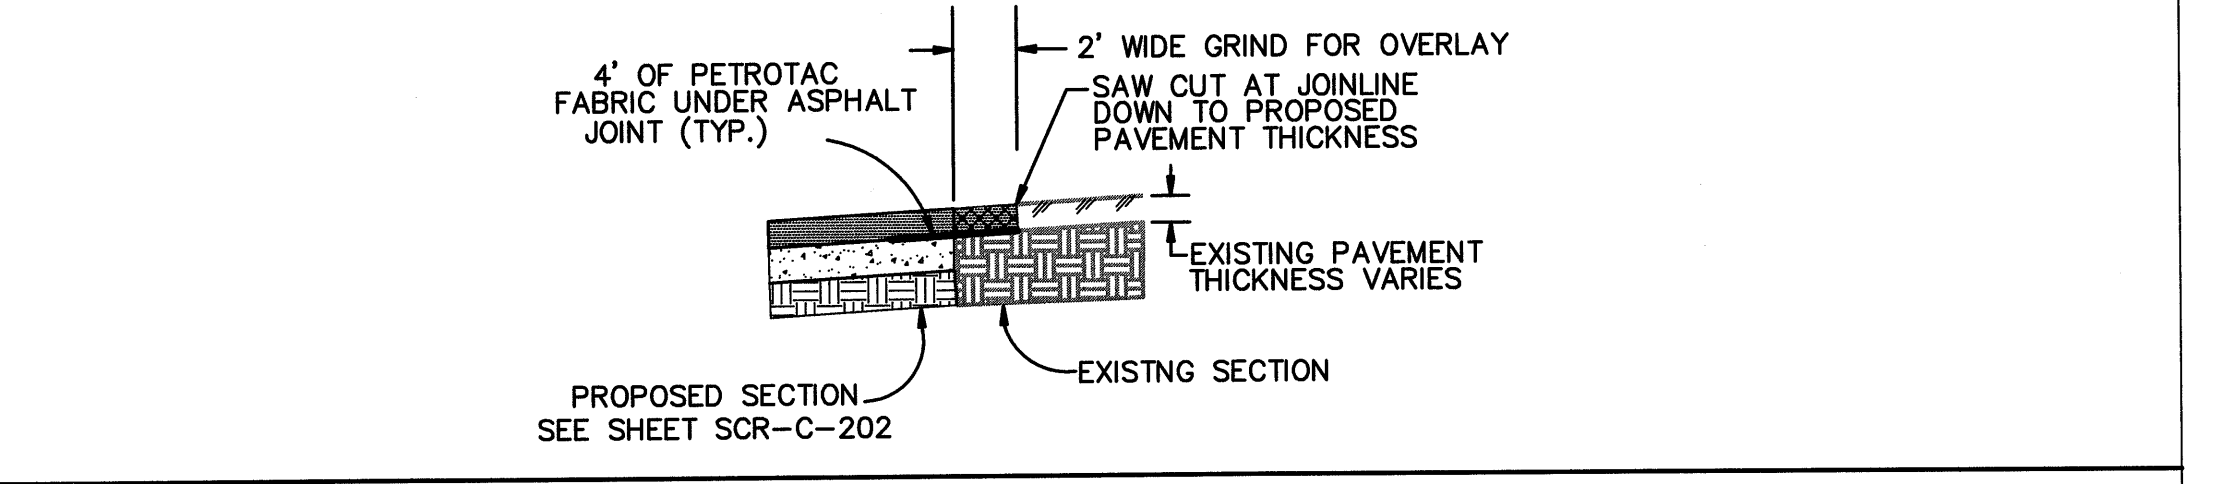

**G SAWCUT AND JOIN DETAIL**

NO SCALE

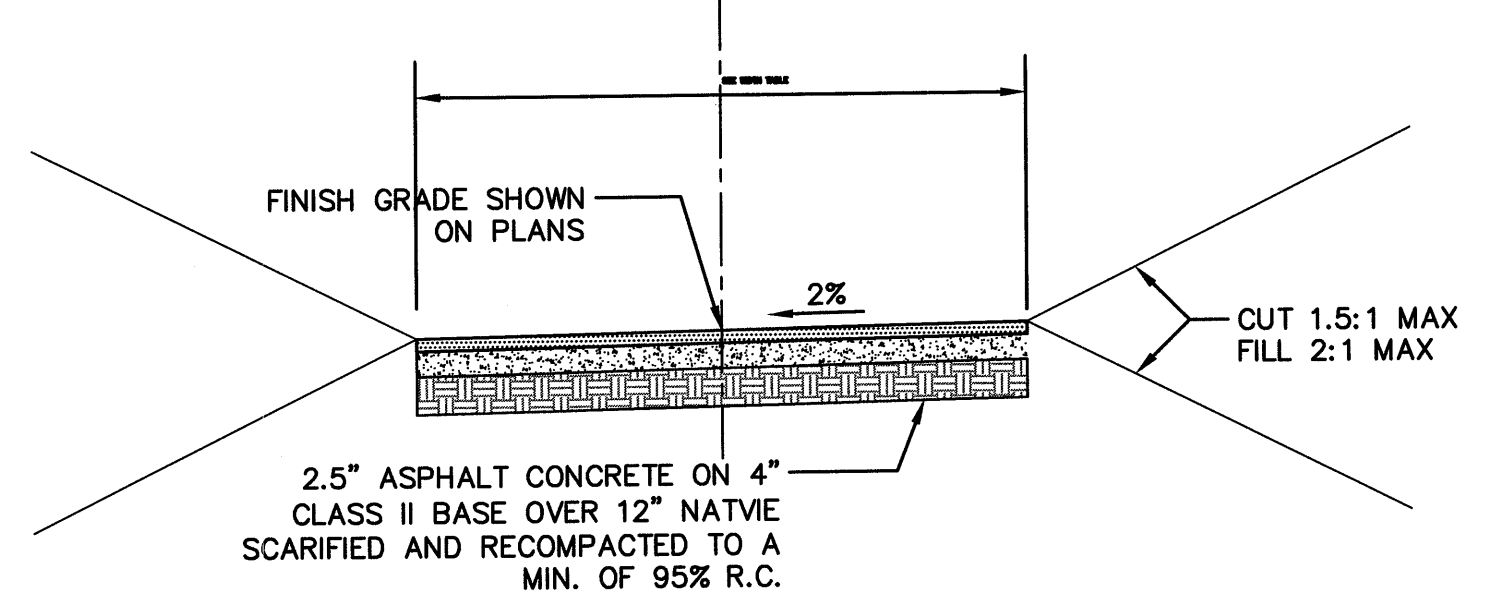

DRIVEWAY TABLE  
DRIVEWAY SLOPES LEFT

DWY No.	WIDTH	SHEETS
1	9.00'	6 & 29
2	13.60'	9 & 29
3	12.00'	10 & 30
4	9.00'	10 & 30
5	9.00'	14 & 30
6	12.00'	22 & 30


DRIVEWAY SLOPES RIGHT

7	9.00'	24 & 30
---	-------	---------

**DRIVEWAY SECTION**


NO SCALE

- DRIVEWAY NOTE:
- BEGIN DRIVEWAY STRUCTURAL SECTION 15 FEET OFFSET FROM CENTERLINE WHERE SHOWN ON PLAN.
  - USE 6-INCH DECOMPOSED GRANITE DRIVEWAY WHERE SHOWN ON THE PLAN.

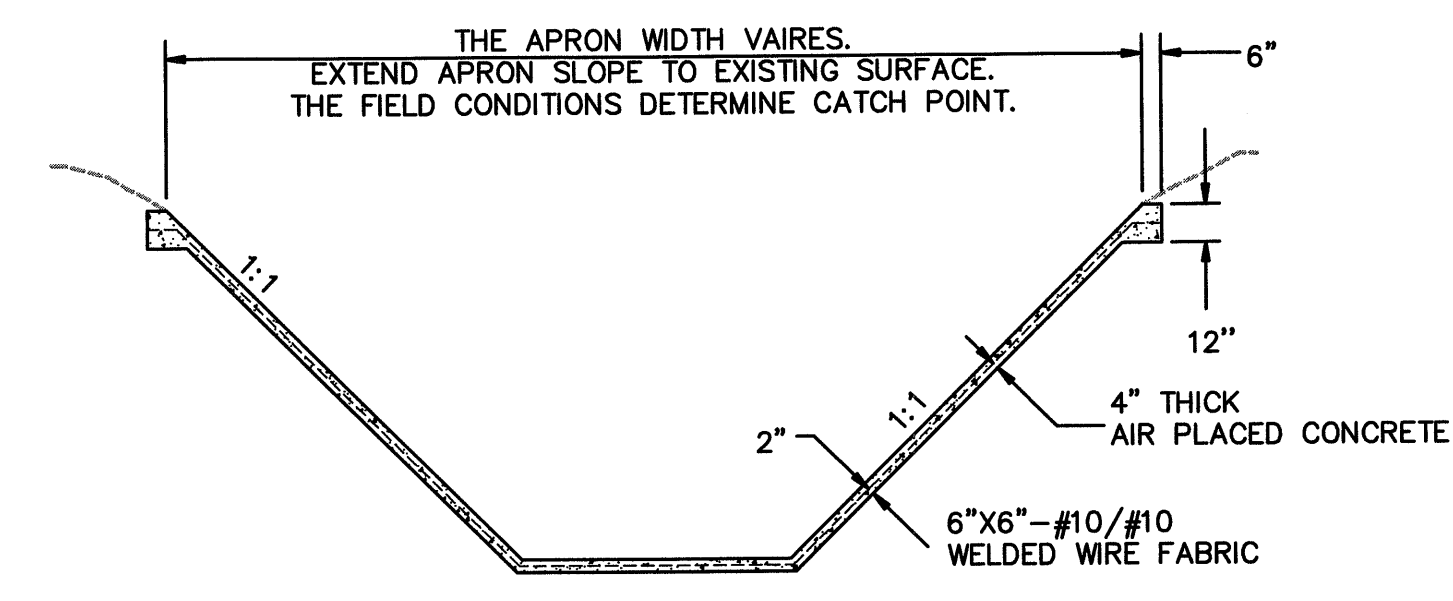


**SECTION C: ACROSS 1:1 SLOPE APRON**


THE BROW DITCH IS LOCATED AT THE TOP OF ROAD SLOPE AND TRANSITIONS TO THE INLET APRON WITH NO GAPS.

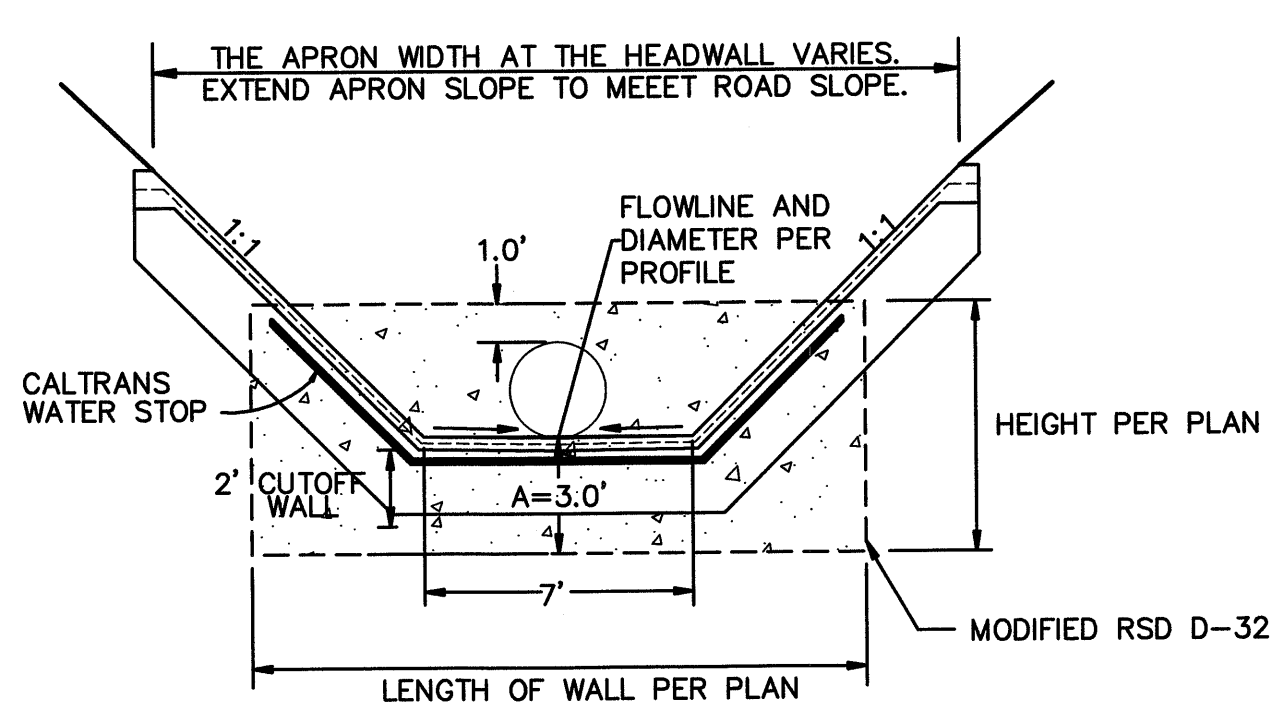

**SECTION D: WALL MEETS APRON**

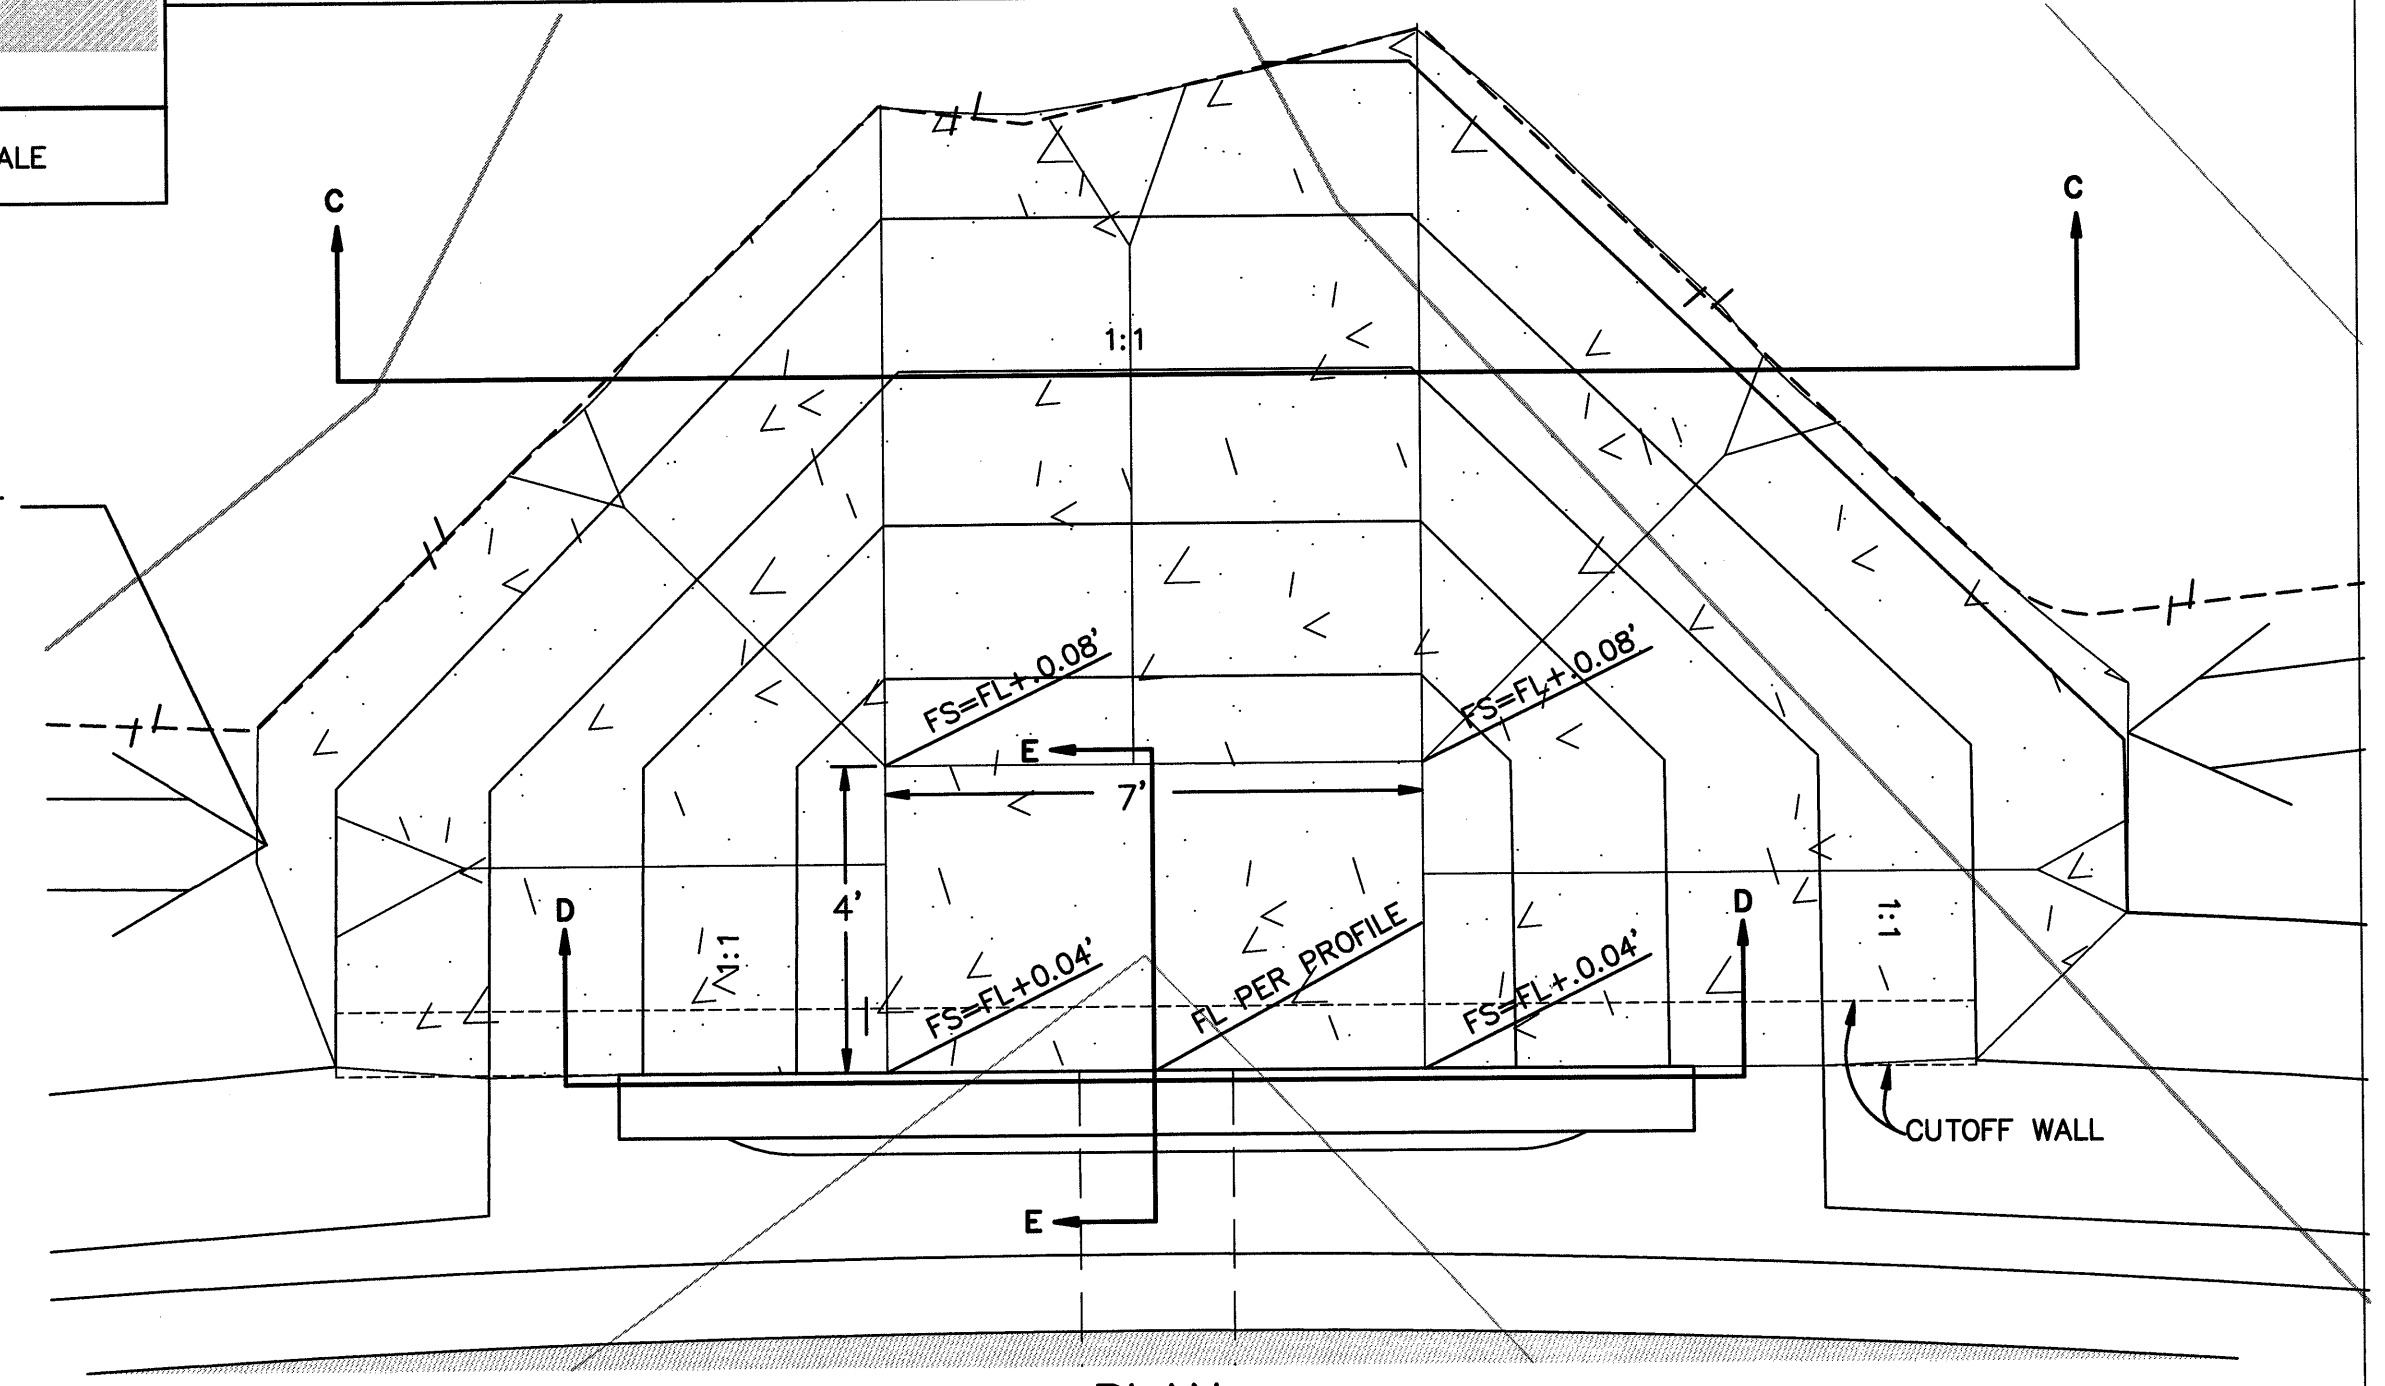

**PLAN**

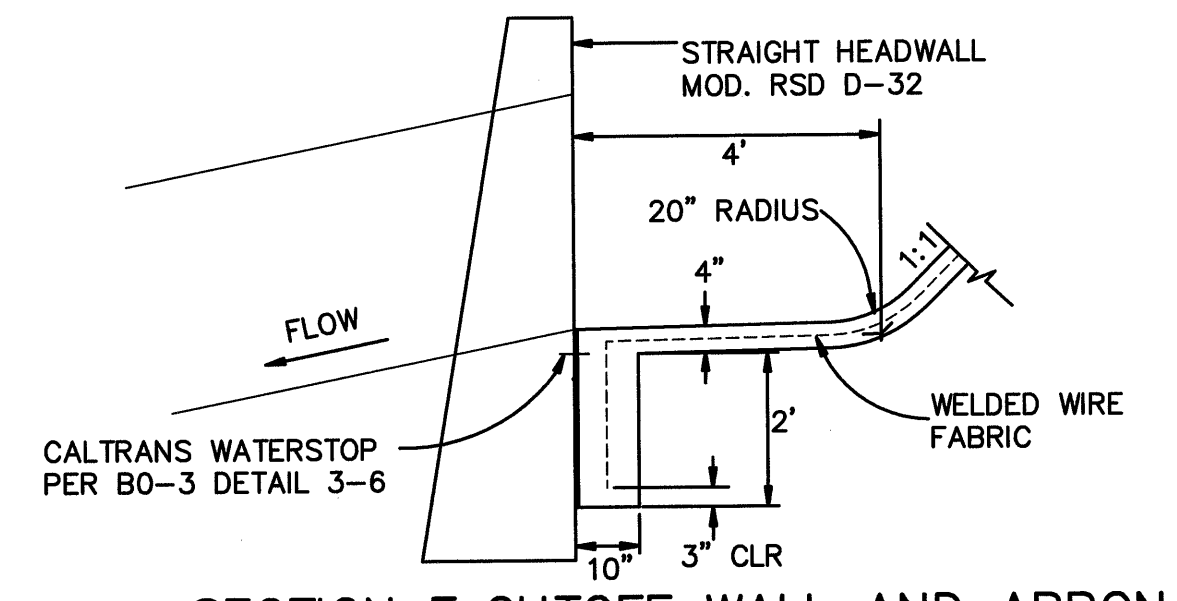

**SECTION E: CUTOFF WALL AND APRON**



**E DECOMPOSED GRANITE DRIVEWAY SECTION**

**F CONCRETE INLET APRON**

NO SCALE

REVISIONS

NO.	WORK DONE	DATE:	BY:	APP'D:	NO.	WORK DONE	DATE:	BY:	APP'D:	NO.	WORK DONE	DATE:	BY:	APP'D:	NO.	WORK DONE	DATE:	BY:	APP'D:	NO.	

SAN DIEGO GAS & ELECTRIC COMPANY  
SAN DIEGO, CALIFORNIA

**SUNCREST SUBSTATION ACCESS ROAD**

DETAILS

DRAWN BY: DHT	DATE: 3/24/10	SCALE: 1"=20'	W.O.:	REV: 0
CHECKED BY: PJC	DATE: -			
APPROVED BY: CR	DATE: -	SHEET 4 OF 45		
CAD NO.: IPPVT04	PLOT SCALE: 1=1			

**SCR-C-204**

3/26/10

K:\S03039600\CADD\USFS\CIVIL\IP-PVT\IPPVT04

