

SOURCE: Southern California Edison 2006 and MHA Environmental Consulting 2007

LEGEND

- Proposed Route: Segment Built Along Existing Distribution Lines
- Proposed Route: Segment Built on New Infrastructure
- Proposed Route: Segment Built Along 500 kV ROW
- Alternative Route Segment
- Interstate Highway
- State Route
- Existing Substation
- City Boundary

0 0.125 0.25 0.5 0.75 Miles

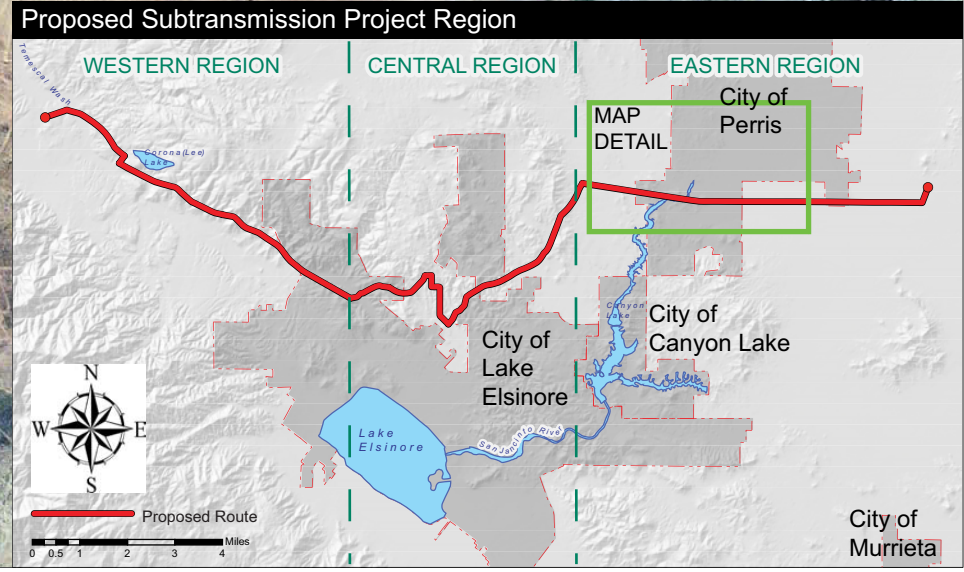


Figure C.2-4
Proposed Subtransmission and Alternative Route Segments