


Legend

- Existing
- Proposed

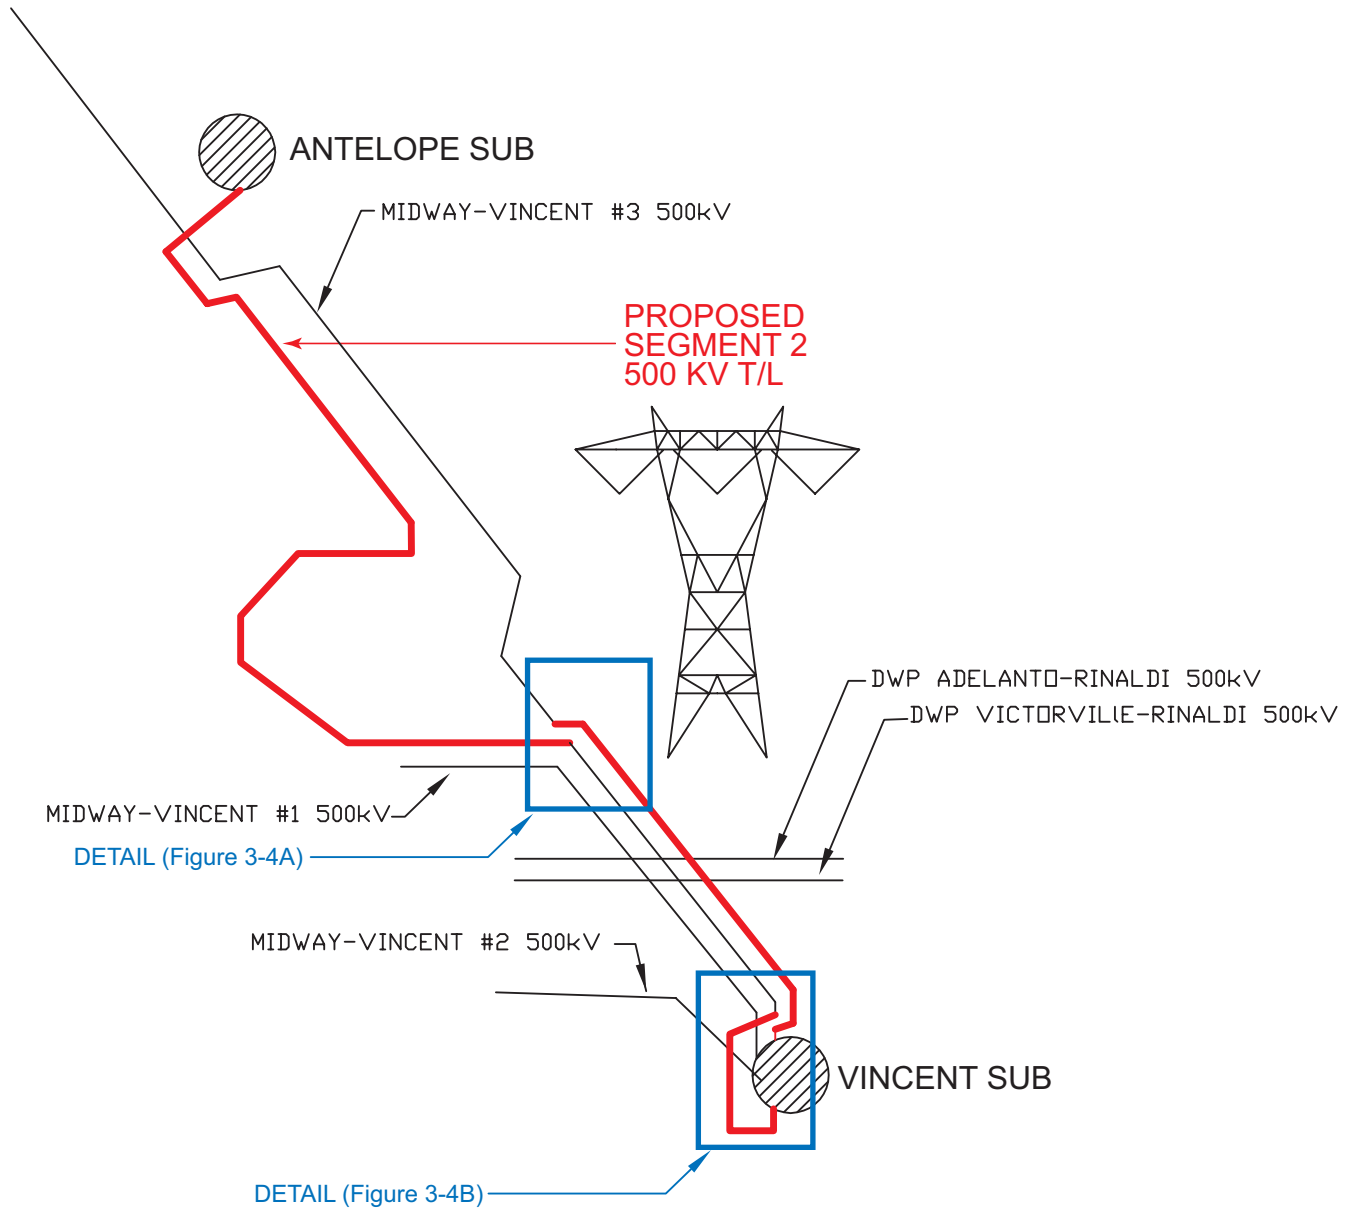

Note:

Refer to Figures 3-4A and 3-4B for detail of T/L cut-over at Anaverde and line crossings and configuration of T/Ls near Vincent Substation, respectively.