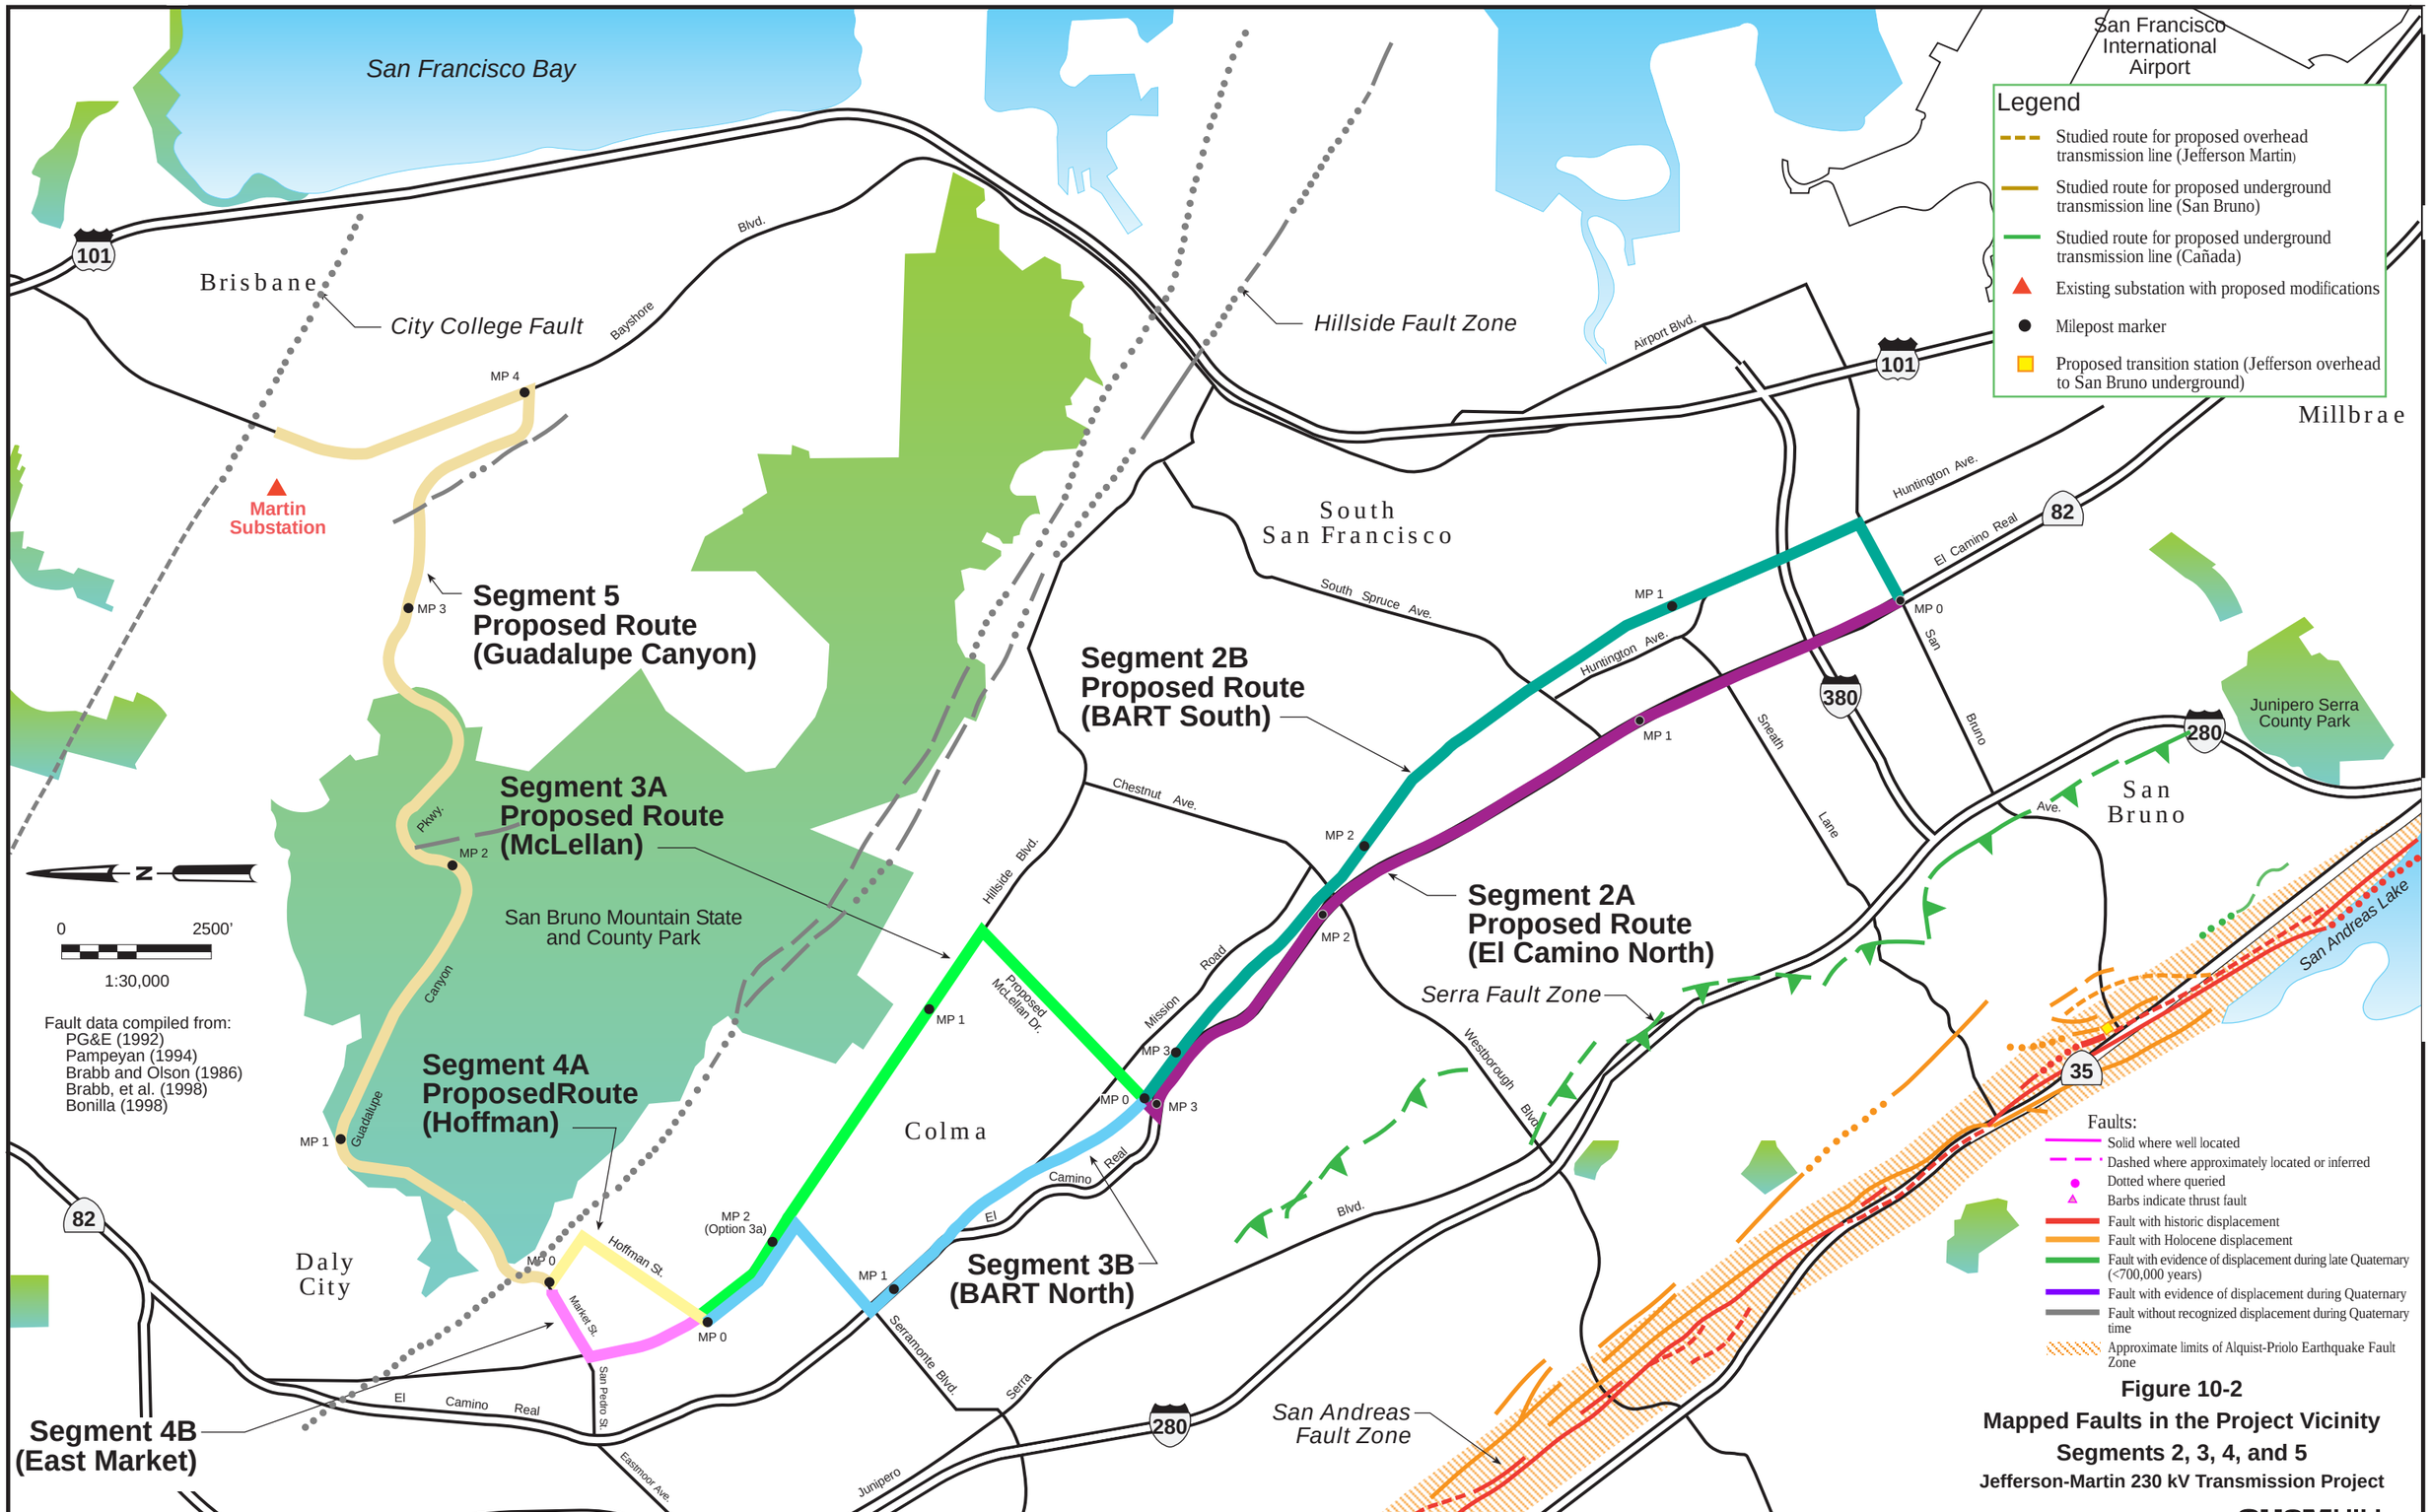

Figure 10-2
Mapped Faults in the Project Vicinity
Segments 2, 3, 4, and 5
Jefferson-Martin 230 kV Transmission Project

CH2MHILL

172750.JM.GO •Base 30000 faults•9/25/02•ccc E52002001SFO