
RECON Map Locator

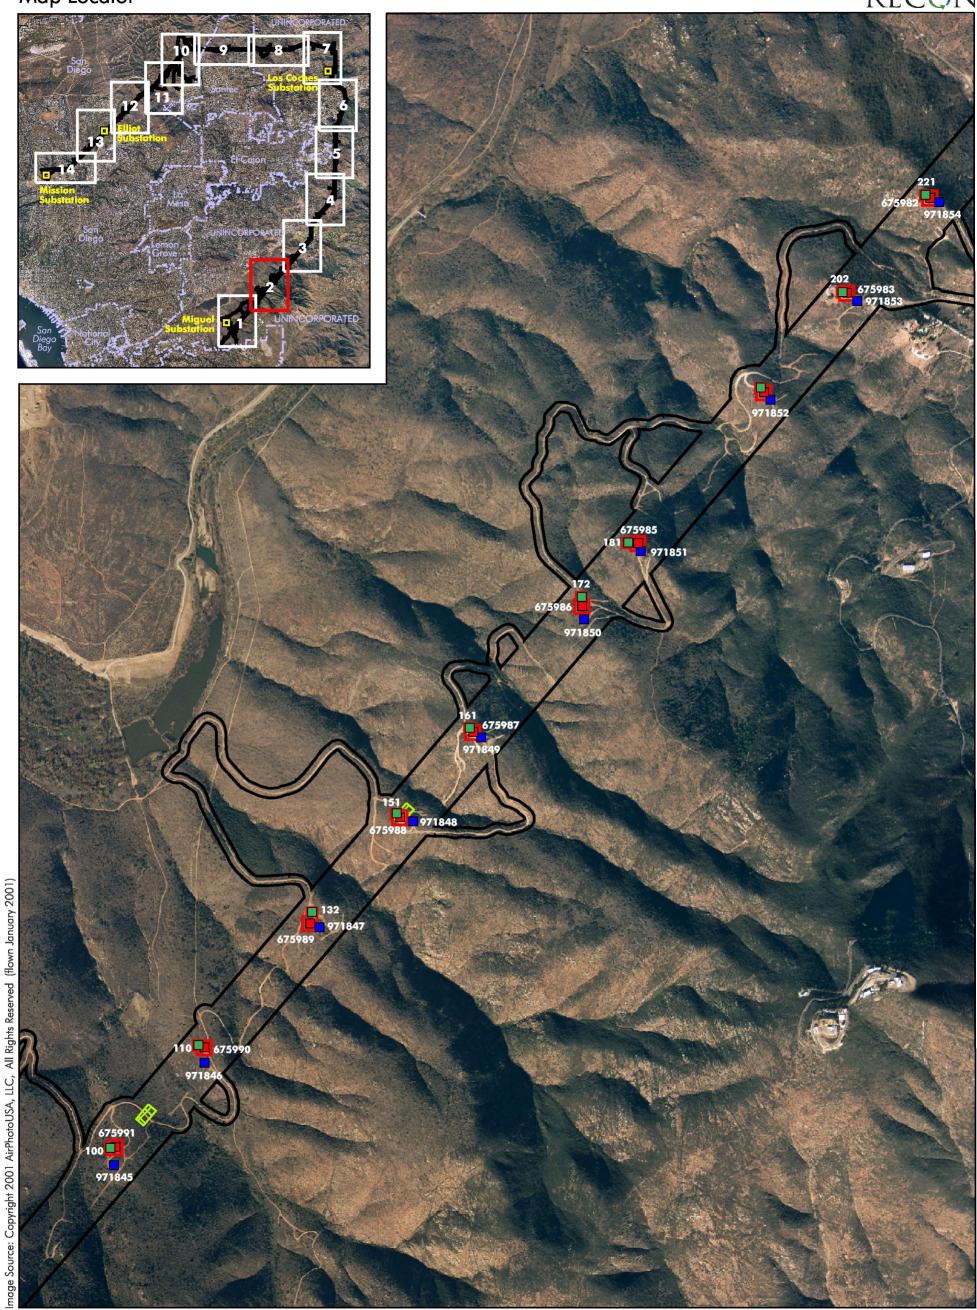

Existing 230kV lattice tower (Source: SDG&E May 20, 2003)

Existing 69/138kV lattice tower to be modified to 230 kV structure (Source: SDG&E May 20, 2003)

Proposed 69/138kV structure (Source: SDG&E May 8, 2003)

Impact areas around towers/structures

- 150' x 150' work area around existing towers to be modified to or replaced with 230 kV structures plus 100' x 100' work area around proposed 69/138kV structures

Stringing/snub site (Source: SDG&E May 8, 2003)

Survey area

FIGURE 1-2 Project Area Map 2

Feet

1000 N

SDG&E Miguel - Mission 230kV #2

