



**Figure 3.6.3-2: Talega-Escondido 230 kV Line Upgrade (Index)**  
 Source: The Nevada Hydro Company

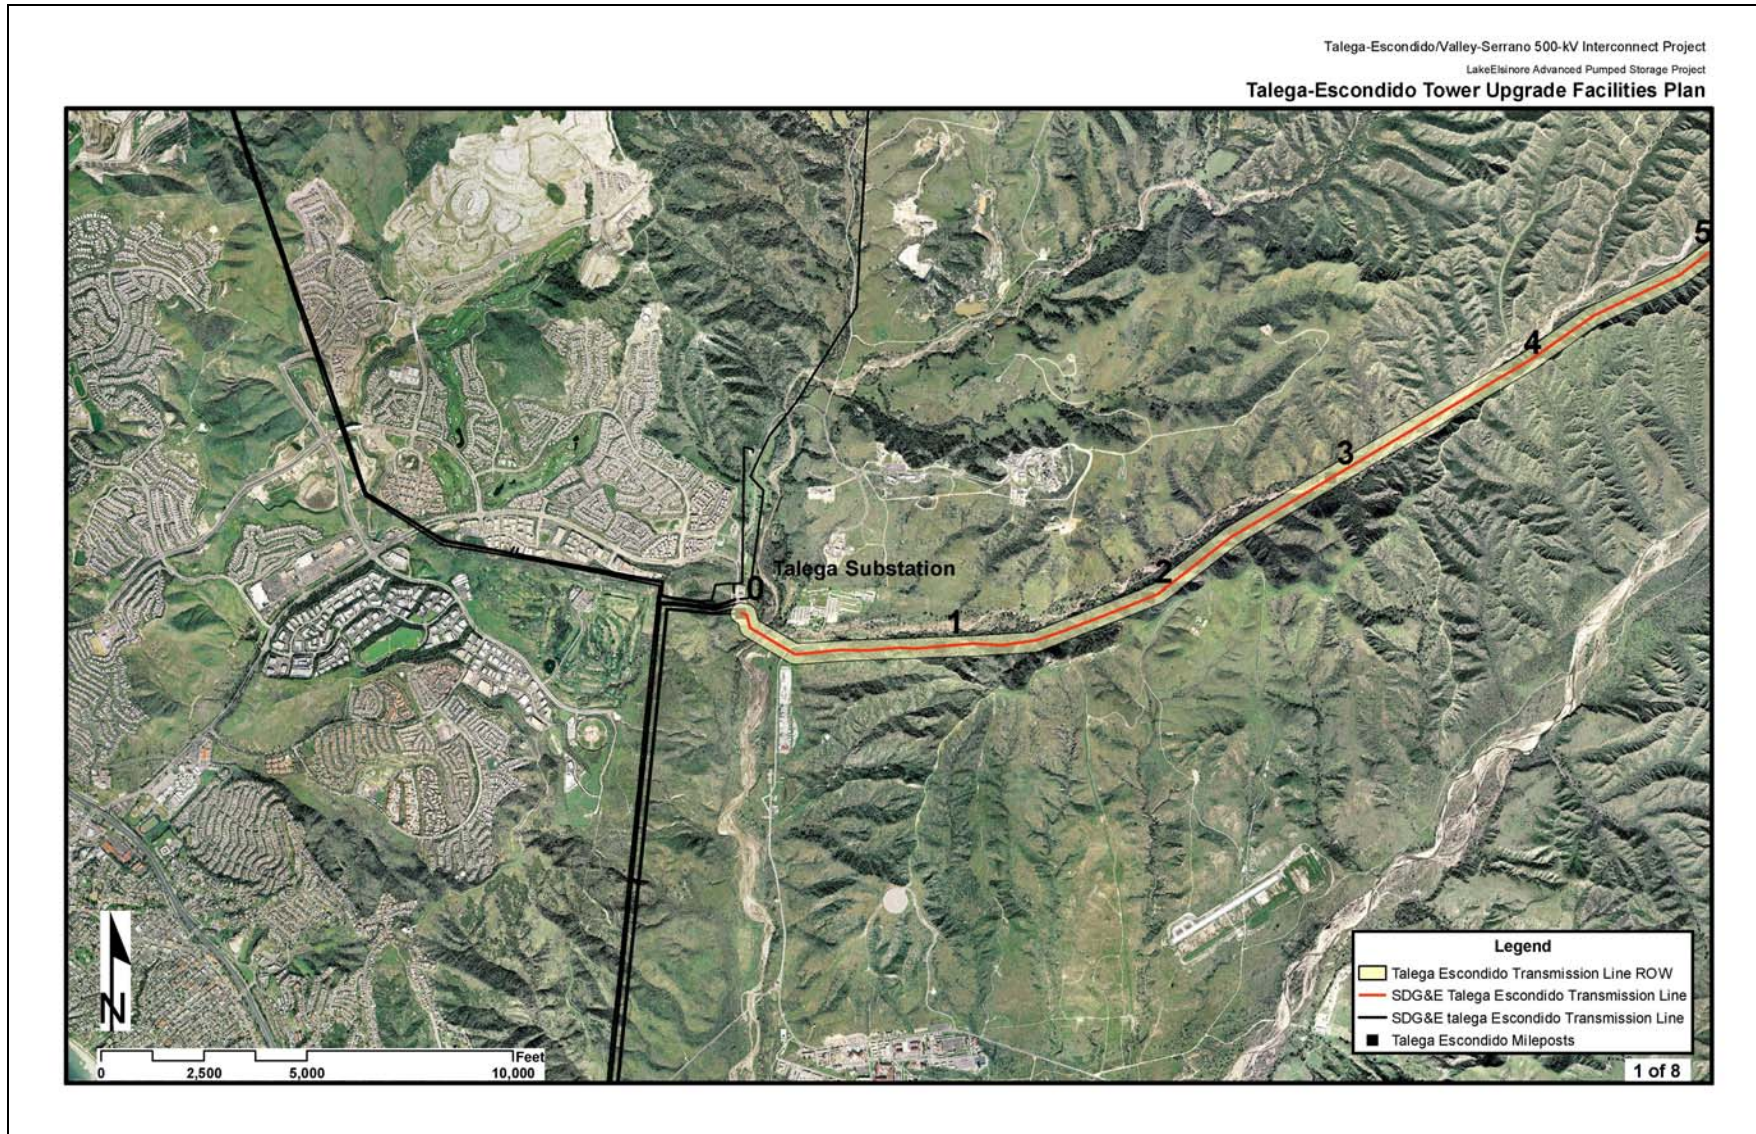


**Figure 3.6.3-2: Talega-Escondido 230 kV Line Upgrade (1 of 8)**

Source: The Nevada Hydro Company

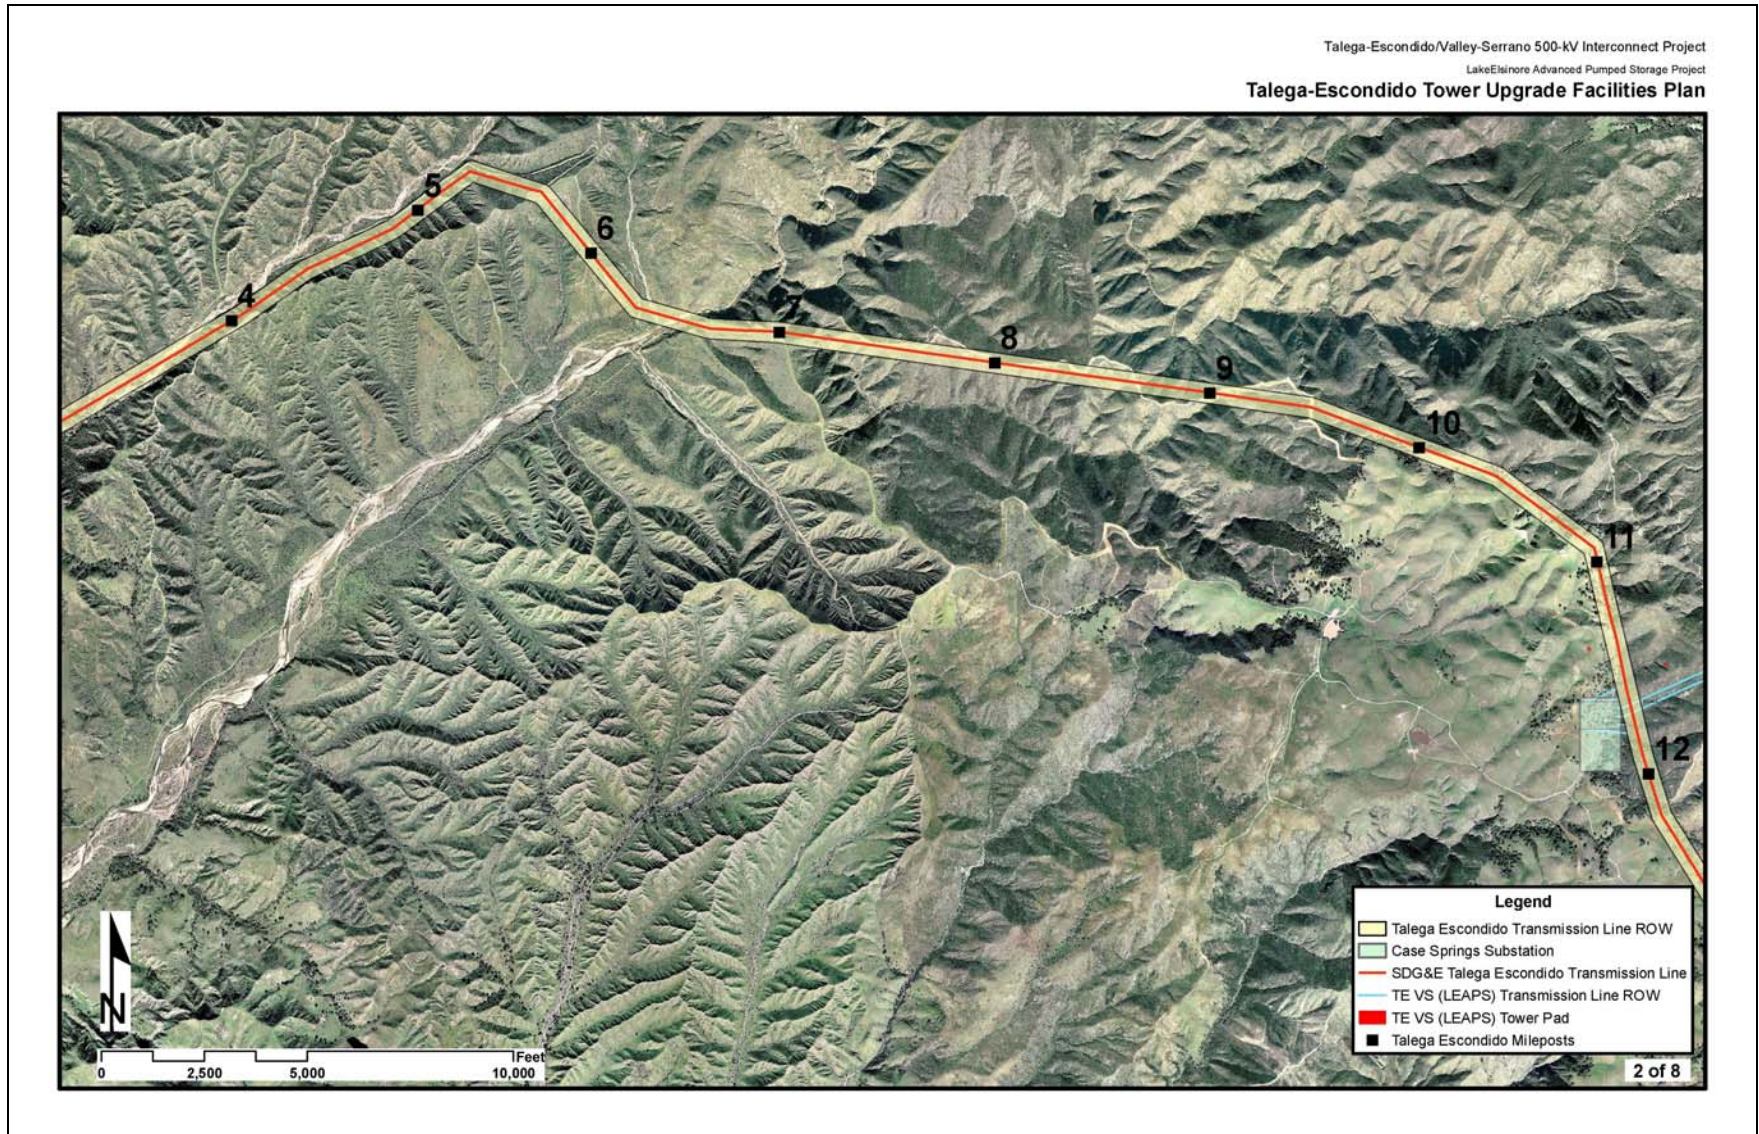


**Figure 3.6.3-2: Talega-Escondido 230 kV Line Upgrade (2 of 8)**

Source: The Nevada Hydro Company

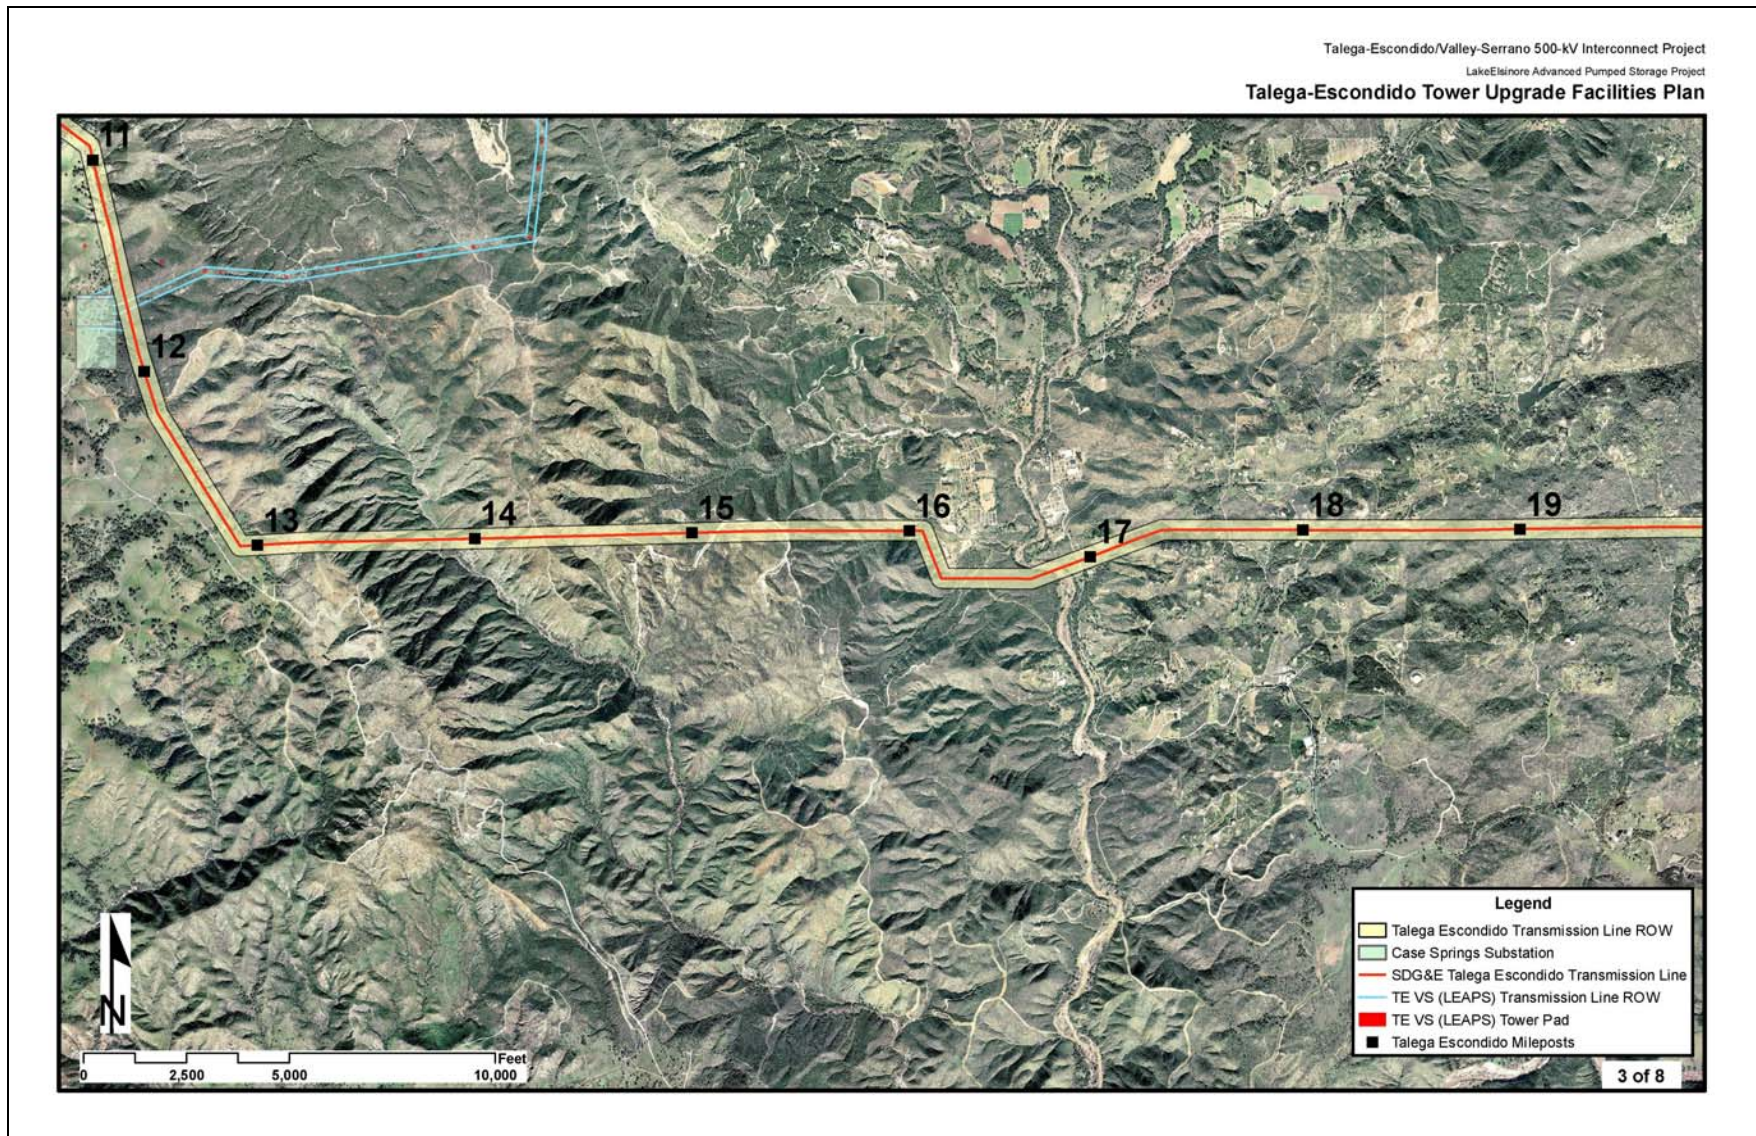


**Figure 3.6.3-2: Talega-Escondido 230 kV Line Upgrade Map (3 of 8)**

Source: The Nevada Hydro Company

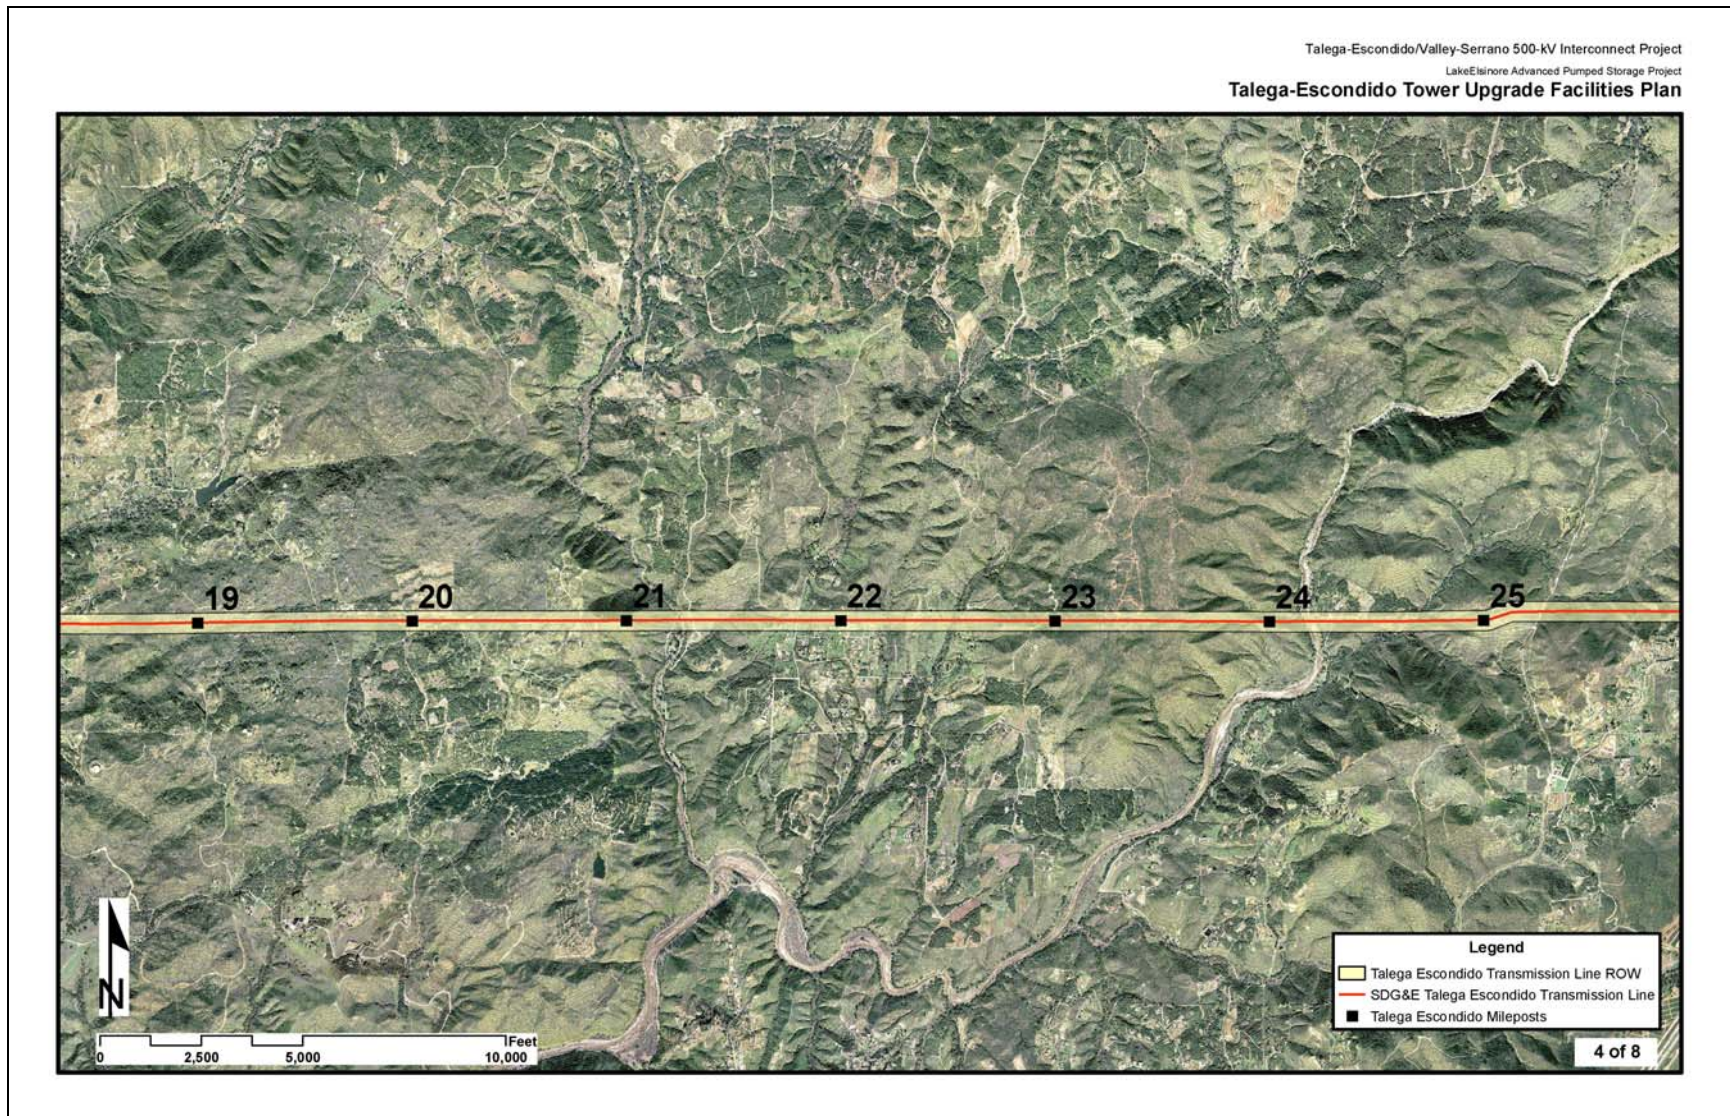


**Figure 3.6.3-2: Talega-Escondido 230 kV Line Upgrade Map (4 of 8)**

Source: The Nevada Hydro Company

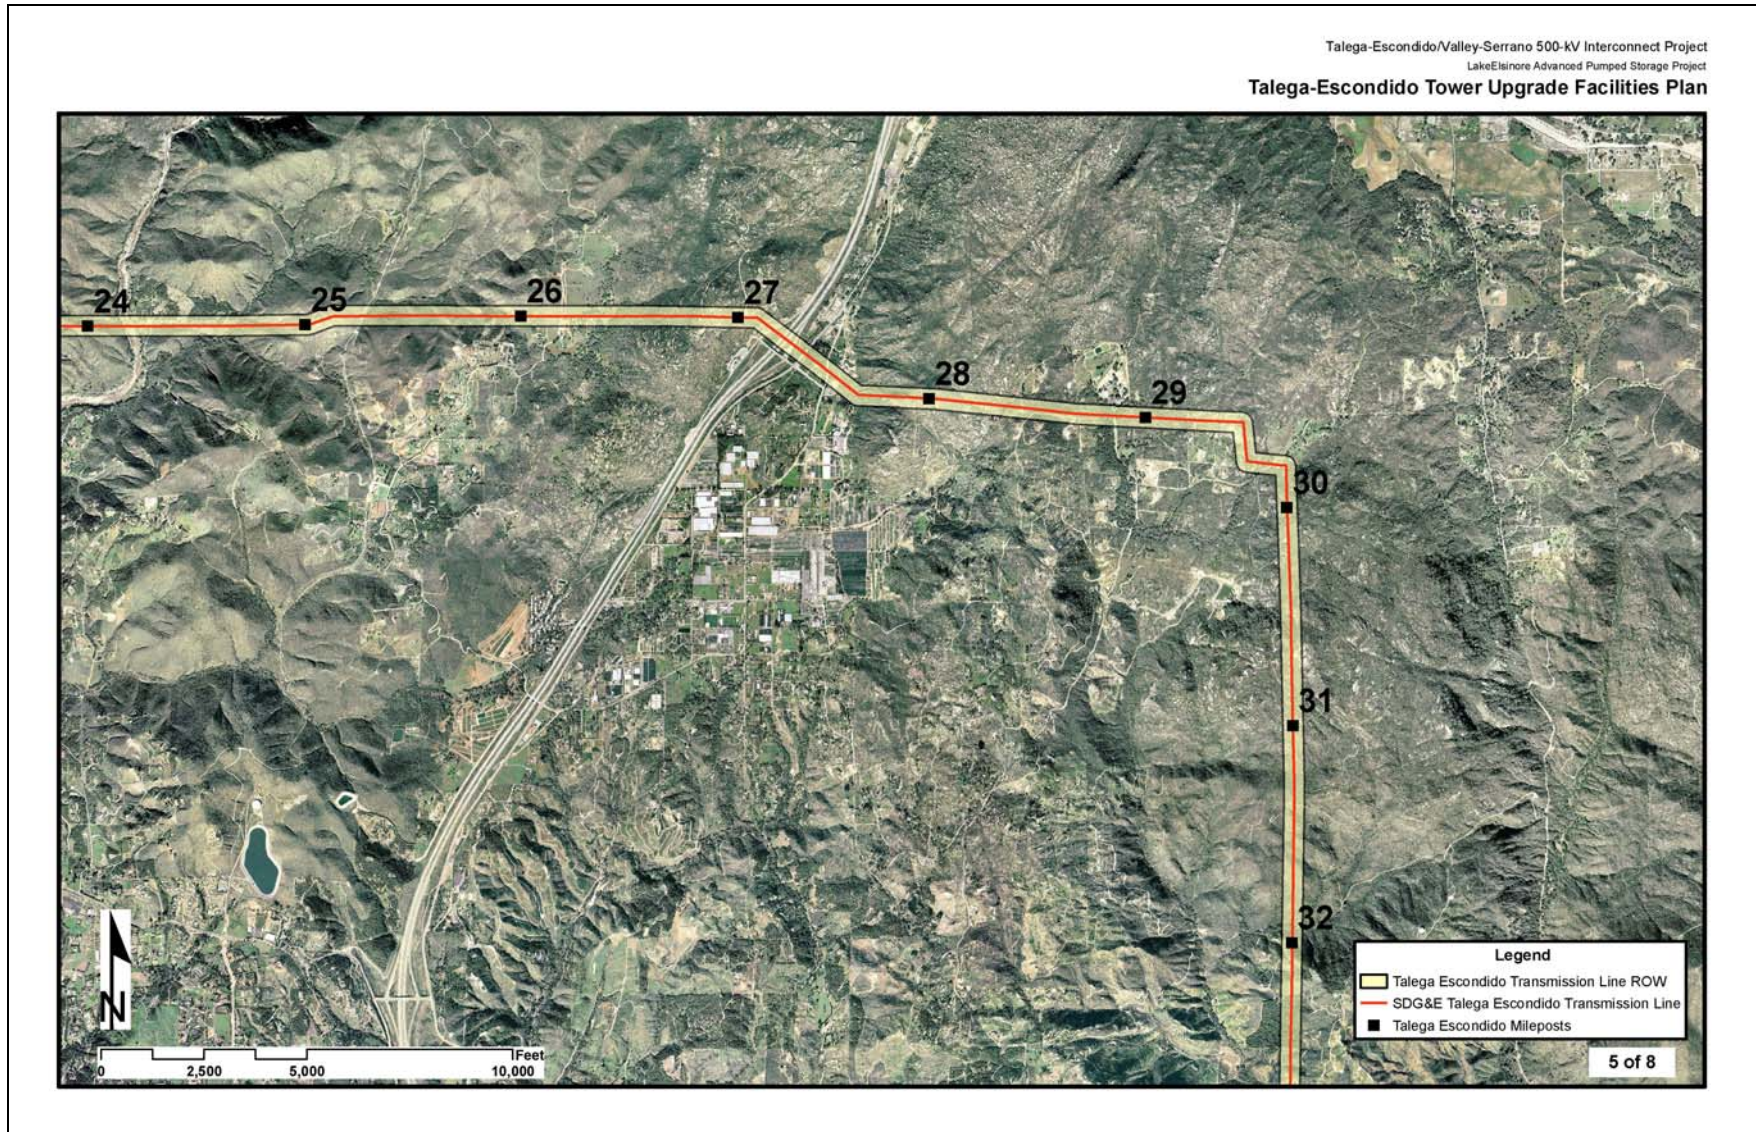


**Figure 3.6.3-2: Talega-Escondido 230 kV Line Upgrade Map (5 of 8)**

Source: The Nevada Hydro Company

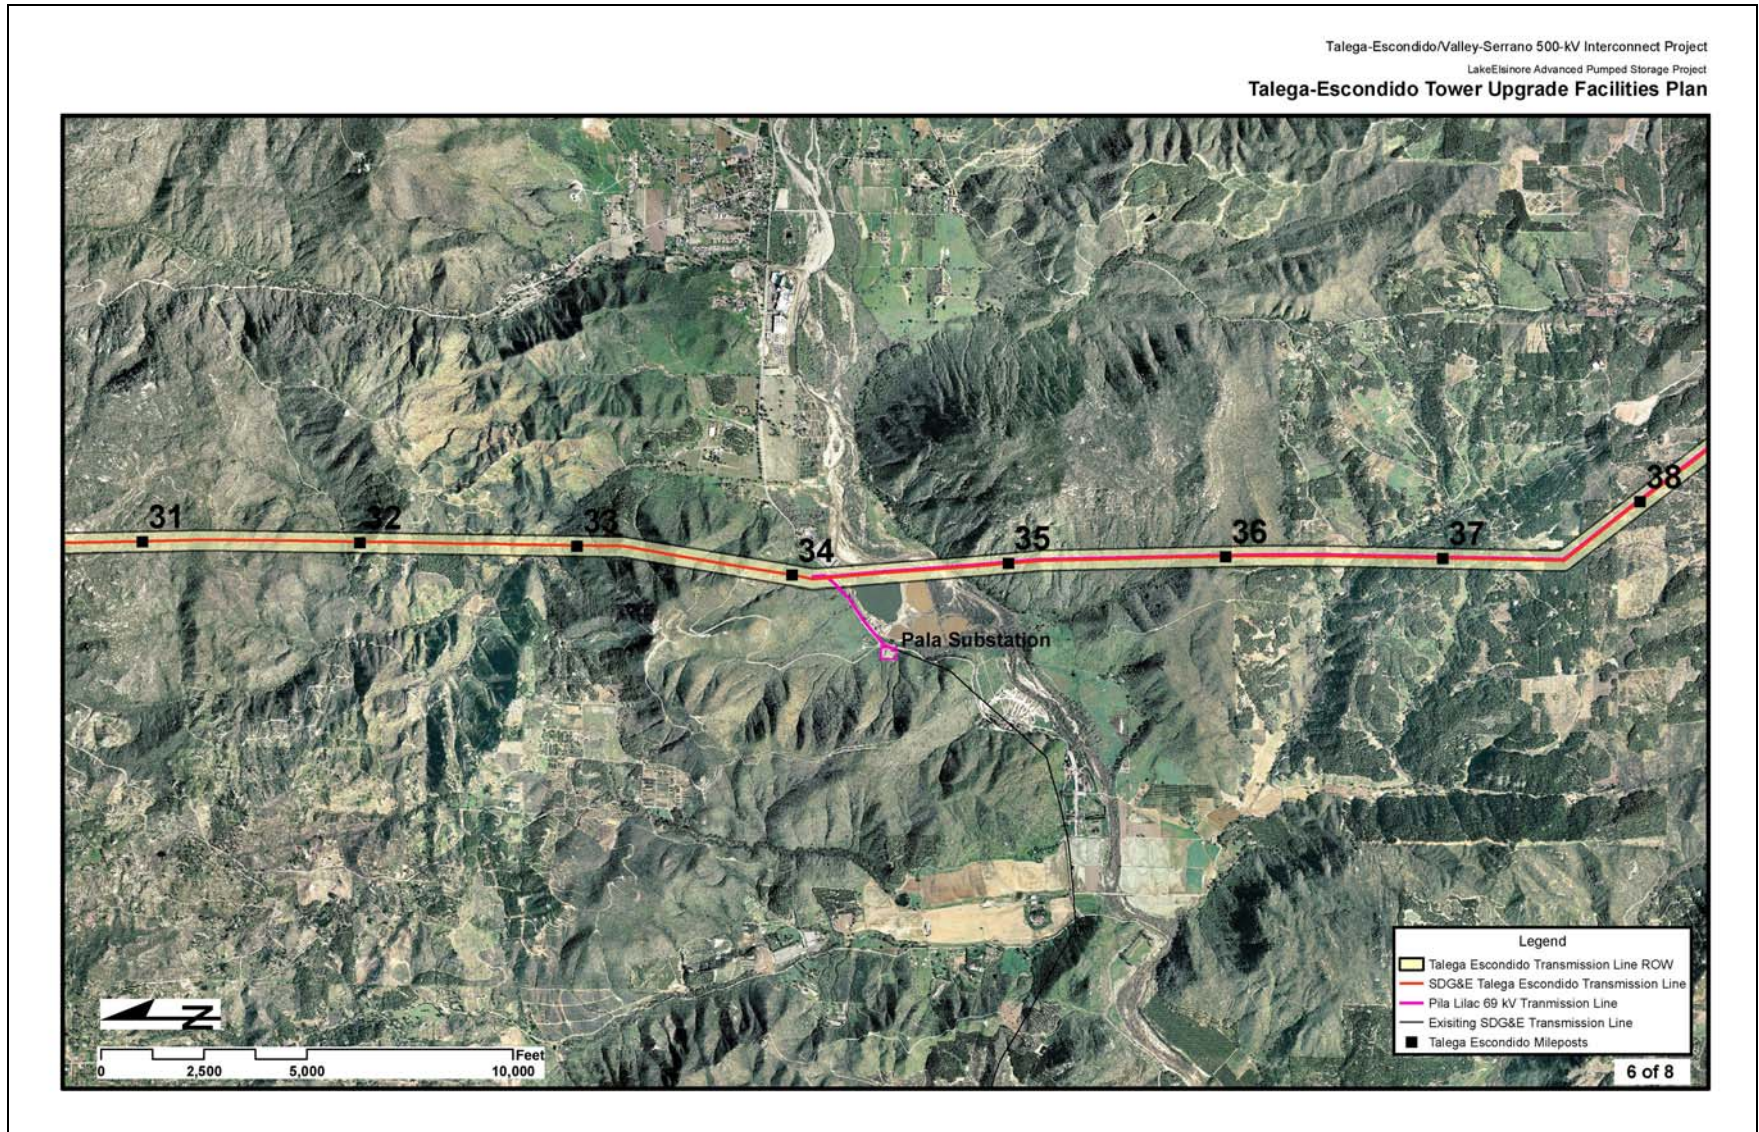

**Figure 3.6.3-2: Talega-Escondido 230 kV Line Upgrade Map (6 of 8)**


Source: The Nevada Hydro Company

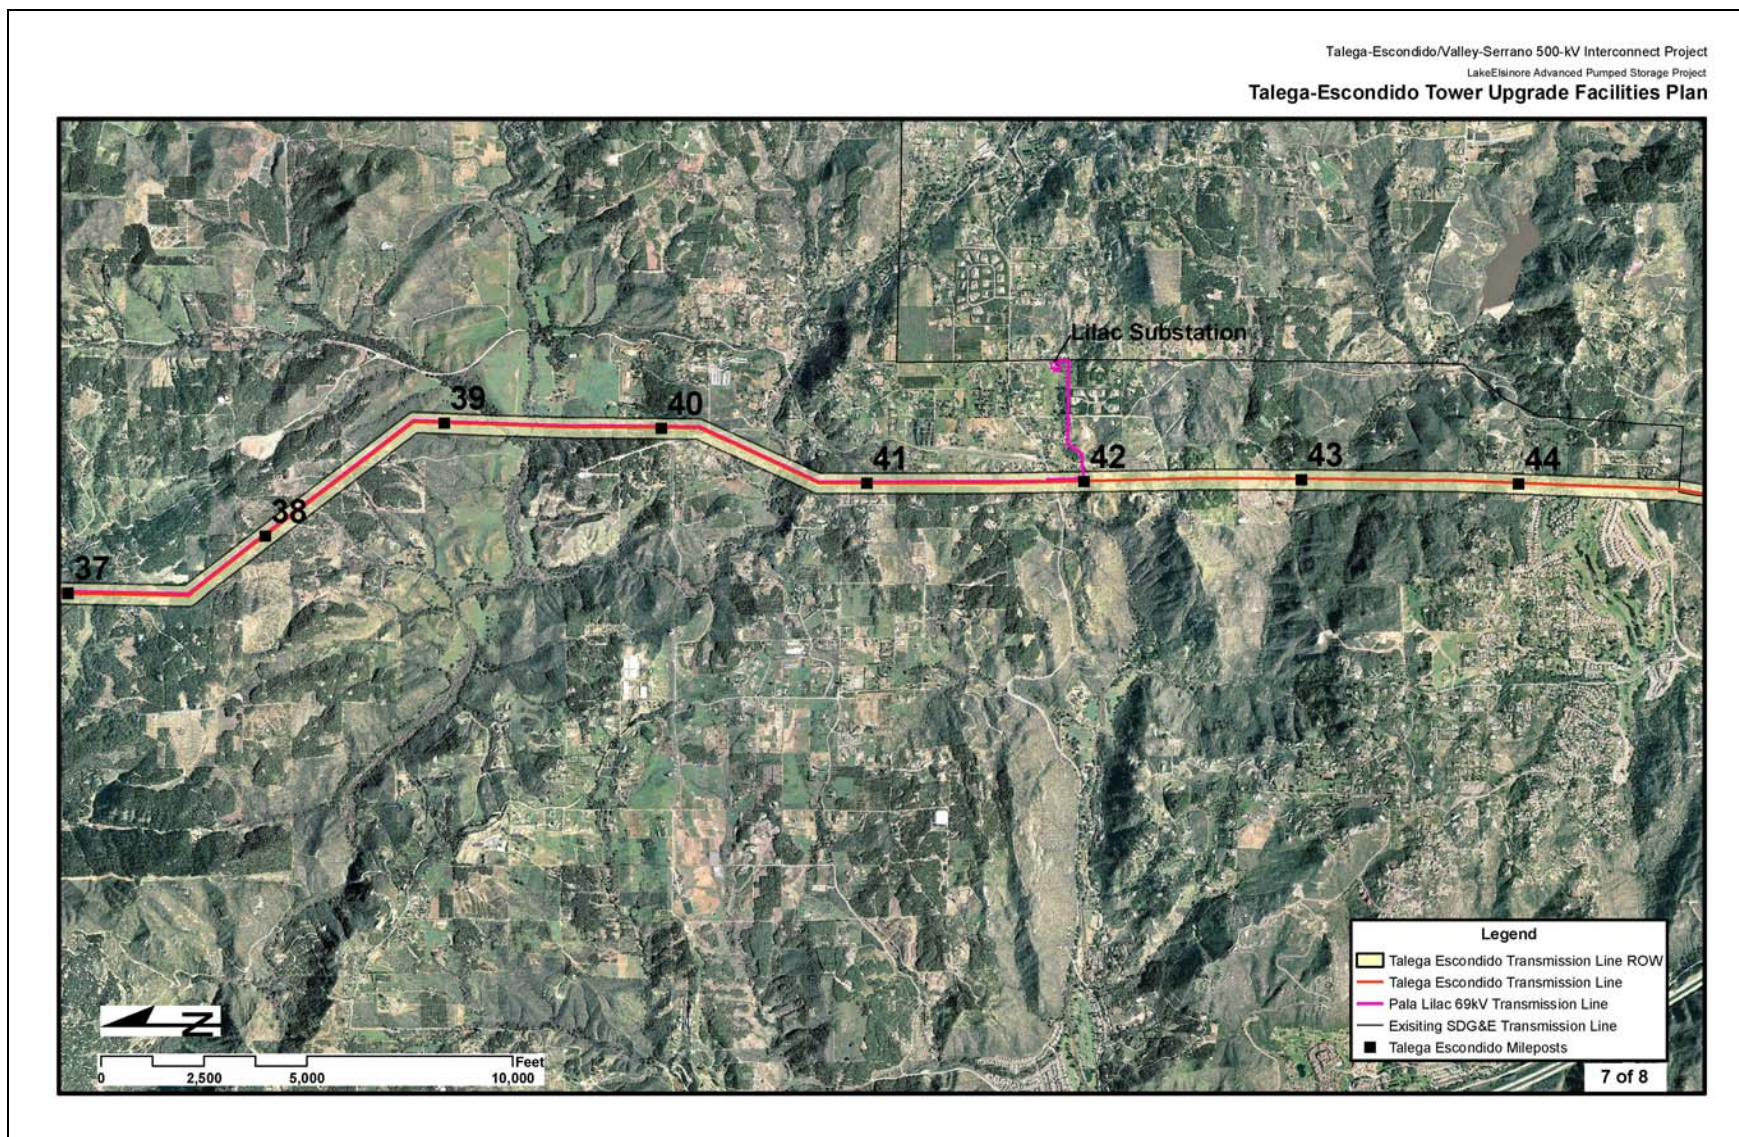

**Figure 3.6.3-2: Talega-Escondido 230 kV Line Upgrade Map (7 of 8)**

Source: The Nevada Hydro Company



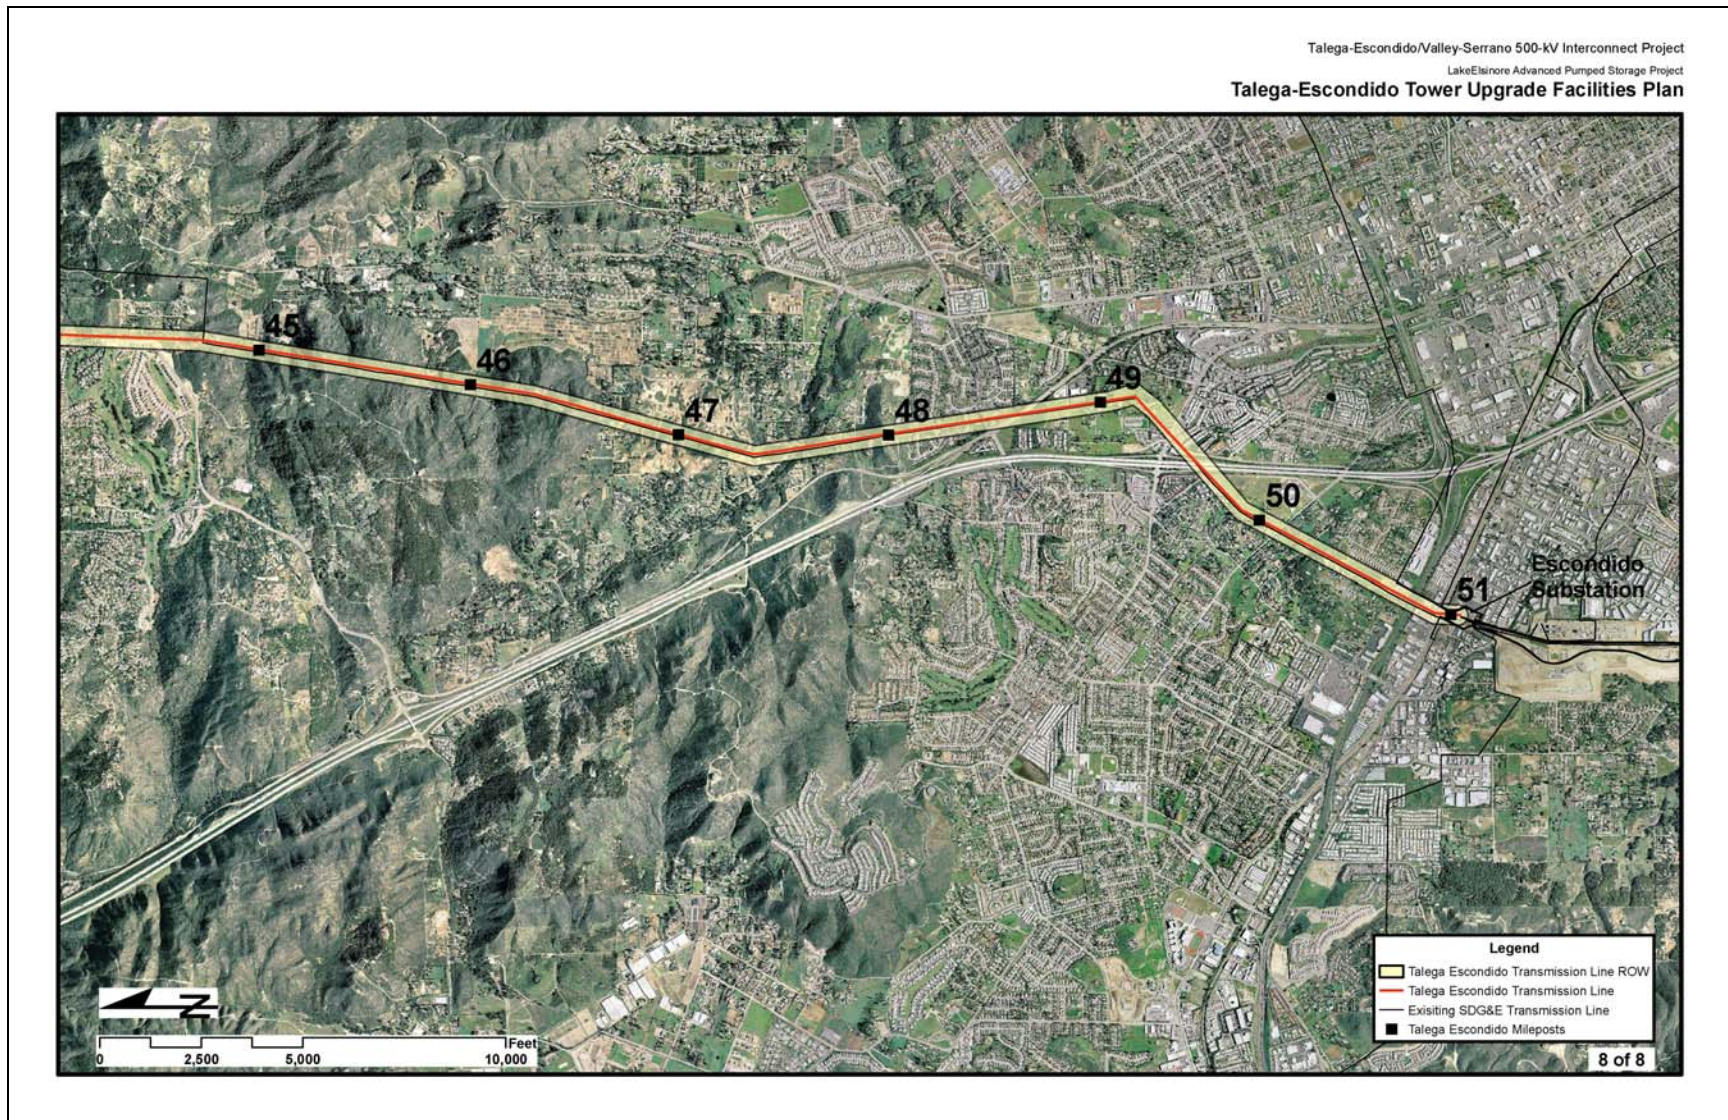

**Figure 3.6.3-2: Talega-Escondido 230 kV Line Upgrade Map (8 of 8)**

Source: The Nevada Hydro Company

This Page Intentionally Blank