


PROFILE: BELL BLUFF TRUCK TRAIL
SCALE
HORIZ: 1"=20'
VERT: 1"=4'

CENTERLINE DATA TABLE



SYMBOL	DELTA/BEARING	RADIUS	LENGTH
CL57	30°20'55"	450.00'	238.36'
CL58	N16°56'38"W	...	83.48'
CL59	69°56'52"	200.00'	244.16'

- NOTE:
1. LINES/CURVES SHOWN ON THE DATA TABLE ARE NOT BROKEN AT MATCH LINES. LENGTHS ARE COMPREHENSIVE.
 2. CONTRACTOR SHALL USE DEFLECTION COUPLINGS TO INSTALL THE 4" PVC DR14 C-900 WATER PIPELINE ALONG CURVES. ALLOWABLE LENGTHS OF PIPE SECTIONS THROUGH CURVES ARE 20', 10', OR 5'. WATERLINE IS 8.0 FEET LEFT OF CENTERLINE. TELECOMMUNICATION AND ELECTRICAL LINE PER SEPARATE PLAN.

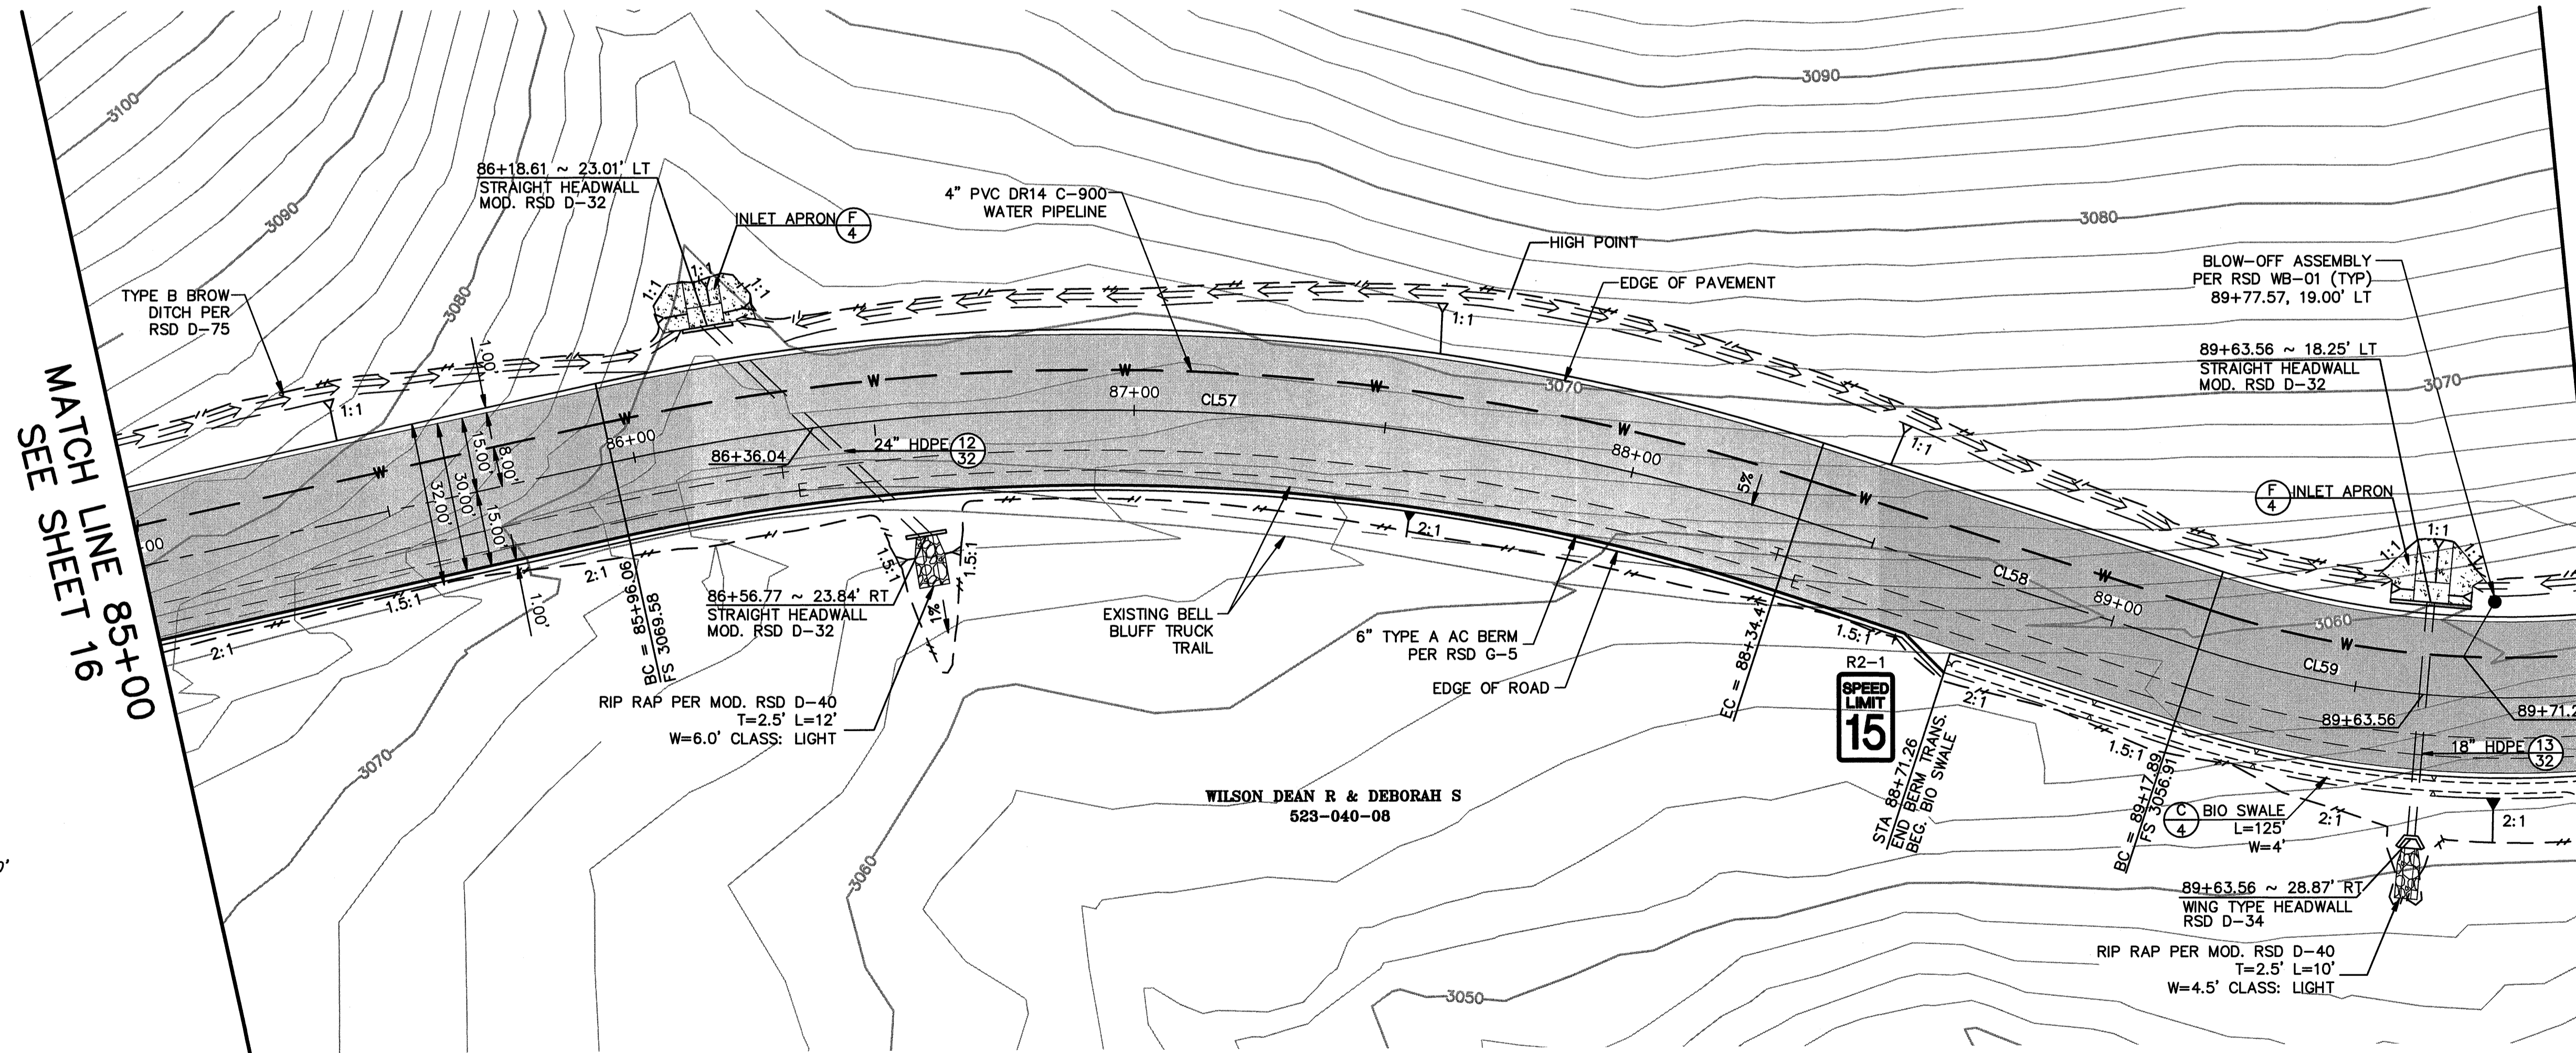

MATCH LINE 85+00
SEE SHEET 16

MATCH LINE 90+00
SEE SHEET 18

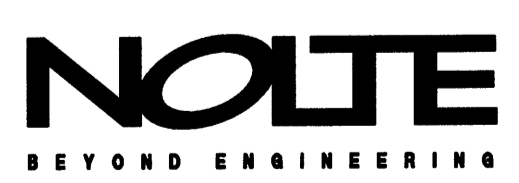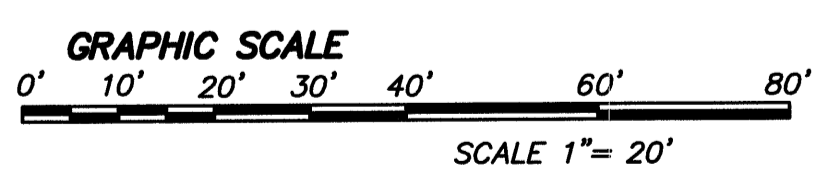


REVISIONS

NO.	WORK DONE	DATE:	BY:	APP'D:	NO.	WORK DONE	DATE:	BY:	APP'D:	NO.	WORK DONE	DATE:	BY:	APP'D:	NO.	WORK DONE	DATE:	BY:	APP'D:	NO.	

SAN DIEGO GAS & ELECTRIC COMPANY
SAN DIEGO, CALIFORNIA

SUNCREST SUBSTATION ACCESS ROAD
PLAN & PROFILE

DRAWN BY: DHT	DATE: 3/24/10	SCALE: 1"=20'	W.O.: -	REV: 0
CHECKED BY: PJC	DATE: -			
APPROVED BY: CR	DATE: -	SHEET 17 OF 55		
CAD NO.: IPPVT17	PLOT SCALE: 1=1			

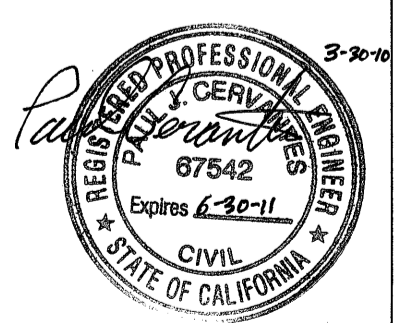

N:\SBO\39600\CADD\USFS\Civil_LP-FVT\IPPT17