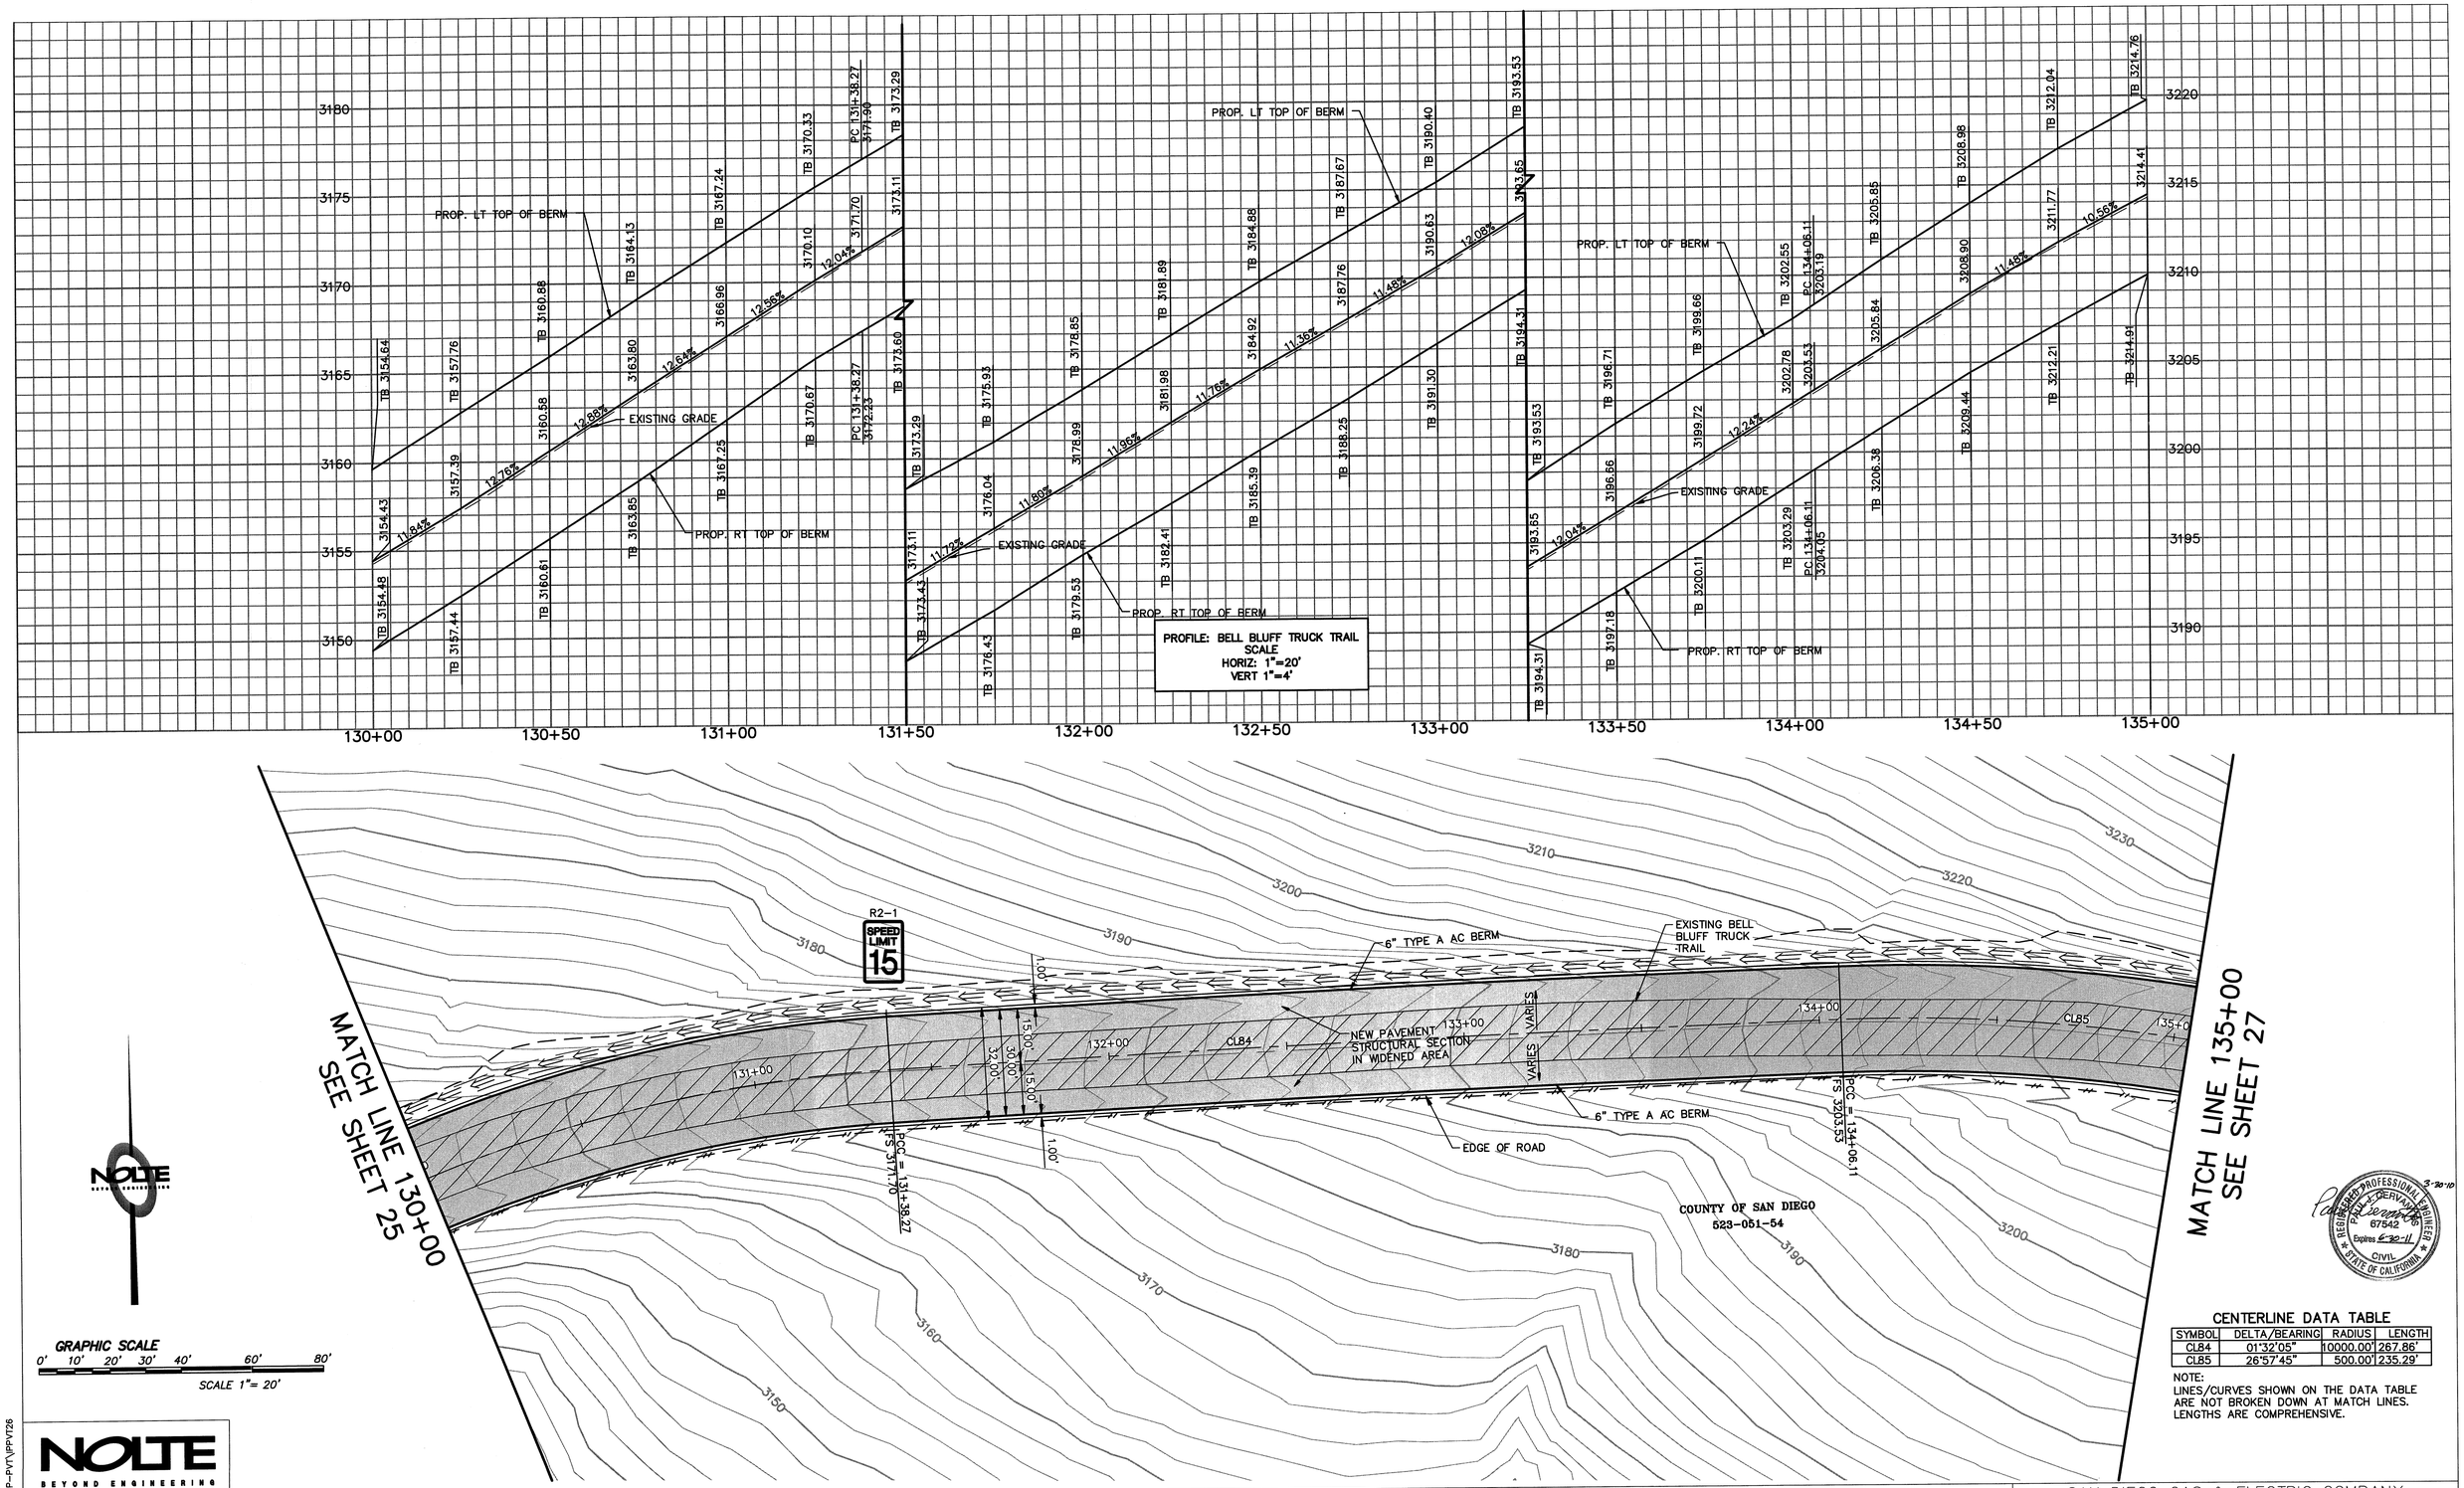

CENTERLINE DATA TABLE

SYMBOL	DELTA/BEARING	RADIUS	LENGTH
CL84	01°32'05"	10000.00'	267.86'
CL85	26°57'45"	500.00'	235.29'

NOTE:
LINES/CURVES SHOWN ON THE DATA TABLE ARE NOT BROKEN DOWN AT MATCH LINES. LENGTHS ARE COMPREHENSIVE.

REGISTERED PROFESSIONAL ENGINEER
PAUL J. CERVANTES
67542
Expires 6-30-11
CIVIL
STATE OF CALIFORNIA
3-30-10

NOLTE
BEYOND ENGINEERING

REVISIONS

NO.	WORK DONE	DATE:	BY:	APP'D:	NO.	WORK DONE	DATE:	BY:	APP'D:	NO.	WORK DONE	DATE:	BY:	APP'D:	NO.	WORK DONE	DATE:	BY:	APP'D:

SAN DIEGO GAS & ELECTRIC COMPANY
SAN DIEGO, CALIFORNIA

SUNCREST SUBSTATION ACCESS ROAD

PLAN & PROFILE

DRAWN BY:	DHT	DATE:	3/24/10	SCALE:	1"=20'	W.O.:	–	REV.: 0
CHECKED BY:	PJC	DATE:	–				
APPROVED BY:	CR	DATE:	–	SHEET 26 OF 55			SCR-C-226
CAD NO.:	IPPVT26	PLOT SCALE:	1=1				

N:\SDB\39600\CADD\USFS\CIVIL\P-PVT\IPPVT26