

ATTACHMENT D Revised PEA Figures



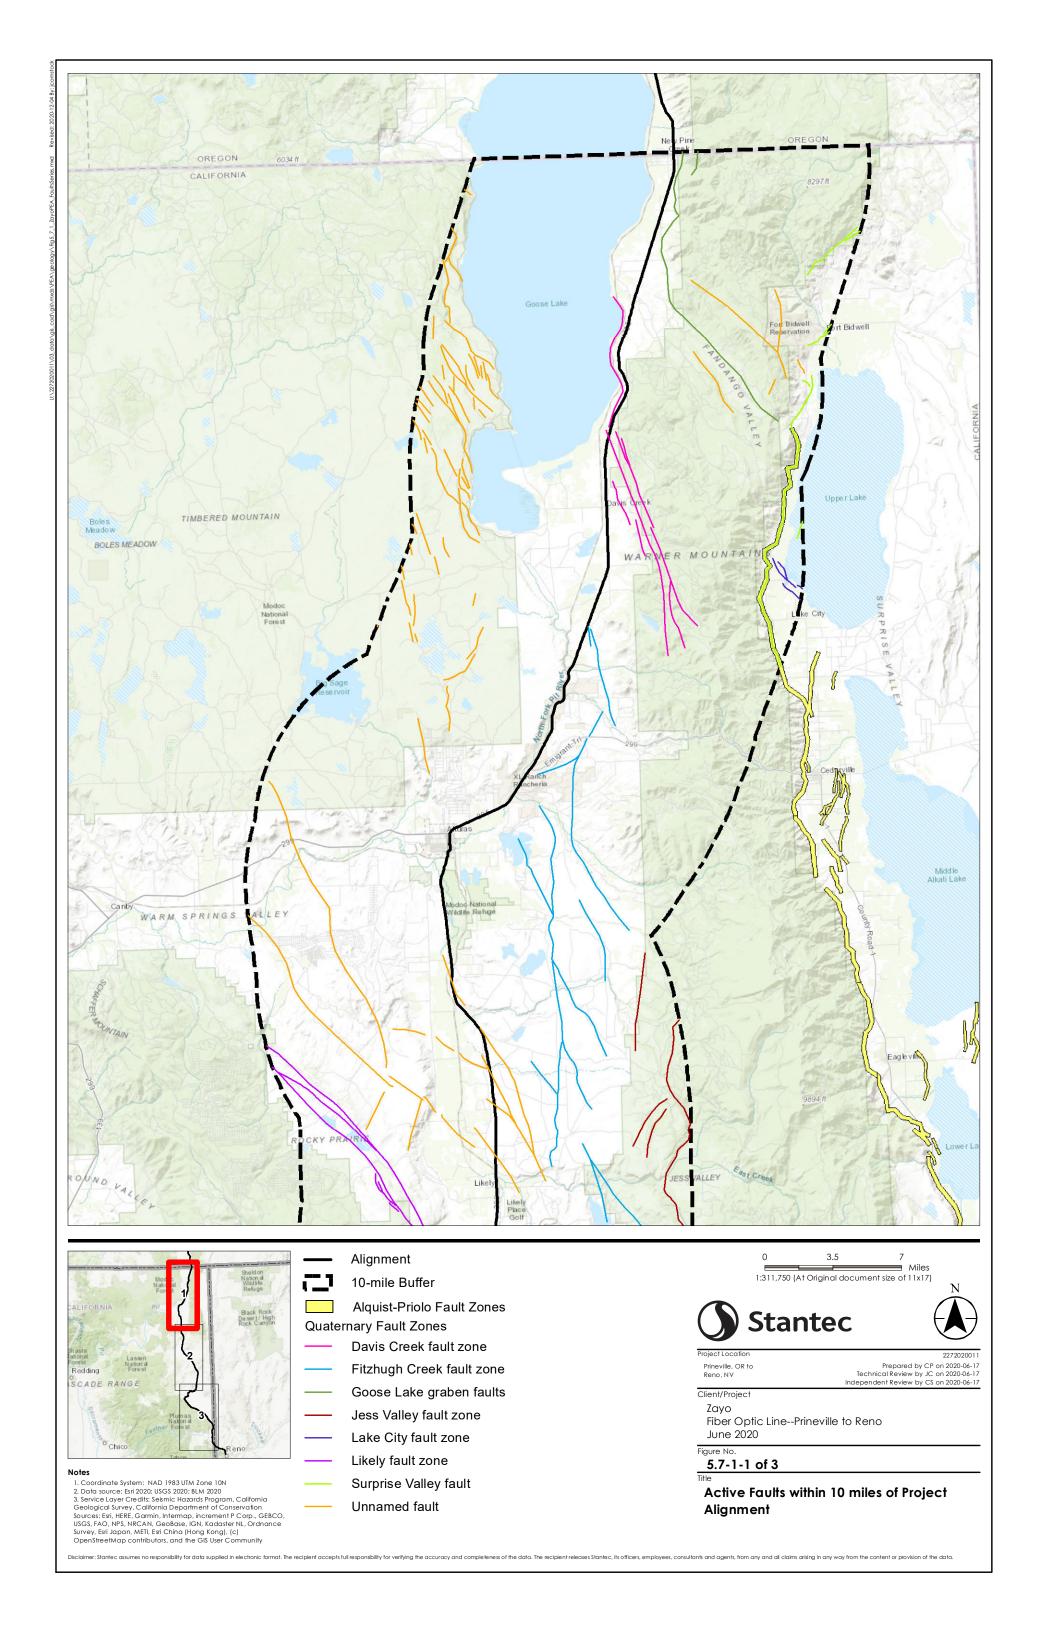

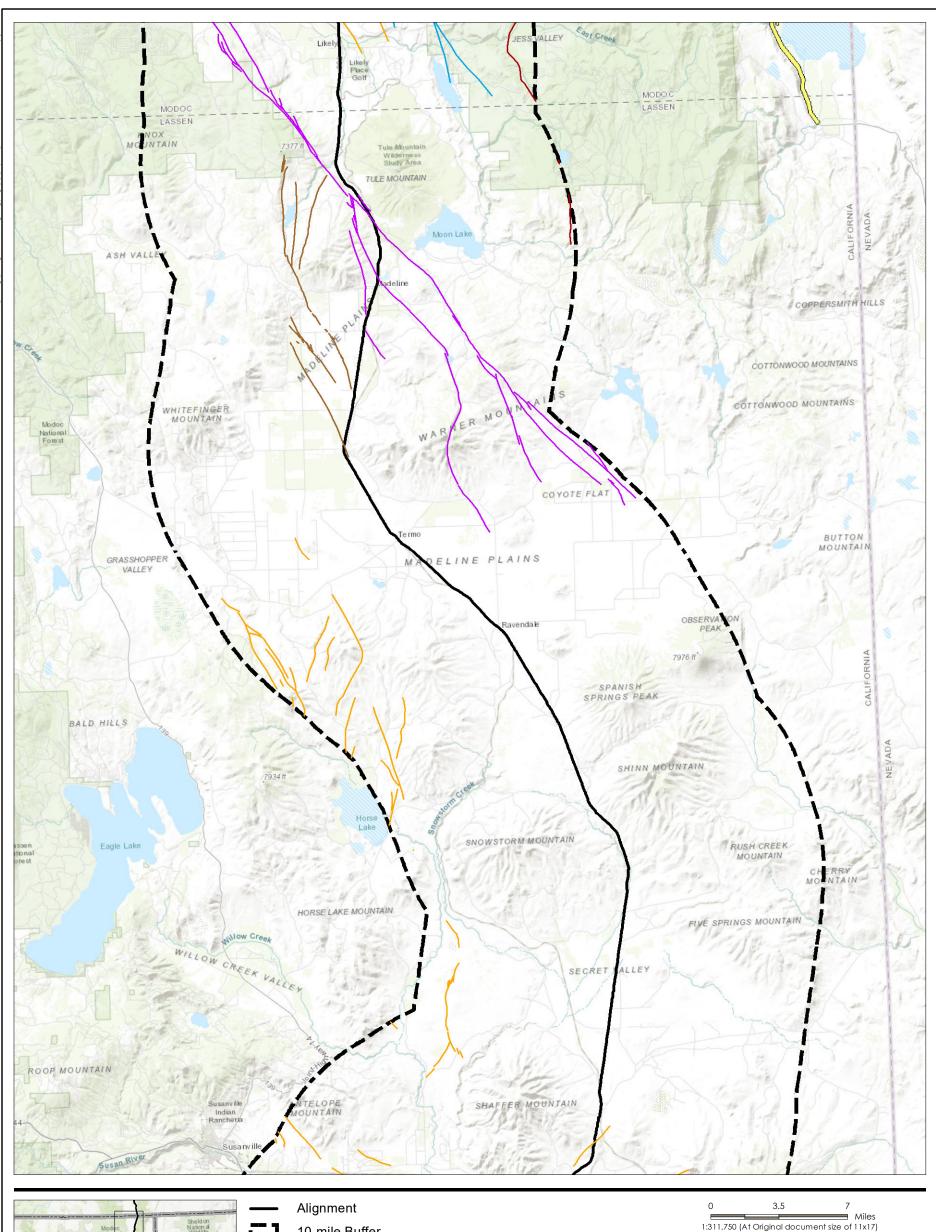

10-mile Buffer

Alquist-Priolo Fault Zones

Quaternary Fault Zones

Fitzhugh Creek fault

Jess Valley fault zone

Likely fault zone

Nelson Corral fault

Unnamed fault

Stantec



Prineville, OR to Reno, NV

Prepared by CP on 2020-06-17 Technical Review by JC on 2020-06-17 Independent Review by CS on 2020-06-17

Client/Project Zayo

Fiber Optic Line--Prineville to Reno June 2020

Figure No. 5.7-1-2 of 3

Active Faults within 10 miles of Project Alignment

Notes


NOTES


1. Coordinate System: NAD 1983 UTM Zone 10N

2. Data source: Esri 2020; USGS 2020; BLM 2020

3. Service Layer Credits: Seismic Hazards Program, California Geological Survey, California Oepartment of Conservation Sources: Esri, HERE, Garmin, Intermap, increment P Corp., GEBCO, USGS, FAO, NPS, NRCAN, GeoBase, IGN, Kadaster NL, Ordnance Survey, Esri Japan, METI, Esri China (Hong Kong), (c)

OpenStreetMap contributors, and the GIS User Community

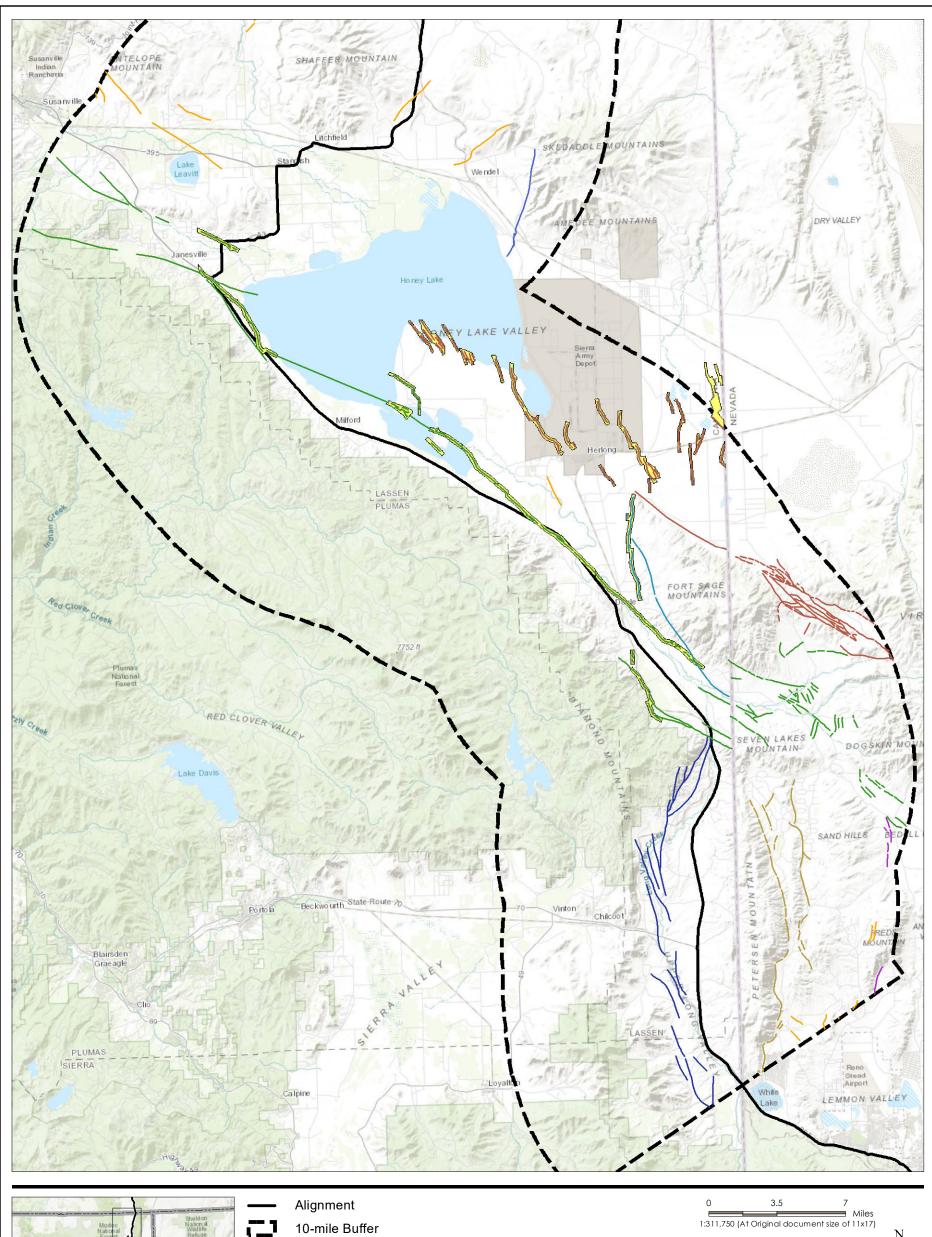



Notes

Notes

1. Coordinate System: NAD 1983 UTM Zone 10N

2. Data source: Esri 2020; USGS 2020; BLM 2020

3. Service Layer Credits: Seismic Hazards Program, California Geological Survey, California Department of Conservation Sources: Esri, HERE, Garmin, Intermap, increment P Corp., GEBCO, USGS, FAO, NPS, NRCAN, GeoBase, IGN, Kadaster NL, Ordnance Survey, Esri Japan, MEII, Esri China (Hong Kong), (c)

OpenStreetMap contributors, and the GIS User Community

Alquist-Priolo Fault Zones

Quaternary Fault Zones

Amedee fault

Fort Sage fault

Freds Mountain fault

Honey Lake fault zone

Petersen Mountain fault

Upper Long Valley fault zone

Warm Springs Valley fault zone

Unnamed fault





Stantec Prepared by CP on 2020-06-17 Technical Review by JC on 2020-06-17 Independent Review by CS on 2020-06-17

Prineville, OR to Reno, NV Client/Project

Zayo Fiber Optic Line--Prineville to Reno June 2020

Figure No.

5.7-1-3 of 3

Active Faults within 10 miles of Project Alignment

